



भारतीय विमानपत्तन प्राधिकरण
AIRPORTS AUTHORITY OF INDIA



अभियांत्रिकी विभाग

लाल बहादुर शास्त्री अन्तरराष्ट्रीय हवाई अड्डा, वाराणसी

DEPARTMENT OF ENGINEERING
LAL BHADUR SHASTRI INTERNATIONAL AIRPORT,
VARANASI-221006

निविदा प्रपत्र **TENDER DOCUMENT**

(Tender ID : 2026_AAI_283667_1)

कार्य का नाम:- वाराणसी के लाल बहादुर शास्त्री अंतर्राष्ट्रीय हवाई अड्डे का विकास;
उप-शीर्षक: परिमीटर लाइटिंग, डब्ल्यूडीआई और लैंडिंग टी की एसआईटीसी.

Name of work:- **Development of Lal Bahadur Shastri International Airport, Varanasi;**
SH: **SITC of Perimeter Lighting, WDI and Landing T.**

BID MANAGER : **ASST. GENERAL MANAGER ENGG (E),
AAI, LBSI AIRPORT, VARANASI**

EXTENSION NO : **0542-2622082 (Ext. 552)**

E-MAIL ID : **ambrish@aai.aero**

INDEX

AIRPORTS AUTHORITY OF INDIA
LBSI AIRPORT, VARANASI - 221006
ELECTRICAL ENGINEERING WING

कार्य का नाम: वाराणसी हवाई अड्डे का विकास - मौजूदा सेवाओं का डायवर्जन (विद्युतीय कार्य)।
NAME OF WORK: **Development of Varanasi Airport-Diversion of existing services (Electrical works).**

INDEX

Sl. No.	PARTICULARS	Page Nos.
1.	COVER PAGE & INDEX	C1, I1, I2
2.	NOTICE INVITING E-TENDER	A1-A12
3.	DETAILS OF SIMILAR WORKS COMPLETED, FORM-A	A13
4.	DETAILS OF FINANCIAL INFORMATION, FORM-B	A14
5.	PROFORMA FOR NET WORTH FROM CHARTED ACCOUNTANT, FORM-C	A15
6.	PROFORMA FOR FINANCIAL DATA FOR LAST 5 AUDITED FINANCIAL YEARS FROM CHARTED ACCOUNTANT, FORM-D	A16
7.	PROFORMA FOR WORK IN HAND FROM CHARTED ACCOUNTANT, FORM-E	A17
8.	PROFORMA OF TENDER ACCEPTANCE LETTER, FORM-F	A18
9.	UNDERTAKING REGARDING DEBARMENT/BLACKLISTING, FORM-G	A19
10.	PROFORMA OF UNDERTAKING FOR PLANT & MACHINERY, FORM-H	A20
11.	UNDERTAKING FOR DECLARATION OF LOCAL CONTENTS, FORM-J, K ,L	A21-A23
12.	GST UNDERTAKING AND PAYMENT FORMAT, FORM-M	A24
13.	E-PAYMENT DETAILS, FORM-N	A25
14.	UNDERTAKING FOR CORRECTNESS OF DOCUMENTS, FORM-O	A26
15.	PQ PERFORMA	A27-A31
16.	ACCOUNT INFORMATION FOR BANK GUARANTEE ANNEXURE R,S	A32-A34
17.	AFFIDAVIT OF MINIMUM WAGES	A35
18.	FORM FOR INSURANCE SURETY BOND TOWARDS EMD	I-IV
19.	GUIDANCE TO BIDDERS	GTB1 to GTB8
20.	Procedure for Online collection of Tender Fee & EMD from Bidders	Tender Fee 1 to Tender Fee 20
21.	GENERAL CONDITIONS OF CONTRACT (GCC) including Cover Page	GCC 1 to GCC 142(143)

		Pages incl cover pg)
22.	SPECIAL CONDITION OF CONTRACT	SCC 1 to SCC 10
23.	TECHNICAL SPECIFICATIONS	TS 1 to TS 22
24.	LIST OF PREFERRED MAKES (LPM)	LPM 1 to LPM 12
25.	SCHEDULE OF WORK	BoQ1 to BoQ7

Certified that this Tender Document having pages 1 to 264 (Two Hundred Sixty Four) only.

Sd/-

Asst. General Manager (Engg. - Elect.)/Bid Manager,
Airports Authority of India,
LBSI Airport, Varanasi-226001.



भारतीय विमानपत्तन प्राधिकरण
AIRPORTS AUTHORITY OF INDIA
एलबीएसआई हवाई अड्डा, वाराणसी - 221006
LBSI AIRPORT, VARANASI - 221006
इलेक्ट्रिकल इंजीनियरिंग विंग
Electrical Engineering Wing

Ref No.: AAI/VNS/JGM(E-E)/eNIT-P6/26-27

Date : 10.07.2026

ई-निविदा आमंत्रण सूचना (2 बीओटी - 2 लिफाफा खुली निविदा)
NOTICE INVITING e-TENDER (2 BOT – 2 Envelope Open Tender)

(निविदा आईडी: 2026_AAI_283667_1)
(Tender Id: 2026_AAI_283667_1)

- i) Item rate e-tenders are invited through the e-tendering CPP portal by **Asst. General Manager (E-E), Airports Authority of India, LBSI Airport, Varanasi -221006** on behalf of Chairman, AAI from the eligible contractors for the work of **“Development of Lal Bahadur Shastri International Airport, Varanasi; SH: SITC of Perimeter Lighting, WDI and Landing T.”** at an estimated cost of **Rs. 4,86,15,526.00 (excluding GST)** with period of completion **7 (Seven) Months.**
- ii) The tendering process is online at CPP-portal URL address <https://etenders.gov.in/eprocure/app> or **www.aai.aero**. Prospective tenders may download and go through the tender document.
- iii) Prospective Tenderers are advised to get themselves register at CPP-portal, obtain ‘Login ID’ & ‘Password’ and go through the instructions available in the Home Page after log in to the CPP-portal <https://etenders.gov.in/eprocure/app> or **www.aai.aero**. They should also obtain Digital Signature Certificate (DSC) in parallel which is essentially required for submission of their application. The process normally takes 03 days’ time. The tenderer may also take guidance from AAI Help Desk Support through path [aai.aero/tender/e-tender/help desk support](http://aai.aero/tender/e-tender/help%20desk%20support).
- iv) For any technical related queries please call the Helpdesk. The 24 x 7 Help Desk details are as below: -
Tel: 0120-4001002, 0120-4001005, 0120-6277787
E-mail: support-eproc@nic.in
- v) Tenderers are requested to mention the URL of the Portal and Tender ID in the subject while emailing any issue along with the contact details.
- vi) Before submitting queries, bidders are requested to follow the instruction given in “Guidelines to Bidders” and get their computer system configured according to the recommended settings as specified in the portal at “System Settings for CPPP”.
- vii) For any further technical assistance with regard to functioning of CPP portal the tenderer may contact to the following AAI help desk numbers on all working days only between

Sl. No.	Support Persons	Escalation Matrix	E-mail Address	Contract Numbers	Timings*
I	Technical Help Desk Team	Instant Support	eprochelp@aai.aero	011- 24632950 Ext. 3512	0800-2000 Hrs. (MON – SAT)

2	JE (IT)	After 4 Hrs. of Issue	etendersupport@aai.aero or vaibhav_g@aai.aero	011- 24632950 Ext. 3523	0930-1800 Hrs. (MON – FRI)
3.	Sr. Manager (IT)	After 12 Hrs.	shripatim@aai.aero	011- 24632950 Ext. 3509	0930-1800 Hrs. (MON – FRI)
4.	Jt. GM (IT)	After 24 Hrs.	Sunil.km@aai.aero	011- 24632950 Ext. 3506	0930-1800 Hrs. (MON – FRI)
5.	General Manager (IT)	After 03 Days.	gmit@aai.aero	011- 24657900	0930-1800 Hrs. (MON – FRI)

*सभी सरकारी राजपत्रित अवकाशों पर हेल्प डेस्क सेवाएं बंद रहेंगी।

*The help desk services shall remain closed on all Govt. Gazetted Holidays.

viii) Tender processing fee of Rs. 1,180/- (i/c GST), non-refundable will be required to be paid online on CPP Portal only.

Earnest Money Deposit (EMD) of Rs. **14,58,466.00 (Rupees Fourteen Lakhs Fifty Eight Thousand Four Hundred Sixty-Six Only)** will be required to be paid online on CPP portal only, by the bidder, within the due date of submission of the bid as above and scanned copy of said payment receipt to be submitted in Envelope –I, failing which the bid shall be summarily rejected.

~~EMD may be submitted in the form of Bank Guarantee in the format (Appendix I C and I D). The Bank Guarantee (PGB/BG-SD/FBG) in accordance with the bank details as mentioned in as below along with Annexure R at page A-40 and A-41.~~

CORPORATE NAME	÷ AIRPORTS AUTHORITY OF INDIA
BANK NAME	÷ ICICI BANK
IFSC CODE	÷ ICIC0000007
BG ADVISING MESSAGE	÷ IFN 760COV (BG ISSUE) IFN 767COV (BG AMENDMENT)
*UNIQUE IDENTIFIER CODE	÷ AAIVARANASI

- निम्नलिखित 02 लिफाफे निविदाकर्ता द्वारा निम्नलिखित अनुसूची के अनुसार सीपीपी-पोर्टल पर ऑनलाइन जमा किए जाएंगे: -

Following 02 envelopes shall be submitted through online at CPP-portal by the tenderer as per the following schedule: -

महत्वपूर्ण डेटा शीट CRITICAL DATA SHEET

Sl. No.	Description	Date
1.	Publishing Date	10.07.2026
2.	Bid Document Download / Sale Start Date	11.07.2026 : 0930 hrs
3.	Clarifications Start Date	11.07.2026 : 0930 hrs
4.	Clarifications End Date	17.07.2026 : 1800 hrs
5.	Bid Submission Start Date	11.07.2026 : 0930 hrs
6.	Bid Submission End Date	01.08.2026 : 1800 hrs
7.	Last date and time of submission of Original Insurance Surety Bond or BG against EMD, if not paid online on CPP Portal.	27.07.2026 : 1100 hrs
8.	Bid Opening Date (Envelop-I)	03.08.2026 : 1200 hrs
9.	Bid Opening Date (Envelop-II)	10.08.2026 : 1200 hrs

नोट: यदि बोलीदाता को कार्य के बोली दस्तावेज़ से संबंधित कोई प्रश्न हो, तो उन्हें स्पष्टीकरण प्राप्त करने के लिए सीपीपी पोर्टल पर 'स्पष्टीकरण प्राप्त करें' का उपयोग करना चाहिए। इस संबंध में संचार के किसी अन्य माध्यम पर विचार नहीं किया जाएगा।

Note: If the bidder has any query related to the Bid Document of the work, they should use 'Seek Clarification' on CPP portal to seek clarifications. No other means of communication in this regard shall be entertained.

2. किसी भी परिस्थिति में बोली प्रक्रिया से संबंधित प्रश्नों को स्वतंत्र बाह्य पर्यवेक्षकों (आईईएम) के पास नहीं भेजा जाएगा।
Under no circumstances bid procedure related queries shall be referred to the Independent External Monitors (IEMs).

लिफाफा-I (तकनीकी बोली और पूर्व-योग्यता) : - बोली में निम्नलिखित शामिल हैं:

Envelope-I (Technical Bid and Pre-qualification) : - Bid containing following:

A. तकनीकी बोली में निम्नलिखित शामिल होंगे: -

Technical Bid containing the following: -

i) निविदा प्रसंस्करण शुल्क की ऑनलाइन भुगतान रसीद और बयाना राशि जमा (ईएमडी) के ऑनलाइन भुगतान की स्कैन की गई प्रति।

Scanned copy of online payment receipt of Tender Processing Fee and online payment of Earnest Money Deposit (EMD).

यदि ईएमडी का भुगतान सीपीपी पोर्टल पर ऑनलाइन नहीं किया गया है:

यदि ईएमडी का भुगतान सीपीपी पोर्टल पर ऑनलाइन नहीं किया गया है (परिशिष्ट IC के अनुसार), तो ईएमडी जारी करने वाले बैंक द्वारा आईसीआईसीआई बैंक को भेजे गए एसएफएमएस (संरचित वित्तीय संदेश प्रणाली) बीजी पुष्टिकरण संदेश की स्कैन की गई प्रति, अनुलग्नक आर के अनुसार, और वचन पत्र (परिशिष्ट ID के अनुसार) संलग्न करें। ईएमडी के विरुद्ध बीजी की मूल प्रति सहायक महाप्रबंधक (इंजीनियरिंग-इलेक्ट्रिकल), विद्युत अभियांत्रिकी शाखा, (बोली प्रबंधक), भारतीय विमानपत्तन प्राधिकरण, एलबीएसआई हवाई अड्डा, वाराणसी - 226001 को महत्वपूर्ण डेटा शीट में उल्लिखित तिथि और समय से पहले जमा/भेजनी होगी।

EMD, if not paid online on CPP Portal:

Scanned copy of BG against EMD with copy of the SFMS (Structured Financial Messaging System) BG confirmation message sent by the BG-issuing bank to ICICI bank as per **Annexure R** if EMD not paid online on CPP Portal (as per Appendix IC) along with letter of undertaking (as per Appendix I D). Original of BG against EMD is required to be submitted/sent to the **Assistant General Manager (Engg-Elect), Electrical Engineering Wing, (Bid Manager), Airports Authority of India, LBSI Airport, Varanasi - 226001** on or before date & time mentioned in CRITICAL DATA SHEET

ii) फॉर्म-ए की स्कैन की गई प्रति - पिछले सात वर्षों के दौरान पूर्ण किए गए समान कार्यों का विवरण, ग्राहक द्वारा जारी किए गए पूर्णता प्रमाण पत्र के साथ।

Scanned copy of Form- A - details of similar works completed during last seven years supported with completion certificate issued by client.

iii) फॉर्म-बी - वित्तीय जानकारी (टर्नओवर) की स्कैन की गई प्रति।

Scanned copy of Form- B - Financial Information (Turnover).

iv) फॉर्म-सी - नेट वर्थ की स्कैन की गई प्रति।

Scanned copy of Form- C - Net Worth.

v) ~~फॉर्म D का स्कैन किया हुआ प्रतिलिपि - वित्तीय डेटा (पिछले 5 वर्षों में किया गया कार्य)।~~

~~Scanned copy of Form - D - Financial Data (Work done during last 5 years)-~~

vi) ~~फॉर्म ई कार्य प्रगति का स्कैन किया हुआ प्रति।~~

~~Scanned copy of Form - E - Work in Hand.~~

vii) ~~जीसीसी के परिशिष्ट 18 के अनुसार हस्ताक्षरित सत्यनिष्ठा समझौते की स्कैन की गई प्रति।~~

~~Scanned copy of Signed Integrity Pact as per Appendix XVI of GCC.~~

viii) बोलीदाता के लेटर हेड पर निविदा स्वीकृति पत्र की हस्ताक्षरित और स्कैन की गई प्रति। (निविदा दस्तावेज, प्रपत्र - एफ में दिया गया प्रपत्र)।

Signed and Scanned Copy of Tender Acceptance Letter on Bidder's Letter Head. (Performa given in Tender Document, Form - F).

ix) कंपनी के लेटर हेड पर ब्लैकलिस्टिंग / डिबारमेंट के संबंध में 'अंडरटेकिंग' की स्कैन की गई प्रति (निविदा दस्तावेज में दिया गया परफॉर्मा)।

Scanned copy of 'Undertaking' regarding Blacklisting / Debarment on Company's Letter Head (Performa given in Tender Document., Form - G).

- x) बोलीदाता को कंपनी के लेटर हेड पर 'अंडरटेकिंग' की स्कैन की हुई प्रति प्रस्तुत करनी होगी कि मैं/हम समय अवधि के भीतर लक्ष्य/उपलब्धियां प्राप्त करने और समग्र रूप से कार्य पूरा करने के लिए प्रभारी अभियंता (ई-आई-सी) के परामर्श से कार्य की आवश्यकता के अनुसार पर्याप्त संयंत्र और मशीनरी तैनात करेंगे। (निविदा दस्तावेज में दिए गए फॉर्म-एच के अनुसार)।

Bidder shall submit scanned copy of 'Undertaking' on Company's Letter Head that I/ We will deploy sufficient plant and machinery as per the requirement of work in consultation with the Engineer-in-Charge (E-I-C) to achieve the milestones/targets and overall completion within the time period. (as per the Form-H given in Tender Document).

- xi) स्वामित्व फर्म के अलावा अन्य बोलीदाताओं को प्राधिकरण पत्र/पावर ऑफ अटॉर्नी की स्कैन की हुई प्रति के साथ कंपनी अधिनियम के तहत कंपनी के निगमन प्रमाणपत्र की प्रति जिसमें कंपनी का सीआईएन/एलएलपीआईएन/निदेशकों का नाम दर्शाया गया हो और पावर ऑफ अटॉर्नी सौंपने के प्राधिकरण के संबंध में बोर्ड के प्रस्ताव की प्रति प्रस्तुत करनी होगी।

स्वामित्व फर्म को प्राधिकरण पत्र/पावर ऑफ अटॉर्नी की स्कैन की हुई प्रति केवल तभी प्रस्तुत करनी होगी जब निविदा को स्वामी के अलावा किसी अन्य व्यक्ति द्वारा संसाधित किया जाता है।

Bidders other than propriety firm shall submit, scanned copy of Authorization Letter/Power of Attorney along with copy of Certificate of Incorporation of the Company under Companies Act showing CIN/LLPIN/Name of Directors of the Company & Copy of Board Resolution regarding Authority to assign Power of Attorney.

Proprietary firm shall submit scanned copy of Authorization Letter/Power of Attorney only if the tender is processed by a person other than proprietor.

- xii) फॉर्म जे, के, एल के अनुसार सामान्य वित्तीय नियम (जीएफआर)-2017 के नियम 144 (xi) के तहत प्रतिबंध पर आदेश के अनुपालन के लिए बोलीदाता द्वारा घोषणा के लिए विधिवत हस्ताक्षरित प्रोफार्मा की स्कैन की गई प्रति।

Scanned Copy of duly signed Performa for Declaration by Bidder for Compliance of Order on Restriction under Rule 144 (xi) of the General Financial Rules (GFRs)-2017 as per Form J,K,L.

- xiii) जीएसटी अंडरटेकिंग की स्कैन की गई प्रति (निविदा दस्तावेज में दिए गए फॉर्म-एम के अनुसार)।

Scanned copy of GST undertaking. (as per the Form-M given in Tender Document).

- xiv) ई-भुगतान विवरण की स्कैन की गई प्रति (निविदा दस्तावेज में दिए गए फॉर्म-एन के अनुसार)।

Scanned copy of E payment details. (as per the Form-N given in Tender Document).

- xv) ~~बचनबद्धता की स्कैन की गई प्रति (निविदा दस्तावेज में दिए गए फॉर्म-ओ के अनुसार)।~~

~~Scanned copy of undertaking (as per the Form -O given in Tender Document).~~

- xvi) वैध इलेक्ट्रिकल कॉन्ट्रैक्टर लाइसेंस की स्कैन की हुई कॉपी।

Scanned copy of Valid Electrical Contractor's License.

- xvii) EPF और ESIC रजिस्ट्रेशन सर्टिफिकेट

EPF & ESIC Registration Certificate-

- xviii) न्यूनतम वेतन के संबंध में ₹100 के स्टाम्प पर शपथ-पत्र

Affidavit of minimum wages on Rs. 100/- stamp

- xix) PAN और GST रजिस्ट्रेशन सर्टिफिकेट की स्कैन की हुई कॉपी

Scanned copy of PAN & GST Registration Certificate

- xx) विधिवत भरा हुआ पीक्यू प्रोफार्मा (निविदा दस्तावेज में दिए गए अनुलग्नक-पीक्यू के अनुसार)।

PQ Performa duly filled. (as per the Annexure-PQ given in Tender Document).

B) ठेकेदारों/निविदाकर्ताओं की योग्यता आवश्यकताएं जिनमें निम्नलिखित शामिल हैं: -

Qualifying requirements of contractors/tenderers containing the following: -

1. निविदा आमंत्रित किए जाने वाले महीने से पहले के महीने के अंतिम दिन को समाप्त होने वाले पिछले 7 (सात) वर्षों के दौरान, समान प्रकृति के कार्य, अर्थात् " **Electrical works** " के एकल अनुबंध में, प्रत्येक **Rs. 194.46 Lacs** (जीएसटी को छोड़कर) के तीन कार्य या प्रत्येक **Rs. 243.08 Lacs** (जीएसटी को छोड़कर) के दो कार्य या **Rs. 388.92 Lacs** (जीएसटी को छोड़कर) का एक कार्य सफलतापूर्वक पूरा किया होना चाहिए।

Should have successfully completed or substantially completed three works, each of **Rs. 194.46 Lacs** (excluding GST) or two works, each of **Rs. 243.08 Lacs** (excluding GST) or one work of **Rs. 388.92 Lacs** (excluding GST) in single contract of Similar nature of work i.e. "**Electrical works**" during last 07 (seven) years ending last day of month previous to the one in which tenders are invited.

पिछले सात वर्षों के दौरान पूर्ण किए गए समान कार्यों का विवरण दिए गए प्रारूप- फॉर्म-ए में ग्राहक द्वारा जारी किए गए सहायक दस्तावेजों के साथ।

The details of similar works completed during last seven years in the given format- Form-A with supporting documents issued by client.

कार्य अनुभव प्रमाणपत्रों की स्कैन की गई प्रति [पीडीएफ प्रारूप में] जमा करनी होगी। योग्यता के लिए ऊपर उल्लिखित कार्यों का मूल्य जीएसटी रहित है। अनुभव प्रमाणपत्रों में स्पष्ट रूप से उल्लेख होना चाहिए कि कार्य मूल्य जीएसटी सहित है या जीएसटी रहित।

Scanned Copy [in PDF Format] of Work Experience Certificates shall be submitted. The Value of Works mentioned above for qualification are exclusive of GST. The experience certificates should clearly mention the work value is inclusive or exclusive of GST.

टिप्पणी: / Note:

2. जीएसटी युग से पहले पूरे किए गए कार्यों के अनुभव प्रमाण पत्रों की पूर्णता राशि को 1.12 से विभाजित किया जाएगा (जीएसटी से पहले के करों को छोड़कर) ताकि इसे जीएसटी के बाद के युग के अनुभव प्रमाण पत्रों के बराबर बनाया जा सके, लेकिन जीएसटी को छोड़कर।

The Experience Certificates of works completed pre-GST era, Completion amount will be divided by 1.12 (to exclude pre-GST taxes) to make it at par with experience certificates of post GST era but excluding GST.

3. एंडएम/एएमसी/सीएमसी कार्यों के लिए वार्षिक दर अनुबंधों हेतु आमंत्रित निविदाओं में, एक वर्ष से अधिक के एएमसी अनुबंधों को पूरा करने का अनुभव रखने वाली एजेंसी को आनुपातिक आधार पर एक वर्ष के पूर्ण कार्य के मूल्य के लिए गिना जाएगा। हालांकि, जिस एजेंसी ने एक वर्ष से अधिक के एएमसी अनुबंधों को पूरा करने में एक वर्ष का कार्य पूरा कर लिया है, उसे आनुपातिक आधार पर एक वर्ष के पूर्ण कार्य के मूल्य के लिए गिना जा सकता है।

The Tenders invited for Annual Rate Contracts for O&M/ AMC/ CMC works, agency having experience of completed AMC contract of more than one year shall be counted for the value of work for a completed one year on pro-rata basis. However, the agency who has completed one year of work in running AMC contract of more than one year, may be counted for the value of work for a completed one year on pro-rata basis.

4. बैक-टू-बैक अनुबंध/उप-अनुबंध आधार पर कार्य निष्पादित करके प्राप्त अनुभव निम्नलिखित शर्तों में स्वीकार्य है: Experience gained by executing work on back-to-back contract/ Sub-contract basis is acceptable in the following conditions:

कार्य वास्तव में दूसरी एजेंसी (उप-ठेकेदार) द्वारा स्वामी की त्रिपक्षीय सहमति/लिखित अनुमोदन के साथ किया जाना चाहिए। इसके साथ वैध अनुबंध और अनुभव प्रमाण पत्र भी होना चाहिए।

Work should be actually executed by the second agency (sub-contractor) with due concurrence of the owner as tripartite agreement/ written approval. It should be backed by valid agreement and experience certificate.

सरी एजेंसी द्वारा प्राप्त भुगतान टीडीएस प्रमाणपत्रों में दर्शाया जाना चाहिए।

Payments received by second agency should be reflected in TDS certificates.

5. विशिष्ट प्रकृति के कार्यों (विशिष्ट वस्तुओं/कार्यों/कार्यों की सूची एएआई कार्य नियमावली के पैरा 35.3 में उल्लिखित है) के लिए संयुक्त कार्यों में प्राप्त अनुभव मुख्य ठेकेदार द्वारा या तो आंतरिक विशेषज्ञता और अनुभव के आधार पर या अनुबंध की शर्तों के अनुसार मुख्य ग्राहक के अनुमोदन से विशिष्ट एजेंसियों की सहायता से निष्पादित किया गया था। ऐसे मामलों में, मुख्य ठेकेदार और विशिष्ट एजेंसी दोनों ही अपने-अपने ग्राहकों से समान कार्य के लिए अनुभव प्रमाण पत्र प्राप्त करते हैं, अर्थात् मुख्य ठेकेदार, मालिक से विशिष्ट कार्यों के साथ-साथ संयुक्त कार्य के लिए और विशिष्ट एजेंसी, मुख्य ठेकेदार से विशिष्ट कार्यों के लिए।

Experience gained in composite works for the specialized nature of works (List of Specialized Items / Jobs/ Works are mentioned at Para 35.3 of AAI Works Manual) were executed by main contractor either by in-house expertise & experience or by engaging the specialized agencies with the approval of main client as per contract conditions. In such cases, main contractor as well as specialized agency both get the experience certificate for the same work from their respective client(s) i.e. main contractor for composite work along with specialized works from owner and specialized agency for specialized work(s) from the main contractor.

इस स्थिति में, आंतरिक विशेषज्ञता और अनुभव रखने वाली विशेष एजेंसी या मुख्य एजेंसी, जिसने वास्तव में विशेष कार्य किया है, के अनुभव प्रमाण पत्र को समान विशेष प्रकृति के कार्य में तकनीकी/पूर्व-योग्यता मानदंडों के लिए विचार किया जाएगा।

In this situation, the experience certificate of either specialized agency or main agency having in-house expertise & experience, who has actually executed the specialized work(s), shall be considered for Technical /Pre-qualifying criteria in similar specialized nature of work(s).

6. पर्याप्त पूर्णता, अनुबंध के तहत निर्धारित लागत के 80 (अस्सी) प्रतिशत या उससे अधिक मूल्य के कार्यों के पूरा होने पर आधारित होगी।

Substantial completion shall be based on 80(eighty) percent of awarded cost or more value wise works completed under the contract.

“निष्पादित कार्यों का मूल्य, कार्य के वास्तविक मूल्य में 7% प्रति वर्ष की साधारण दर से वृद्धि करके वर्तमान लागत स्तर पर लाया जाएगा, जिसकी गणना कार्य पूरा होने की तिथि से बोली खुलने की तिथि (कवर-I/तकनीकी बोली) तक की जाएगी”।

“The value of executed works shall be brought to current costing level by enhancing the actual value of work at simple rate of 7% per annum, calculated from the date of completion to date of bid opening (Cover-I/Technical bid)”.

अनुभव प्रमाणपत्र में किए गए कार्य की प्रकृति, कार्य का मूल्य, कार्य प्रारंभ होने की तिथि, अनुबंध के अनुसार कार्य समाप्ति की तिथि, वास्तविक कार्य समाप्ति की तिथि और कार्य का संतोषजनक समापन दर्शाया जाना चाहिए। गैर-सरकारी/गैर-सार्वजनिक क्षेत्र के उपक्रमों से कार्य अनुभव प्रमाणपत्र दिखाने वाले निविदाकर्ताओं को स्रोतों पर कर कटौती (टीडीएस) प्रमाणपत्र (फॉर्म 16) की प्रति के साथ पंजीकृत चार्टर्ड अकाउंटेंट द्वारा जारी प्रमाणपत्र भी प्रस्तुत करना होगा, जिसमें कार्य का नाम, कार्य के लिए प्राप्त कुल भुगतान और कार्य के लिए टीडीएस राशि का स्पष्ट उल्लेख हो।

Client certificate for experience should show the nature of work done, the value of work, date of start, date of completion as per agreement, actual date of completion and satisfactory completion of work. **Tenderers showing work experience certificate from non-government/non-PSU organizations should submit copy of tax deduction at sources (TDS) certificate(s) (Form 16) along with a certificate issued by registered Chartered Accountant, clearly specifying the name of work, total payment received against the work and TDS amount for the work.**

i) पिछले वित्तीय वर्ष से एकवर्ष पूर्व की 31 मार्च को समाप्त होने वाले तीन वर्षों के दौरान निर्माण/विद्युत कार्यों में औसत वार्षिक वित्तीय कारोबार **Rs. 172.10 Lacs** होना चाहिए। वित्तीय जानकारी दिए गए प्रारूप – फॉर्म-बी में प्रस्तुत की जानी चाहिए।

पिछले तीन वर्षों में बैलेंस शीट में लगातार घाटा दिखाने वाले निविदाकर्ताओं को सीधे तौर पर अस्वीकार कर दिया जाएगा।

Should have Average Annual Financial Turnover of **Rs. 172.10 Lacs** in construction/electrical works during last three years ending 31st March of the one year prior to previous financial year. The Financial Information shall be submitted in the given format – **Form-B**.

Tenderers showing continuous losses during the last three years in the balance sheet shall be summarily rejected.

- ii) निविदाकर्ता के पास प्रमाणित चार्टर्ड अकाउंटेंट द्वारा जारी न्यूनतम **Rs. 72.92 Lacs** की कुल संपत्ति होनी चाहिए, जिसके लिए यूनिआईडी का प्रमाण पत्र आवश्यक है। प्रमाण पत्र दिए गए प्रारूप - फॉर्म-सी में प्रस्तुत किया जाना चाहिए।
The tenderer should have a minimum net worth of **Rs. 72.92 Lacs** issued by certified Chartered Accountants having UNID. The Certificate should be submitted in the given format- **Form-C**.

- iii) निविदा प्रसंस्करण शुल्क और बयाना राशि का भुगतान सीपीपी पोर्टल के पेमेंट गेटवे के माध्यम से क्रिटिकल डेटा शीट में उल्लिखित बोली जमा करने की अंतिम तिथि और समय तक ऑनलाइन करना आवश्यक है। जिन निविदाकर्ताओं द्वारा क्रिटिकल डेटा शीट में उल्लिखित बोली जमा करने की अंतिम तिथि और समय तक ऑनलाइन निविदा प्रसंस्करण शुल्क और बयाना राशि का भुगतान नहीं किया जाता है, उनकी निविदाएँ अस्वीकार कर दी जाएंगी।

Tender processing fee and Earnest Money Deposit is required to be paid online through Payment Gateway of CPP Portal on or before bid submission end date & time mentioned in CRITICAL DATA SHEET. The tenderer, whose tender processing fee and EMD is not paid through online by bid submission end date & time mentioned in critical data sheet, then their tenders will be liable to be rejected.

- iv) मेक इन इंडिया को वरीयता

केवल 'श्रेणी-I स्थानीय आपूर्तिकर्ता' और 'श्रेणी-II स्थानीय आपूर्तिकर्ता', जैसा कि "सार्वजनिक खरीद नीति (मेक इन इंडिया को वरीयता), आदेश 2017- संशोधन दिनांक 16.09.2020" के तहत परिभाषित किया गया है या भारत सरकार, वाणिज्य और उद्योग मंत्रालय, औद्योगिक एवं आंतरिक व्यापार संवर्धन विभाग (नीति खरीद अनुभाग) द्वारा दिनांक 16 सितंबर 2020 के पत्र संख्या P-45021/2/2017-PP (BE-II) के तहत अधिसूचित, आज तक संशोधित किया गया है।

Preference to Make in India

Only 'Class-I Local Supplier' and 'Class-II Local Supplier', as defined under the "Public Procurement Policy (Preference to Make in India), order 2017- revision dated 16.09.2020" or amended upto date, notified by Government of India, Ministry of Commerce and Industry, Department of Promotion of Industrial & Internal Trade (Policy Procurement Section) vide letter No. P-45021/2/2017-PP (BE-II) dated 16th Sep 2020.

'श्रेणी-I स्थानीय आपूर्तिकर्ता' और 'श्रेणी-II स्थानीय आपूर्तिकर्ता' से तात्पर्य ऐसे आपूर्तिकर्ता या सेवा प्रदाता से है, जिसकी खरीद के लिए प्रस्तुत की गई अच्छी सेवाएं या कार्य इस आदेश के तहत निर्धारित न्यूनतम स्थानीय सामग्री को पूरा करते हैं।

'Class-I Local supplier' and 'Class-II Local Supplier' means a supplier or service provider, whose good services or works offered for procurement, meets the minimum local content as prescribed under this Order".

न्यूनतम स्थानीय सामग्री: किसी आपूर्तिकर्ता को "क्लास-I" स्थानीय आपूर्तिकर्ता के रूप में वर्गीकृत करने के लिए स्थानीय सामग्री की आवश्यकता न्यूनतम 50% है और "क्लास-II स्थानीय आपूर्तिकर्ता" के लिए, 'स्थानीय सामग्री' की आवश्यकता "सार्वजनिक खरीद नीति (मेक इन इंडिया को वरीयता), आदेश 2017- संशोधन दिनांक 16.09.2020" के अनुसार न्यूनतम 20% है।

Minimum Local Content: The local content requirement to categorize a supplier as "Class -I" Local Supplier is minimum 50% and for "Class -II Local Supplier", the 'local content' requirement is minimum 20% as per "Public Procurement Policy (Preference to Make In India), order 2017- revision dated 16.09.2020".

क्रय वरीयता: क्रय वरीयता 'क्लास-II स्थानीय आपूर्तिकर्ता' की तुलना में 'क्लास-I स्थानीय आपूर्तिकर्ता' को दी जाएगी, जिसका उद्धृत मूल्य 20% (या डीपीआईआईडी द्वारा अधिसूचित) की क्रय वरीयता के मार्जिन के भीतर आता है, जो कार्य की गैर-विभाज्य प्रकृति पर आधारित है, भारत सरकार, वाणिज्य और उद्योग मंत्रालय, औद्योगिक और आंतरिक व्यापार संवर्धन विभाग (नीति खरीद अनुभाग) द्वारा अधिसूचित "सार्वजनिक खरीद नीति (मेक इन इंडिया को वरीयता), आदेश 2017- संशोधन दिनांक 16.09.2020" के प्रावधानों के अनुसार या आज तक संशोधित।

Purchase preference: Purchase preference shall be given to “Class-I Local Supplier” over 'Class-II local supplier' whose quoted price falling within the margin of purchase preference of 20% (or as notified by DPIIT) based on non- divisible nature of work in accordance with the provisions of “Public Procurement Policy (Preference to Make In India), order 2017- revision dated 16.09.2020” notified by Government of India, Ministry of Commerce and Industry, Department of Promotion of Industrial & Internal Trade (Policy Procurement Section) vide letter No. P- 45021/2/2017- PP (BE-II) dated 16th Sep 2020 or as amended up to date.

स्थानीय सामग्री का सत्यापन:

Verification of local content:

A. "श्रेणी-I स्थानीय आपूर्तिकर्ता" / "श्रेणी-II स्थानीय आपूर्तिकर्ता" को स्थानीय सामग्री का प्रतिशत दर्शाना होगा और स्व-प्रमाणन/वचन देना होगा कि प्रस्तावित वस्तु "श्रेणी-I स्थानीय आपूर्तिकर्ता" / "श्रेणी-II स्थानीय आपूर्तिकर्ता" के लिए स्थानीय सामग्री की आवश्यकता को पूरा करती है, जैसा भी मामला, हो। उन्हें उन स्थानों का विवरण भी देना होगा जहाँ स्थानीय मूल्यवर्धन किया गया है। बोलीदाता को इस संबंध में कंपनी के लेटरहेड पर वचनपत्र की स्कैन की हुई प्रति जमा करनी होगी (फॉर्म-के और एल के अनुसार)।

The “Class-I Local Supplier”/ “Class –II Local Supplier” shall be required to indicate percentage of local content and provide self-certification / undertaking that the item offered meets the local content requirement for “Class-I Local Supplier” / “Class –II Local Supplier” as the case may be. They shall also give details of the location(s) at which the local value addition is made. Bidder shall submit scanned copy of Undertaking on Company’s letter head in this regard (As Per FORM-K & L).

B. स्थानीय सामग्री का दावा केवल आपूर्ति भाग पर किया जाएगा तथा परिवहन, बीमा, स्थापना, कमीशनिंग, प्रशिक्षण, संचालन और एएमसी/सीएमसी/एआईसीएमसी आदि जैसी सेवाओं पर इसका दावा नहीं किया जाएगा।

Local Content shall be claimed on the supply part only and shall not be claimed on the services such as Transportation, Insurance, Installation, Commissioning, Training, Operation & AMC/CMC/AICMC etc.

C. स्थानीय सामग्री की गणना भारत सरकार के दिशानिर्देशों के अनुसार की जाएगी।

Local Content shall be calculated as per Govt. of India guidelines.

D. प्रपत्र एल के अंतर्गत घोषित मदवार स्थानीय सामग्री, सामग्री की वास्तविक आपूर्ति के समय भिन्न हो सकती है। हालाँकि, स्थानीय सामग्री का कुल प्रतिशत "सार्वजनिक खरीद नीति (मेक इन इंडिया को वरीयता), आदेश 2017- संशोधन दिनांक 16.09.2020" के अनुसार "श्रेणी-I स्थानीय आपूर्तिकर्ता" / "श्रेणी-II स्थानीय आपूर्तिकर्ता" (जैसा लागू हो) के लिए न्यूनतम स्थानीय सामग्री आवश्यकता को पूरा करेगा।

Item wise Local Contents declared under FORM L may vary at the time of actual supply of material. However, the total percentage of local contents shall meet the minimum local content requirement for “Class-I Local Supplier”/ “Class –II Local Supplier” (as applicable) in accordance with the “Public Procurement Policy (Preference to Make In India), order 2017- revision dated 16.09.2020”.

E. झूठी घोषणाओं के मामले में, बोलीदाता या उसके उत्तराधिकारियों को एएआई की निविदाओं में भाग लेने के लिए दो साल तक के लिए प्रतिबंधित किया जा सकता है, साथ ही कानून के तहत अन्य कार्रवाई भी की जा सकती है।

In case of false declarations, bidder or its successors can be debarred for up to two years for participating in tenders of AAI along with other actions as may be permissible under law.

F. कोई आपूर्तिकर्ता जिसे इस आदेश के उल्लंघन के कारण किसी अन्य क्रयकर्ता संस्था द्वारा प्रतिबन्धित किया गया है, प्रतिबन्ध की अवधि के दौरान भाग लेने के लिए पात्र नहीं होगा।

A supplier who has been debarred by any other procuring entity for violation of this Order shall not be eligible to participate for the duration of the debarment.

v) जीएफआर के नियम 144(xi) के तहत पंजीकरण की आवश्यकता

Requirement of registration under rule 144(xi) of GFR 2017

भारत सरकार, वित्त मंत्रालय, व्यय विभाग (सार्वजनिक खरीद प्रभाग) के आदेश संख्या एफ क्रमांक 6/18/2019-पीपीडी दिनांक 23/07/2020 के आधार पर भारत के साथ भूमि सीमा साझा करने वाले देश से बोलीदाता द्वारा पंजीकरण की आवश्यकता, सामान्य वित्तीय नियम (जीएफआर) 2017 के नियम 144(xi) के तहत प्रतिबंध के संबंध में अद्यतन संशोधनों के साथ लागू होगी। बोलीदाता को इस संबंध में कंपनी के लेटर हेड पर "अंडरटेकिंग" की स्कैन की हुई प्रति (फॉर्म-के के अनुसार) लिफाफा-I में जमा करनी होगी। यदि बोलीदाता द्वारा प्रस्तुत अंडरटेकिंग/प्रमाणपत्र झूठा पाया जाता है, तो उसकी निविदा तुरंत समाप्त कर दी जाएगी और कानून के अनुसार आगे की कानूनी कार्रवाई की जाएगी जिसमें प्रदर्शन गारंटी और/या सुरक्षा जमा को जब्त करना और भविष्य में एएआई निविदाओं में भाग लेने से रोकना शामिल है।

Requirement of registration by the bidder from a country sharing land border with India based on order No. F No. 6/18/2019-PPD dated 23/07/2020 of Government of India, Ministry of Finance, Department of Expenditure (Public procurement Division) with up to date amendments, regarding restriction under Rule 144(xi) of the General Financial Rules (GFR) 2017 shall be applicable. ~~Bidder shall submit scanned copy of „Undertaking“ on Company's Letter Head in this regard (As per FORM-K) in Envelope-I.~~ If Undertaking/ Certificate submitted by the bidder found to be false, his tender will be immediately terminated and further legal action in accordance with law including forfeiting of Performance Guarantee and/ or Security Deposit and debarring in participating in AAI tenders in future shall be initiated.

ऊपर उल्लिखित लिफाफा-I के सभी दस्तावेजों की स्कैन की गई प्रति सीपीपी पोर्टल पर प्रस्तुत की जाएगी।

Scanned copy of all the Documents of Envelope-I mentioned above shall be submitted on the CPP portal.

लिफाफा-II: - सीपीपी पोर्टल के माध्यम से वित्तीय ई-बोली।

Envelope-II: - The Financial e-Bid through CPP portal.

सभी दरें दिए गए प्रारूप में उद्धृत की जानी चाहिए और कोई अन्य प्रारूप स्वीकार्य नहीं है। यदि निविदा दस्तावेज़ के साथ मूल्य बोली मानक BOQ प्रारूप में दी गई है, तो उसे सभी निविदाकर्ताओं द्वारा डाउनलोड करके भरा जाना चाहिए। निविदाकर्ताओं को BOQ फ़ाइल डाउनलोड करनी होगी, उसे खोलना होगा और नीले रंग के (असुरक्षित) कक्षों में अपने संबंधित वित्तीय उद्धरण और अन्य विवरण (जैसे निविदाकर्ता का नाम) भरने होंगे। अन्य कक्षों में कोई परिवर्तन नहीं किया जाना चाहिए। विवरण भरने के बाद, निविदाकर्ता को फ़ाइल का नाम बदले बिना उसे सेव करके ऑनलाइन जमा करना होगा। यदि निविदाकर्ता द्वारा BOQ फ़ाइल में कोई संशोधन पाया जाता है, तो बोली अस्वीकार कर दी जाएगी।

All rates shall be quoted in the format provided and no other format is acceptable. If the price bid has been given as a standard BOQ format with the tender document, then the same is to be downloaded and to be filled by all the tenderers. Tenderers are required to download the BOQ file, open it and complete the blue coloured (unprotected) cells with their respective financial quotes and other details (such as name of the tenderer). No other cells should be changed. Once the details have been completed, the tenderer should save it and submit it online, without changing the filename. If the BOQ file is found to be modified by the tenderer, the bid will be rejected.

2. ईएमडी की वापसी Refund of EMD

न्यूनतम बोली लगाने वाले को छोड़कर सभी बोलीदाताओं द्वारा जमा की गई अग्रिम राशि वित्तीय बोली खुलने की तिथि से एक सप्ताह के भीतर वापस कर दी जाएगी। सफल बोलीदाता की अग्रिम राशि, अग्रिम राशि/निष्पादन बैंक गारंटी के बराबर सुरक्षा जमा प्राप्त होने पर वापस कर दी जाएगी।

EMD deposited by all the bidders except the confirmed lowest bidder shall be returned within one week from the date of opening of the financial bid. EMD of the successful bidder shall be returned on receipt of Security Deposit equivalent to EMD amount/ performance bank guarantee.

3. बोली प्रस्तुत करना: - Bid Submission: -

निविदाकर्ता को अपना आवेदन केवल सीपीपी पोर्टल: <https://etenders.gov.in/eprocure/app> पर ही जमा करना होगा। निविदाकर्ता/ठेकेदार को सलाह दी जाती है कि वे बोलियाँ ऑनलाइन जमा करने के लिए निविदा दस्तावेज़ में दिए गए निर्देशों का पालन करें। निविदाकर्ताओं को पैरा 2 के अनुसार स्कैन किए गए दस्तावेज़ों की डिजिटल रूप से हस्ताक्षरित फ़ाइल अपलोड करनी होगी। बोली दस्तावेज़ों को 100 डीपीआई के साथ काले और सफेद विकल्प के साथ स्कैन किया जा सकता है, जिससे स्कैन किए गए दस्तावेज़ का आकार कम करने में मदद मिलती है।

The tenderer shall submit their application only at CPP Portal: <https://etenders.gov.in/eprocure/app>. Tenderer/Contractor are advised to follow the instructions provided in the tender document for online submission of bids. Tenderers are required to upload the digitally signed file of scanned documents as per Para 2. Bid documents may be scanned with 100 dpi with black and white option which helps in reducing size of the scanned document.

ऊपर निर्दिष्ट स्थान के अलावा किसी अन्य स्थान पर आवेदन अपलोड करने पर विचार नहीं किया जाएगा। आवेदन की हार्ड कॉपी स्वीकार नहीं की जाएगी।

Uploading of application in location other than specified above shall not be considered. **Hard copy of application shall not be entertained.**

4. व्यावसायिक संबंध रखने वाले एक निविदाकर्ता या निविदाकर्ताओं द्वारा एक से अधिक निविदाएँ प्रस्तुत नहीं की जाएँगी। किसी भी परिस्थिति में पिता और उसके पुत्र/पुत्रियों या अन्य निकट संबंधियों, जिनका आपस में व्यावसायिक संबंध हो (अर्थात् जब एक या एक से अधिक साझेदार/निदेशक समान हों) को एक ही अनुबंध के लिए अलग-अलग प्रतिस्पर्धियों के रूप में निविदा प्रस्तुत करने की अनुमति नहीं दी जाएगी। इस शर्त का उल्लंघन करने पर दोनों पक्षों की निविदाएँ अस्वीकृत कर दी जाएँगी।

Not more than one tender shall be submitted by one tenderer or tenderers having business relationship. Under no circumstance will father and his son(s) or other close relations who have business relationship with one another (i.e. when one or more partner(s)/director(s) are common) be allowed to tender for the same contract as separate competitors. A breach of this condition will render the tenders of both parties liable to rejection.

5. जिस निविदाकर्ता ने केंद्रीय सार्वजनिक खरीद पोर्टल (CPPP) की वेबसाइट <http://etenders.gov.in/eprocure/app> से निविदा डाउनलोड की है, वह डाउनलोड किए गए मूल्य बोली टेम्पलेट सहित निविदा प्रपत्र में किसी भी प्रकार से छेड़छाड़/संशोधन नहीं करेगा। यदि निविदा प्रपत्र में किसी भी प्रकार से छेड़छाड़/संशोधन पाया जाता है, तो निविदा पूरी तरह से अस्वीकार कर दी जाएगी और उसकी अग्रिम राशि जब्त कर ली जाएगी तथा निविदाकर्ता को भारतीय विमानपत्तन प्राधिकरण (AAI) के साथ व्यापार करने से प्रतिबंधित किया जा सकता है।

Tenderer who has downloaded the tender from Central Public Procurement Portal (CPPP) website <http://etenders.gov.in/eprocure/app>, shall not tamper/modify the tender form including downloaded price bid template in any manner. In case if the same is found to be tampered/modified in any manner, tender will be completely rejected and EMD would be forfeited and tenderer is liable to be banned from doing business with AAI.

6. बोली खोलने की प्रक्रिया निम्नानुसार है: -

Bids Opening Process is as below: -

लिफाफा-I (ईएमडी, तकनीकी बोली और पूर्व-योग्यता) :

Envelope-I (EMD, Technical bid and Pre-qualification):

पैरा 2 (ए) और (बी) (निविदाकर्ताओं द्वारा अपलोड) के अनुसार दस्तावेज़ों वाले लिफाफा-I को क्रिटिकल डेटा शीट में उल्लिखित तिथि और समय पर खोला जाएगा।

Envelope-I containing documents as per Para 2 (A) and (B) (uploaded by the tenderers) shall be opened on date & time mentioned in CRITICAL DATA SHEET.

यदि निविदाकर्ता को लिफाफा-I में अपलोड किए गए दस्तावेज़ों में किसी कमी के बारे में स्पष्टीकरण की आवश्यकता होगी, तो उसे आवश्यकता पड़ने पर सीपीपी पोर्टल के माध्यम से स्पष्टीकरण उपलब्ध कराने के लिए कहा जाएगा।

If any clarification is needed from the tenderer about the deficiency in his uploaded documents in Envelope - I, he will be asked to provide it through CPP portal, if required.

निविदाकर्ता को एएआई द्वारा निर्दिष्ट समय के भीतर अपेक्षित स्पष्टीकरण/दस्तावेज अपलोड करने होंगे, ऐसा न करने पर यह मान लिया जाएगा कि बोलीकर्ता के पास प्रस्तुत करने के लिए कुछ नहीं है और बोली का मूल्यांकन तदनुसार किया जाएगा।

The tenderer shall upload the requisite clarification/documents within time specified by AAI, failing which it shall be presumed that bidder does not have anything to submit and bid shall be evaluated accordingly.

निविदाकर्ताओं को उनकी बोलियों की स्वीकृति/अस्वीकृति की सूचना सीपीपी पोर्टल के माध्यम से दी जाएगी।

The intimation regarding acceptance/rejection of their bids will be intimated to the tenderers through CPP portal.

लिफाफा-II (वित्तीय बोली) :

Envelope-II (Financial Bid):

तकनीकी मानदंडों और अर्हता आवश्यकताओं को पूरा करने वाले निविदाकर्ताओं की वित्तीय बोली वाला लिफाफा-II, क्रिटिकल डाटा शीट में उल्लिखित दिनांक और समय पर खोला जाएगा। (यदि लिफाफा-II (वित्तीय बोली) खोलने की तिथि और समय में परिवर्तन करना आवश्यक हो, तो इसकी सूचना सीपीपी पोर्टल के माध्यम से दी जाएगी)।

Envelope-II containing financial bid of the tenderers found to be meeting the technical criteria and qualifying requirements shall be opened on date & time mentioned in CRITICAL DATA SHEET. **(In case the date and time for opening of Envelope-II (Financial bid) is required to be changed, the same shall be intimated through CPP Portal).**

7. एएआई बिना कोई कारण बताए किसी भी या सभी आवेदनों को स्वीकार या अस्वीकार करने का अधिकार सुरक्षित रखता है। एएआई बिना कोई कारण बताए किसी भी स्तर पर निविदा प्रक्रिया को रद्द करने का अधिकार भी सुरक्षित रखता है। AAI reserves the right to accept or reject any or all applications without assigning any reasons. AAI also reserves the right to call off tender process at any stage without assigning any reason.

8. एएआई के पास उन कार्य एजेंसियों को अनुबंध से बाहर करने का अधिकार सुरक्षित है जिनका चालू परियोजना(ओं) में प्रदर्शन निम्न स्तर का और आमतौर पर खराब रहा हो और जिन्हें एएआई के किसी भी विभाग द्वारा निषेधाज्ञा/अस्थायी या स्थायी प्रतिबंध/ब्लैकलिस्टिंग का पत्र जारी किया गया हो। एएआई के पास निविदाकर्ता द्वारा प्रस्तुत प्रमाण पत्रों को किसी भी चरण में (कार्य आवंटित करने से पहले या बाद में) सत्यापित करने का अधिकार सुरक्षित है। यदि किसी भी चरण में, आवेदक द्वारा प्रस्तुत कोई भी जानकारी/दस्तावेज गलत/झूठा पाया जाता है या उसमें कोई ऐसी विसंगति पाई जाती है जो निविदाकर्ता को अयोग्य ठहराती है, तो भारतीय विमानपत्तन प्राधिकरण निम्नलिखित कार्रवाई करेगा:

AAI reserves the right to disallow the working agencies whose performance at ongoing project (s) is below par and usually poor and has been issued letter of restrain/Temporary or Permanent debarment/black listing by any department of AAI. **AAI reserves the right to verify the credential submitted by the tenderer at any stage (before or after the award the work). If at any stage, any information /documents submitted by the applicant is found to be incorrect/false or have some discrepancy which disqualifies the tenderer then Airports Authority of India shall take the following action:**

- a) निविदाकर्ता द्वारा जमा की गई ईएमडी की पूरी राशि जब्त कर ली जाएगी।

Forfeit the entire amount of EMD submitted by the tenderer.

- b) निविदाकर्ता को एएआई में निविदा देने से दो वर्ष तक की अवधि के लिए रोक दिया जाएगा, जिसमें किसी अन्य उचित संविदात्मक/कानूनी कार्रवाई के अलावा अनुबंध की समाप्ति भी शामिल है।

The tenderer shall be liable for debarment for a period upto two years from tendering in AAI, including termination of the contract apart from any other appropriate contractual/legal action.

9. कंसोर्टियम/जेवी कंपनियों को अनुमति नहीं दी जाएगी।
Consortium /JV companies shall not be permitted.

10. केन्द्रीय सार्वजनिक क्षेत्र उपक्रम को क्रय वरीयता स्वीकृति की तिथि पर भारत सरकार के निर्देशानुसार लागू होगी।
Purchase preference to Central Public Sector Undertaking shall be applicable as per the directive of Govt. of India prevalent on the date of acceptance.

11. डीआईसी/एनएसआईसी/केवीआईसी/केवीआईबी/हस्तशिल्प एवं हथकरघा निदेशालय आदि में पंजीकृत भारतीय सूक्ष्म एवं लघु उद्यमों (एमएसई) को एमएसई के लिए सार्वजनिक खरीद नीति आदेश 2012 के प्रावधानों के अनुसार दी जाने

वाली रियायतें, जिनमें नवीनतम संशोधन शामिल हैं, केवल आपूर्ति और सेवाओं की निविदाओं पर लागू होंगी और निर्माण कार्य पर लागू नहीं होंगी। चूँकि यह कार्य निर्माण कार्य की श्रेणी में आता है, इसलिए भारतीय सूक्ष्म एवं लघु उद्यमों (एमएसई) को यह रियायत लागू नहीं होगी।

Concessions to Indian Micro & Small Enterprises (MSEs) units registered with DIC/ NSIC/ KVIC/ KVIB /Directorate of Handicraft and Handloom etc., to be given as per the provisions of Public Procurement Policy for MSEs order 2012 with up to date amendments, shall be applicable for tenders of supply and services only and shall not be extended to construction work. As this work comes under construction work category, **hence concession to Indian Micro and Small Enterprises (MSEs) is not applicable.**

12. निविदाकर्ताओं को विशिष्ट दस्तावेज़ पहचान संख्या (UDIN) से उत्पन्न दस्तावेज़ जैसे बैलेंस शीट/टर्नओवर प्रमाणपत्र, कार्यशील पूंजी प्रमाणपत्र (पिछले 5 वित्तीय वर्षों के दौरान किए गए कार्य और वर्तमान कार्य), निवल संपत्ति प्रमाणपत्र, गैर-सरकारी कार्यों के लिए स्रोत पर कर कटौती (TDS) प्रमाणपत्र आदि, NIT शर्तों के अनुसार CA द्वारा विधिवत प्रमाणित और UDIN युक्त प्रस्तुत करने होंगे। बिना UDIN के बोलीदाताओं द्वारा प्रस्तुत दस्तावेज़ों पर विचार नहीं किया जाएगा।

Tenderers have to submit Unique Document Identification Number (UDIN) generated documents like Balance Sheet / Turnover certificate, Working Capital Certificate (works done during last 5 financial years & works in hand), Net worth Certificate, Tax Deduction at Source (TDS) Certificates for Non- Govt. works etc. as per NIT conditions duly certified by CA and having UDIN. The documents submitted by bidders without UDIN shall not be entertained.

13. उद्योग संवर्धन और आंतरिक व्यापार विभाग (डीपीआईआईटी), वाणिज्य और उद्योग मंत्रालय, भारत सरकार, द्वारा जारी सार्वजनिक खरीद (मेक इन इंडिया को वरीयता), आदेश 2017, कार्यालय ज्ञापन संख्या पी-45021/2/2017-पीपी (बीई-II) दिनांक 16.09.2020 लागू है।

Department of Promotion of Industry and Internal Trade (DPIIT), Ministry of Commerce and Industry, Government of India, issued Public Procurement (Preference to Make in India), Order 2017 vide OM No. P-45021/2/2017-PP(BE-II) dated 16.09.2020 is applicable.

14. सामान्य वित्तीय नियम (जीएफआर) 2017 के नियम 144(xi) के अंतर्गत प्रतिबंधों के संबंध में भारत सरकार, वित्त मंत्रालय, व्यय विभाग (सार्वजनिक खरीद प्रभाग) के आदेश संख्या एफ संख्या 6/18/2019-पीपीडी दिनांक 23/07/2020 के अनुसार, भारत के साथ भूमि सीमा साझा करने वाले देश से बोलीदाता द्वारा पंजीकरण की आवश्यकता लागू होगी। बोलीदाता को इस संबंध में कंपनी के लेटर हेड पर 'अंडरटेकिंग' की स्कैन की हुई प्रति प्रस्तुत करनी होगी। (अनुलग्नक- जे, के, एल)।

Requirement of registration by the Bidder from a country sharing land border with India based on order No. F No. 6/18/2019-PPD dated 23/07/2020 of Government of India, Ministry of Finance, Department of Expenditure (Public procurement Division) with up to date amendments, regarding restriction under Rule 144(xi) of the General Financial Rules (GFR) 2017 shall be applicable. Bidder shall submit scanned copy of 'Undertaking' on Company's letter head in this regard. (Annexure- J, K, L).

* अंग्रेजी और हिंदी संस्करणों के बीच किसी भी प्रकार की विसंगति या असंगति होने की स्थिति में, अंग्रेजी संस्करण ही मान्य होगा।

* In the event of any discrepancy or inconsistency between the English and Hindi versions, the English version shall prevail.

Sd/-

सहायक महाप्रबंधक (इंजीनियरिंग - विद्युत) / बोली प्रबंधक
Asst. General Manager (Engg. - Elect.)/Bid Manager
भारतीय विमानपत्तन प्राधिकरण,
Airports Authority of India,
एलबीएसआई हवाई अड्डा, वाराणसी - 221006
LBSI Airport, Varanasi- 221006

FORM -A

DETAILS OF SIMILAR WORKS SUCCESSFULLY COMPLETED OR SUBSTANTIALLY COMPLETED DURING THE LAST SEVEN YEARS ENDING ON THE LAST DAY OF MONTH PREVIOUS TO THE ONE IN WHICH TENDER IS INVITED.

Sl. No.	Details of Work	W-1	W-2	W-3
i.	Name of work/project and Location			
ii.	Name and Address of client			
iii.	Awarded Cost of work (in Rs. Lakhs)			
iv.	Date of commencement as per contract			
v.	Stipulated date of completion			
vi.	Actual date of completion			
vii.	Completion Cost / Actual work done			
viii.	Nature of Work done			
ix.	Whether the work was done on back to back basis. Yes/No			
x.	Details of TDS Amount			

SIGNATURE (S) OF BIDDER (S)
(WITH STAMP)

Note: The contractor should give list of only eligible category works of requisite amount with supporting documents issued from client.

FORM - B

FINANCIAL INFORMATION

Name of the firm / contractor.....

1. Financial Analysis – Details to be furnished turnover on construction/Electrical works with profit / loss as per figure in balance sheet account for the last three years duly certified by the Chartered Accountant as submitted by the applicant to the Income - Tax Department.

Fig. in lakhs Rs.

S. No.	Particulars	Financial Year (Last three years)		
		FY 2022-23	FY 2023-24	FY 2024-25
1.	Turn-Over on Construction / Electrical Works			
2.	Profit / Loss after Taxes (standalone)			

2. Financial arrangement for carrying out the proposed work.

Unique Document Identification Number (UDIN).....

SIGNATURE OF CHARTERED
ACCOUNTANT WITH SEAL

SIGNATURE (S) OF BIDDER (S)

Note: The bidder should give information strictly in above format.

FORM -C

FORM FOR CERTIFICATE OF NET WORTH FROM CHARTERED ACCOUNTANT

This is to certify that as per the audited balance sheet and profit & loss account during the financial year, the Net Worth of M/s. (Name & Registered Address of individual / firm / company), as on(the date of certificate) is Rs. after considering all liabilities. It is further certified that Net Worth of the company has not eroded by more than 30% in the last three years ending on 31st March 2025 (the relevant year*).

Unique Document Identification Number (UDIN).....

Signature of Chartered Accountant

Name of Chartered Accountant

Membership of ICAI

Date and Seal

SIGNATURE (S) OF BIDDER (S)

*The relevant year shall be the financial year ending 31st March preceding the calendar year of bid submission or 31st March of the financial year preceding the previous financial year, if the balance sheet of the previous financial year has not been audited

FORM-D

FINANCIAL DATA

(WORK DONE DURING THE LAST FIVE FINANCIAL YEARS)

Name of the Bidder:

Sl No.	Description	Financial Data for Last 5 Audited Financial Years				
		FY 2020-21	FY 2021-22	FY 2022-23	FY 2023-24	FY 2024-25
1	Maximum value of electrical works executed (excluding GST) in any one year during the last 5 (five) years (updated at current price level by enhancing at a simple rate of interest @7% per annum), taking in to account completed as well as work in progress.					

Note:

a. All such documents reflect the financial data of the tenderer or member in case of JV and not that of sister or parent company.

b. The financial data in above prescribed format shall be certified by Chartered Accountant/ Company Auditor under his signature and stamp in original along with membership no.

Unique Document Identification Number(UDIN).....

Signature & name of Chartered Accountant with seal

SIGNATURE (S) OF BIDDER (S)

FORM-E

WORKS IN HAND

(On or after the Bid Submission Start Date i.e.)

Name of the Bidder:

Name and Brief contract (Clearly indicate the part of the work assigned to the bidder (s))	Name of client with telephone Number and fax number	Contract Value in Rupees (Give only the value of Work assigned to the bidder (s))	Value of balance work yet to be done in Rupee as on (submission end date)	Value of work to be done in 'T' i.e. 09 months (Completion Period of the Project) w.e.f. bid submission end date (m): From.....(m)..... To.....(m)+(T).....

Unique Document Identification Number (UDIN).....

Signature of Chartered Accountant with Seal

~~SIGNATURE (S) OF BIDDER (S)~~

FORM - F

TENDER ACCEPTANCE LETTER
(To be given on Contractor's Letter Head)

Date:

To
Asst. General Manager,
Electrical Engineering Wing,
Airports Authority of India,
LBSI Airport, Varanasi – 226001,

Sub: Acceptance of Terms & Conditions of Tender.

(Tender ID No.: 2026_AAI_283667_1)

Name of Work:- Development of Lal Bahadur Shastri International Airport, Varanasi; SH: SITC of Perimeter Lighting, WDI and Landing T.

Dear Sir,

1. I/We have downloaded / obtained the tender document(s) for the above mentioned 'Tender/Work' from CPP Portal web site(s) namely: <https://etenders.gov.in/eprocure/app> as per your advertisement, given in the above mentioned website(s).
2. I / We hereby certify that I / we have inspected the site and read the entire terms and conditions of the tender documents, corrigendum(s) and reply to query if any made available to me/ us which shall form part of the contract agreement and I / we shall abide hereby by the terms / conditions / clauses contained therein.
3. I/We hereby unconditionally accept the tender conditions of AAI's tender documents in its totality / entirety for the above mentioned work.
4. I/We declare that I/We have not paid and will not pay any bribe to any officer of AAI for awarding this contract or at any stage during its execution or at the time of payment of bills, and further if any officer of AAI asks for bribe/gratification, I will immediately report it to the Appropriate authority in AAI.
5. I/We hereby submitted that I / We paid / submitted the required Earnest Money as per NIT conditions.
6. I / We certify that all information/ documents furnished by our Firm is true & correct and in the event at any stage, the information/ documents is found to be incorrect/ untrue or found violated, then we shall be liable for debarment from tendering in AAI without giving any notice or reason therefore or summarily reject the bid or terminate the contract, without prejudice to any other rights or remedy including the forfeiture of the full said earnest money deposit absolutely.

Yours faithfully,

Place:

Date:

(Signature of the Bidder with Official Seal)

FORM - G

UNDERTAKING REGARDING BEBARMENT/BLACKLISTING/RESTRAINTMENT

Name of Work:- Development of Lal Bahadur Shastri International Airport, Varanasi; SH: SITC of Perimeter Lighting, WDI and Landing T.

(Tender ID No.: 2026_AAI_283667_1)

I/We (Name and post of authorized signatory), on behalf of (Name of firm), do here by solemnly affirm and declare as follows :

- (i) Our firm is not restrained / debarred / blacklisted by Airports Authority of India (AAI)/ Ministry of Civil Aviation (MoCA)/ Dept. of Expenditure (DoE), Ministry of Finance and the debarment/ blacklisting/restraintment is not in force as on last date of opening of tender (Envelope-I, normally called as technical bid).
- (ii) None of Proprietor / Partners / Board Members / Directors of M/s. (Name of firm) has remained Proprietor / Partners / Board Member / Director in any firm which stands debarred / blacklisted/restrained by AAI/ MoCA/ DoE and the debarment/ blacklisting/restraintment is not in force as on last date of opening of tender (Envelope-I, normally called as technical bid).
- (iii) Our firm understands that if our firm either debarred before the date of opening of tender (first bid, normally called as technical bid, in case of two packet/two stage bidding) or debarred before the date of contract by AAI/ MoCA/ DoE (Debarment applicable for all Ministries/ Departments), our bid is liable to be rejected at that stage.
- (iv) Our firm understands that at any stage, if above statements are found to be false, our firm shall be liable for debarment from bidding in AAI, apart from any other appropriate contractual legal action including debarment/ blacklisting/ restraintment, termination of the contract etc. as deemed fit.

[Signature and name of the
authorized signatory of the firm]

Date :

Place :

Note : Above undertaking is to be given on company's letter head.

FORM - H

Undertaking for Plant & Machinery
(To be given on Contractor's Letter Head)

Date:

To
Asst. General Manager,
Electrical Engineering Wing,
Airports Authority of India,
LBSI Airport, Varanasi – 226001,

**Name of Work:- Development of Lal Bahadur Shastri International Airport, Varanasi; SH: SITC
of Perimeter Lighting, WDI and Landing T.**

(Tender ID No.: 2026_AAI_283667_1)

Sir (s),

I/We(name of Company / Firm) do hereby undertake that –

I/We will deploy sufficient plant and machinery as per requirement of work in consultation with Engineer-in-Charge (EIC) to achieve the milestones / targets and overall completion of work within the time period.

Place :

Date :

Signature and Name
with Company's Stamp.

FORM - J

UNDERTAKING FOR DECLARATION BY BIDDER REGARDING REQUIREMENT OF LOCAL CONTENTS

(Scanned copy to be submitted by Bidder in Cover-I on letter head of the Company/Firm)

Name of Work: - Development of Lal Bahadur Shastri International Airport, Varanasi; SH: SITC of Perimeter Lighting, WDI and Landing T.

(Tender ID No.: 2026_AAI_283667_1)

I, the undersigned, _____ (full names), do hereby declare, in my capacity as _____ of M/s (Name of company/Firm) that:

1) I am competent to swear this undertaking on behalf of _____ (Name of company/Firm) .

2) I have read the Order(s) **“Public Procurement Policy (Preference to Make In India), order 2017- revision dated 16.09.2020”** notified by Government of India, Ministry of Commerce and Industry, Department of Promotion of Industrial & Internal Trade (Public Procurement Section) vide letter No. P- 45021/2/2017-PP (BE-II) dated 16th Sep 2020 or as amended up to date.

3) My **“local contents”** for this tender is _____ (specify the percentage of local contents) as per details attached under ‘FORM L’ and we meet the mandatory minimum Local Content requirement i.e. _____ (Specify the percentage of local contents) for 'Class-I local supplier' / 'Class-II local supplier' (strikeout, whichever is not applicable) as per Government of India, “Public Procurement Policy (Preference to Make In India), order 2017” amended up to date to participate in AAI tender ID No. _____ .

4) The details of location(s) at which the local value addition is made are as per ‘FORM L’

5) I / we are not debarred/blacklisted by any procuring entity for violation of this order and the debarment is not in force as on last date of submission of bid.

Signature and name of the authorized signatory of the firm
with Rubber Stamp

Date:

Place:

FORM - K

DETAILS OF LOCAL CONTENTS

(Scanned copy to be submitted by Bidder in Cover I on letter head of the Company/Firm)

Name of Work: Development of Lal Bahadur Shastri International Airport, Varanasi; SH: SITC of Perimeter Lighting, WDI and Landing T.

(Tender ID No.: 2026-AAI-283667-1)

I/we hereby certify that supply items designed and supplied by us will have the local content as below:-

S. No.	BOQ Item No. (only supply items)	% of Local Content	Details of location(s) at which local value addition is made	Remarks
1				
2				
3				
4				
Total % of Local Contents				

NOTE:-

1. Local Content shall be claimed on the supply part only and shall not be claimed on the services such as Transportation, Insurance, Installation, Commissioning, Training, Operation & AMC/CMC/AICMC etc.
2. Local Content shall be calculated as per Govt. of India guidelines.
3. Item wise Local Contents declared under 'FORM K' may vary at the time of actual supply of material. However, the total percentage of local contents shall meet the minimum local content requirement for "Class I Local Supplier"/ "Class II Local Supplier" (as applicable) in accordance with the "Public Procurement Policy (Preference to Make In India), order 2017 revision dated 16.09.2020".

Signature and name of the authorized signatory of the firm
with Rubber Stamp

Date:

Place:

FORM – L

Performa for declaration by Bidder for compliance of order on Restriction under Rule 144(xi) of the General Financial Rules (GFRs)-2017

(Scanned copy to be submitted by Bidder in Cover-I on letter head of Company/Firm)

Name of Work: - Development of Lal Bahadur Shastri International Airport, Varanasi; SH: SITC of Perimeter Lighting, WDI and Landing T.

(Tender ID No.: 2026_AAI_283667_1)

I, the undersigned, _____ (full names), do hereby declare, in my capacity as _____ of M/s _____ (Name of company/Firm) that:

- 1) I am competent to swear this undertaking on behalf of M/s _____ (Name of company/Firm).
- 2) I have read the Order(s) on the subject of Restrictions under Rule 144 (xi) of the General Financial Rules (GFRs), 2017 regarding restrictions on procurement from a bidder of a country which shares a land border with India and comply to all the provisions of the Order(s).
- 3) I certify that M/s _____ (Name of company/Firm) _____) **is not from such a country / is from such a country, has been registered with the Competent Authority** (strike out whichever is not applicable). I hereby certify that this BIDDER fulfills all requirements in this regard and is eligible to be considered [Where applicable, evidence of valid registration with the Competent Authority is attached].
- 4) I understand that the submission of incorrect data and / or if certificate/ declaration given by M/s _____ (Name of company/Firm) _____ is found to be false, this would be a ground for immediate termination and further legal action in accordance with law as per Clause 12 of the Public Procurement Order on Restrictions under Rule 144 (xi) of the General Financial Rules (GFRs), 2017.

Signature and name of the authorized signatory of the firm
With Rubber Stamp

Date:

Place:

FORM - M

GST UNDERTAKING
(To be submitted in ENVELOPE-I)

Name of Work: - Development of Lal Bahadur Shastri International Airport, Varanasi; SH: SITC of Perimeter Lighting, WDI and Landing T.

(Tender ID No.: 2026_AAI_283667_1)

We hereby declare that we are registered under GST and comply with all provisions of GST Act.

Our GST details are furnished as below:

1	GST Registration No. (Enclose copy of GST Regn.)	:	
2	PAN	:	
3	Legal Name	:	
4	Trade Name	:	

Further, I/We hereby unconditionally accept the following conditions in its entirety for the above work.

1. We are registered under GST and compliance of GST provisions.
2. We undertake that all input credits shall be passed on to AAI.
3. In case of non-compliance of GST provisions and blockage of any input credit, we shall be responsible to indemnify AAI.

Signature with name and Company Seal.

FORM-N

E-Payment Format

(TO BE SUBMITTED IN “ENVELOPE- I”)

- | | | |
|-----|---|---|
| 1. | Beneficiary Name | : |
| 2. | Beneficiary address | : |
| 3. | PAN No | : |
| 4. | Bank A/C No | : |
| 5. | City of Bank | : |
| 6. | Name of Bank | : |
| 7. | Branch | : |
| 8. | Address of Bank | : |
| 9. | Account Type
(Saving/ Current/ Over Draft) | : |
| 10. | RTGS IFSC Code
(Real Time Gross Settlement) | : |
| 11. | NEFT IFSC Code
(Nation Electronic Fund Transfer) | : |

Date:

Authorized Signatory

Name of the Agency

Seal

FORM-O

~~(TO BE SUBMITTED IN COMPANY LETTER HEAD ALONG WITH ENVELOPE D)~~

UNDERTAKING

I/We, () hereby declare that the information as stated above and the supporting documents submitted/uploaded are true and correct to the best of my/our knowledge and belief. I/We further undertake that in case any information/document is found fake/incorrect/forged at any stage, I/We may be debarred from AAI for taking participation in all future AAI works and my/our EMD may be forfeited and any other suitable action as deemed fit by AAI can be taken against me/us.

Place: _____ **Signature:**

Date: _____ **Authorized Signatory of the bidder**

_____ **Signature of Director / Proprietor of the company/firm**

ANNEXURE- PQ**PQ Performa to be filled and submitted by the bidder along with tender application in Envelope - I**

Name of Work: - Development of Lal Bahadur Shastri International Airport, Varanasi; SH: SITC of Perimeter Lighting, WDI and Landing T.

(Tender ID No.: 2026_AAI_283667_1)

Ref. No.	Qualifying Criteria	Particulars	Enclosure Check Lists
(A)	(B)	(C)	(D)
(It is mandatory to fill up or type the Column C & D in details by the firm / contractor)			
1.	Name:		
	Registered office Address:		
	Contact Details: (Phone No.)		
	(email ID)		
	Contact Person:		
Envelope-I (Tender processing fee, EMD, Technical bid and Pre-qualification):- (It is mandatory to fill up or type the following Columns in details by the firm / contractor)			
2.	Scanned copy of payment receipt [in PDF Format] of Tender Processing fee paid through on Line.	Transaction slip uploaded:	Transaction slip uploaded: YES/NO
3.	Scanned copy of payment receipt [in PDF Format] of EMD paid through on Line.	Transaction slip uploaded:	Copy Enclosed: YES/NO
4.	Scanned Copy of Permanent Account Number (PAN) and GST Registration Number.		Copy Enclosed: YES/NO
5.	Signed & Scanned copy of 'Form-A - Details of similar works completed' as per format given in tender document.		Copy Enclosed: YES/NO
6.	Signed & Scanned copy of Form- B - Financial Information as per format given in tender document as Annexure - B.		Copy Enclosed: YES/NO
7.	Sign & Scanned copy of Form -C – Net Worth certificate, having a minimum net worth of Rs. 72.92 Laacs issued by certified Chartered Accountant as per format given in tender document.		Copy Enclosed: YES/NO

8.	Copy of EPF & ESI Registration Certificate		Copy Enclosed: YES/NO
Ref. No.	Qualifying Criteria	Particulars	Enclosure Check Lists
(A)	(B)	(C)	(D)
9.	Scanned copy of 'Work in Hand' as per format given in tender document as Form-E.		Copy Enclosed: YES/NO
10.	Copy of Affidavit of Minimum wages		Copy Enclosed: YES/NO
11.	Duly signed Tender Acceptance Letter (as per the PERFORMA given in Tender Document, as Form-F).	Scanned copy of Undertaking (as per the PERFORMA given in Tender Document, as FORM - F).	Copy Enclosed: YES/NO
12.	Scanned copy of 'Undertaking' regarding Blacklisting / Debarment on Company's Letter Head. (as per the Format given in Tender Document as Form-G).		Copy Enclosed: YES/NO
13.	Scanned copy of 'Undertaking' for Plant & Machinery' as per format given in tender document as Form-H .		Copy Enclosed: YES/NO
14.	Scanned copy of Authorization Letter/ Power of Attorney along with copy of Certificate of Incorporation of the Company under Companies Act showing CIN/LLPIN/Name of Directors of the company & Copy of Board Resolution regarding Authority to assign Power of Attorney for Companies other than propriety firm. OR Proprietary firm shall submit scanned copy of Authorization Letter/ Power of Attorney only if the tender is processed by a person other than proprietor.		Copy Enclosed: YES/NO
15.	Scanned copy of (PERFORMA FORM – J, K, L) Undertaking To Be Submitted By Agencies under public procurement policy for Make In India order 2017 (on company's letter head)		Copy Enclosed: YES/NO
16.	GST Undertaking (Form – M)		Copy Enclosed: YES/NO
17.	Scanned copy of E-Payment Details		Copy Enclosed:

	(Form-N)		YES/NO
--	----------	--	--------

Ref. No.	Qualifying Criteria	Particulars	Enclosure Check Lists
(A)	(B)	(C)	(D)
18.	Scanned copy of undertaking (Form-Θ)		Copy Enclosed: YES/NO
19.	Copy of Valid Electrical License		Copy Enclosed: YES/NO
20.	Scanned copy of Annexure PQ		Copy Enclosed: YES/NO
21	Scanned copy of Annexure T	Duly filled and signed on companys letter head	Copy Enclosed: YES/NO
	Qualifying requirements of contractors / tenderers containing the following: - (It is mandatory to fill up or type the following Columns in details by the firm / contractor)		
22.	Certificate from clients having satisfactorily completed three works, each of Rs. 194.46 Lacs (Excluding GST) or two works, each of Rs. 243.08 Lacs (Excluding GST) or one work of Rs. 388.92 Lacs (Excluding GST) in single contract of similar nature of work (mentioned in NIT) during last seven years.	Details of the Three/Two/One work(s) as applicable:	Copy of certificates enclosed:

WORK NO. 1

a)	Name of Work and Location		Copy of Completion certificate enclosed: YES/NO
b)	Name and Address of Client		
c)	Awarded Cost of work (in Rs. Lakhs)		
d)	Nature of work done		
e)	Date of commencement as per contract		Copy of award letter and schedule of Quantity, TDS enclosed: - YES/NO
f)	Stipulated Date of Completion		
g)	Actual Date of Completion		
h)	Actual Completion Cost		
i)	Whether the work was done on back to back basis, Yes/No.		
j)	Details of TDS Amount, if applicable		

WORK NO. 2

a)	Name of Work and Location		Copy of Completion certificate enclosed: YES/NO
b)	Name and Address of Client		
c)	Awarded Cost of work (in Rs. Lakhs)		
d)	Nature of work done		
e)	Date of commencement as per contract		Copy of award letter and schedule of Quantity, TDS enclosed: - YES/NO
f)	Stipulated Date of Completion		
g)	Actual Date of Completion		
h)	Actual Completion Cost		
i)	Whether the work was done on back to back basis, Yes/No.		
j)	Details of TDS Amount, if applicable		
WORK NO. 3			
a)	Name of Work and Location		Copy of Completion certificate enclosed: YES/NO
b)	Name and Address of Client		
c)	Awarded Cost of work (in Rs. Lakhs)		
d)	Nature of work done		
e)	Date of commencement as per contract		Copy of award letter and schedule of Quantity, TDS enclosed: - YES/NO
f)	Stipulated Date of Completion		
g)	Actual Date of Completion		
h)	Actual Completion Cost		
i)	Whether the work was done on back to back basis, Yes/No.		
j)	Details of TDS Amount, if applicable		
22.	Whether experience from Govt. organizations or private clients?	In case experience of non-govt./non-PSU client, TDS certificate from clients to be enclosed)	TDS certificate enclosed: YES/NO
23.	Annual Financial Turnover		
	Turn Over: Annualized average Financial Turnover equivalent to Indian Rupees Rs. 172.10 Lacs during last three financial years ending on 31.03.2025. The Certificate should be submitted in the given format- Form-B .		Proof of turnover Enclosed (Abridged balance sheet & Profit & Loss A/c) YES/NO
	(a) Year 2022-23		
	(b) Year 2023-24		
	(c) Year 2024-25		
	Average		
24.	Whether certifications, GST and Tax Audit Reports and Other Audit,	UDIN No:	Submitted: YES/NO

	Assurance and Attestation etc. (as applicable in the tender) issued by Chartered Accountant bear Unique Document Identification Number (UDIN) as introduced by the Institute of Chartered Accountants of India?		
25.	Cover –II shall contain		
i.	Financial bid through CPP portal		YES / NO
26.	Any other related information		

Signature with seal
(Authorized signatory of the firm)

DECLARATION

I, () hereby declare that the documents submitted/enclosed are true and correct. In case any document at any stage found fake/incorrect, my EMD may be forfeited & action as deemed fit by AAI can be taken against me.

Place:

Date:

Signature with seal
(Authorized signatory of the firm)

Note: 1. Tenderer are requested to fill the check list properly, writing of attached / enclosed etc. are not acceptable.
2. If any of the supporting documents is submitted in any language other than English or Hindi, a self-attested English Version shall be submitted with the respective document.

ANNEXURE- R

Account information for Bank Guarantee

- (i) The following bank details is incorporated in the tender document so that the prospective successful bidder may submit BG (PBG/BG-SD/FBG) in accordance with the bank details.

CORPORATE NAME : AIRPORTS AUTHORITY OF INDIA

BANK NAME : ICICI BANK

IFSC CODE : ICIC0000007

BG ADVISING MESSAGE : IFN 760COV (BG ISSUE)
IFN 767COV (BG AMENDMENT)

*UNIQUE IDENTIFIER CODE : AAIVARANASI

*Please note that only unique identifier code will change depending on the AAI unit calling the tender.

- (ii) While submitting the documents to BG issuing bank, the vendor/customer/ concessionaire will also submit letter to the issuing bank as per the format mentioned in the Annexure-N.
- (iii) Based on the above inputs from the vendor/customer/concessionaire, the BG Confirmation message through SFMS will be triggered to the beneficiary bank i.e. ICICI bank and on the basis of unique identifier code, the BG confirmation mail will be received in the designated email ids issued to the respective units.
- (iv) While accepting the Original BG document from the vendor/customer/concessionaire, the respective department of AAI should ensure that the vendor attaches copy of the SFMS BG confirmation message sent by the BG issuing bank to ICICI bank.

Advisory: For Applicant and its BG Issuing Bank Branch.

It is to be noted that along with physical BG; an online facility to view the issued BG cover message transmitted to ICICI Bank through SFMS platform also activated.

- For availability of BG in this platform, it is necessary that BG issuing/amending bank send the BG advice in the form of message format **IFN 760COV (BG issuance) / IFN 767COV (BG Amendment)** via SFMS (Structured Financial Messaging System) as provided by RBI.
- In the event of BG issuing/amending bank not sending the message IFN 760COV/ IFN 767COV or **committing any error while capturing the details** at least in the below field, **BG confirmation through online portal would not be updated.**

BG advising message - IFN 760COV/ IFN 767COV via SFMS
IFSC CODE: ICIC0000007
Corporate Name- Airport Authority of India.

Field Number
7037

(Particulars (to be mentioned in Row-1)
< Unique identifier>

Please note that the issuing bank while issuing/amending the BG, should ensure that the above information is correctly captured in the message i.e. IFN 760COV/ IFN 767COV.

Sl. No.	Name of the AAI Unit	Email ID	UNIQUE IDENTIFIER CODE (7037)
1.	VARANASI AIRPORT	bgv.varanasi@aai.aero	AAIVARANASI

Please find below indicative request letter format to be sent to issuing bank for ensuring transmission of BGs through SFMS.

Request Letter: Transmission of Bank Guarantee Cover Message
< to be submitted by applicant to BG issuing bank >

Date:- _____

The Manager,
(Bank),
(Branch)

Sub: Inclusion of unique identifier code of AAI while transmitting BG cover messages where beneficiary bank is ICICI Bank (IFSC-ICIC0000007).

Dear Sir/Ma'am,

I/We, _____, request you to include unique identifier _____ in field 7037 of the SFMS cover messages IFN COV 760 (for BG issuance) and IFN COV 767 (for BG amendment) while transmitting the same to the beneficiary bank (ICICI Bank - IFSCICIC0000007).

Thanking You,

(Vendor/Customer/Concessionaire)

AFFIDAVIT
(of Minimum Wages)

(To be executed in Rs. 100/- Non-Judicial Stamp Paper Duly Notarized)

I, (.....), age years S/o of
..... Proprietor/ Managing Partner/ Managing Director M/s
..... having address
..... do hereby solemnly affirm and state as
follows:

I am competent to swear this affidavit on behalf of (Name of the agency) and hereby confirm that our firm is & will be fully complying to all the provisions of the Contract Labour (Regulation & Abolition) Act-1970, fully complying to the legal obligations with regards to payment of minimum wages as per Minimum Wages Act-1948 and fully complying to all the provisions of EPF & MP Act –1952 for deduction & deposit of provident fund to Statutory Authorities as applicable, as per the prevailing Govt. Statutory Laws, Rules & Regulations etc.

Any lapses/defaults found on the part of our firm in this regard shall be our sole responsibility, and any suitable action may be taken against our company/firm as deemed fit, by Airports Authority of India.

Date:

(Signature of the Contractor)
With rubber stamp

(Notary)

Form of Insurance Surety Bond towards EMD
(To be stamped in accordance with Stamp Act of India)

Insurance Surety Bond No.:

Date:

Name of Work:

To,

{AIRPORTS AUTHORITY OF INDIA _____
AIRPORT}

WHEREAS THIS SURETY BOND AGREEMENT is executed atthisday of
.....20....

BETWEEN

- a. M/s. (Name of the Bidder) having its Registered/Head Office at
..... (Hereinafter called "the Bidder" which expression shall include its successors,
administrators, executors and assigns) ;

AND

- b.(Name and Address of Insurer) having its registered office at
.....(hereinafter called "the Insurer" which expression shall include its successors,
administrators, executors and assigns)

AND

- c. Airports Authority of India, a Statutory Body constituted under the Airports Authority of India Act, 1994 State Bank of India Act, 1955 having its Central Headquarters at Rajiv Gandhi Bhavan, Safdarjung Airport, New Delhi, 110003 (hereinafter called the "AAI");

Dear Sirs,

In accordance with Invitation for Bids under your Bid Document No. **{Tender Reference No.}**, dated
M/s **{Agency's Name}** having its Registered/Head Office at **{address}** (hereinafter called the 'Agency') wish to participate in the said bid for **{Tender Title}**.

As an irrevocable Insurance Surety Bond against Bid Security for an amount of(*)..... valid for days from(**) required to be submitted by the Supplier as a condition precedent for participation in the said bid which amount is liable to be forfeited on the happening of any contingencies as mentioned under the Bidding Documents/NIT No.

We, the {Name of the Insurer} having our Head Office at {address of the Insurer} guarantee and undertake to pay truly AND immediately on demand by **Airports Authority of India** (hereinafter called the 'Owner') and its successors and assigns by these presents the amount of.....(*) on first written demand, without any DEMUR, reservation, protest, demand and recourse, the insurer binds itself, its successors and assigns by these presents. Any such demand made by the 'Owner' shall be conclusive and binding on us irrespective of any dispute or difference raised by the Agency and/or any right/remedy available to the Agency in terms thereof.

THE CONDITIONS of this obligation are:

- (1) If the Bidder withdraws its bid during the period of bid validity specified by the Bidder in the Bid Form; or
- (2) In case the Bidder does not withdraw the deviations proposed by him, if any, at the cost of withdrawal stated by him in the bid and/or accept the withdrawals/rectifications pursuant to the declaration/confirmation made by him; or
- (3) In the case of a successful Bidder, if the Bidder fails or refuses within the specified time limit

1. To execute the Contract Agreement, or
2. To furnish the required performance security/guarantee within the prescribed time.
3. The proceeds of Surety Bond (EMD) shall be payable to Owner in case of breach of any of the terms and conditions of the tender by the bidder.

WE undertake to pay to the Owner up to the above amount upon receipt of its first written demand, without the Owner having to substantiate its demand, and that in its demand the Owner/may note that the amount claimed by it is due to it, owing to the occurrence of any of the above-named CONDITIONS or their combination, and specifying the occurred condition or conditions.

The Surety Bond shall not be affected by any change in the constitution or winding up, any absorption, merger

or amalgamation of any of the parties to this surety bond, with any other person.

In the event that the obligations of Owner of this Surety Bond are assigned or novated to a third party, the Surety agrees that this Bond shall remain in full force and effect and shall be deemed to apply to the new principal as if originally named herein, provided that the Surety's liability shall not be increased or extended beyond the original terms of this Bond.

This Surety Bond shall be governed by Indian Law and is to be construed in accordance with Indian Law in all its respects. Each hereby agrees to submit to the jurisdiction of the Courts at (#), and to comply with all the requirements necessary to give such Court the jurisdiction. All matters arising hereunder shall be determined in accordance with the law and practice of the Courts at (#)

This Insurance Surety Bond shall be unconditional as well as irrevocable and shall remain valid up to.....(@) If any further extension of this Insurance

Surety Bond is required, the same shall be extended to such required period (not exceeding one year) on receiving instructions from M/s **{Agency's Name}** on whose behalf this Insurance Surety Bond is issued.

In witness where of the Insurer, through its authorized officer, has set its hand and stamp on this day of 20..... at

.....
(Signature)

.....
(Name)

.....
(Designation with Insurer Stamp and Complete Address,
Telephone and Email of the Authorized Signatory)

Authorized Vide Power of Attorney PoA No.....

WITNESSES:

(i) Name & Signature

(ii) Name & Signature

Date.....

NOTE:

1. (*) The amount shall be equivalent to EMD amount specified in the tender.
(**) This shall be the last date of bid submission deadline.
(@) This date shall be thirty (30) days after the last date for which the bid is valid.
(#) This shall be the place where the tender is floated by AAI.
2. The Insurance Surety Bond shall be from an Insurer, registered under the Insurance Act, 1938 as per guidelines issued by Insurance Regulatory and Development Authority of India (IRDAI) as amended from time to time.
3. The Owner shall be the Creditor, the Supplier shall be the Principal debtor and the Insurance company/Insurer shall be the Surety in respect of the Insurance Surety Bond to be issued by the Insurer.
4. The Insurance Surety Bond shall be executed on Non-Judicial stamp paper/e-stamp paper of appropriate value as per Stamp Act prevailing in the state(s) where the Insurance Surety Bond is submitted or is to be acted upon or the rate prevailing in State where the Insurance Surety Bond is executed, whichever is higher. The Stamp Paper/e- stamp paper shall be purchased in the name of Supplier/Insurer issuing the Insurance Surety Bond.
5. While getting the Insurance Surety Bond issued, Suppliers are required to ensure compliance to the points mentioned in Form of Bank Guarantee/Insurance Surety Bond Verification Check List enclosed in this Section of Bidding Documents. Further, Suppliers are required to fill up this Form and enclose the same with the Insurance Surety Bond.
6. Each page of Insurance Surety Bond for EMD shall be duly signed / initialed by the executing officers and the last page shall be signed in full by the duly authorized signatory of Insurance Company alongwith two witnesses.

AIRPORTS AUTHORITY OF INDIA

GUIDANCE TO BIDDERS

1. Digitally signed and sealed (Encrypted) item rate online e-tenders are invited by AAI through the CPP e-tender portal on behalf of Chairman, Airports Authority of India (AAI) for the work of **“Development of Lal Bahadur Shastri International Airport, Varanasi; SH: SITC of Perimeter Lighting, WDI and Landing T.”**.
2. The work has to be executed as per the Schedule of Quantity in conjunction with specifications, terms & conditions and schedule of work execution, drawings given in this tender document. The estimated cost of work is mentioned at **Para No.1 of NIT**, this estimate value given is merely a rough guide.
3. **PERIOD OF WORK**
The works are required to be completed within the period as mentioned at **Para No.1 of NIT**. This period shall be reckoned as per Work Order issued by AAI.
AAI reserves the right to place order as a whole or in parts, depending upon site requirements and as per latest guidelines of GoI.
4. The Tenders shall be invited in two Cover system on CPP Portal-Cover I & II.
5. Not more than one Tender shall be submitted by an Agency. No two or more concerns in which an individual is interested as Proprietor and / or partner shall Tender for the execution of the same works. If, they do so, all such Tenders shall be liable to be rejected.
6. Tender documents consisting of plans, specifications, Schedule(s) of quantities of the various classes of work to be done, the conditions of contract and other necessary documents will be open for inspection in the CPP e-tender portal. Tender document can be downloaded from the CPP e-tendering portal without paying any tender fees. However, to participate in the tender / to submit the tender document, the tenderer must pay tender fee of **INR 1,180/- (i/c GST) Non-refundable through online mode.**
- ~~7. Copies of other drawings and documents pertaining to the works signed for the purpose of identification by the Accepting Officer or his accredited representative will be open for inspection by Tenderers at the office as mentioned at “Office Inviting Tender “of Schedule F during working hours.~~
8. Tenderers are advised to inspect and examine the site and its surroundings and satisfy themselves before submitting their Tenders as to the nature of the ground, environment and sub soil (as far as is practicable), the form and nature of the site, the means of access to the site, the accommodation they may require, working conditions including space for stacking of materials, installation of T & P conditions affecting accommodation and movement of labours etc. and in general shall themselves obtain all necessary information as to risks, contingencies and other circumstances which may influence or effect their Tender. A Tenderer shall be deemed to have full knowledge of the site whether he inspects it or not and no extra charges consequent on any misunderstanding or otherwise shall be allowed.
9. Submission of a Tender by a Tenderer implies that he has read this notice and all other contract documents and has made himself aware of the eligibility criteria, scope and specifications of the works to be done, local conditions, local material rates and other factors bearing on the execution of the works.

10. E-Tenders shall be submitted in the CPP e-tender portal only upto the date and time as mentioned in critical data sheet of NIT at S. No. 1 of NIT.
11. Notification of Award of contract will be made in writing to the successful Tenderer by the Tender Accepting Authority or his representative. The contract will normally be awarded to the qualified and responsive Tenderer offering lowest evaluated bid in conformity with the requirements of the specifications and contract documents and the Tender Accepting Authority shall be the sole judge in this regard. The Tender Accepting Authority does not bind himself to accept the lowest or, any tender or to give any reason for the decision.
12. A responsive tenderer is one who submits priced e-tender and accepts all terms and conditions of the specifications and contract documents.
13. A major modification is one which affects in any way the quality, quantity and period of completion of the work or which limits in any way the responsibilities or liabilities of the Tenderer or any right of AAI as required in the specifications and contract documents. Any modification in the terms and conditions of the Tender which are not acceptable to AAI shall also be treated as a major modification.
14. The Accepting Authority reserves to himself the right of accepting the whole or any part of the Tender and Tenderer shall be bound to perform the same at his quoted rates.
15. The Tenderer shall not be permitted to Tender for works in Airports Authority of India Engineering Department responsible for award and execution of contracts, in which his near relative is posted as Manager Finance & Accounts or Sr. Officer or as an Engineer in any capacity. He shall also intimate the names of persons who are working with him in any capacity or are subsequently employed by him and who are near relatives to any officer in Airports Authority of India. Any breach of this condition by the contractor would render him liable to be debarred from Tendering for next 2 years.
16. The tenderers shall give a list of AAI employees related to him if any.
17. No Engineer equivalent to Gazetted rank or other Gazetted Officer of equivalent rank in Central Government Department employed in Engineering or Administration duties in an Engineering Department of Airports Authority of India / Govt. of India is allowed to work as a contractor for a period of two years of his retirement from Airports Authority of India / Government service, without the previous permission of Airports Authority of India /Govt. of India. This contract is liable to be cancelled if either the contractor or any of his employees is found at any time to be such a person who had not obtained the permission of Airports Authority of India /Govt. of India as aforesaid before submission of the Tender or engagement in the contractor's service.
18. The tenderer should study the complete tender document. In order to facilitate AAI to prepare responses, the interested tenderers are requested to submit their queries, in CPP e-tender portal only. The tenderers queries will be replied through CPP e-portal only.
No other mode / means of correspondence pertaining to this tender, except as mentioned above, and shall be entertained.
19. The performance guarantee and security deposit shall be as per **GCC & SCC**.
20. **PROCEDURE FOR QUOTE OF TENDER (COVER-II i.e. FINANCIAL BID)**

- 20.1 The rates quoted shall be **firm and fixed and subject to no escalation** whatsoever till the successful completion of the work.

The contractor shall comply with all applicable provision of Goods and Service Tax (GST) levied by union Government and state Government (CGST, UTGST, SGST and GST). The contractor shall get himself registered and discharge his obligations for payment of taxes, filing of returns etc. under the appropriate provisions of law in respect of all the tax, duties, levies, cess, etc.

All tendered rates should be inclusive of all Taxes, but excluding GST. The GST shall be reimbursed to the successful bidder for all taxable supply / services against a valid tax invoice.

- 20.2 All rates shall be quoted in BOQ format provided in tender document in CPP e-tender portal only.
- 20.3 Since this will be an indivisible work contract, which includes supply of items as per the bill of quantities and their design, installation, testing and commissioning, the contractor is responsible for ensuring the items reach the site in good condition.
- 20.4 This is item rate tender, only rates quoted against each items shall be considered. Any tender which offers percentage (%) below / above the estimated cost is liable to be rejected.

21. POWER OF ATTORNEY / AUTHORIZATION FOR SIGNING TENDER

- 21.1 Only the Power of Attorney / Authorization holder of the tenderer on whose name the tender has been issued shall sign the Tender documents. The original document, if applicable, shall be submitted to AAI on or by as per critical date sheet.
- 21.2 The name and designation of the person or persons of the company who is authorized to sign shall be clearly indicated in the authority letter.

22. ~~INTEGRITY PACT AND INDEPENDENT EXTERNAL MONITOR~~

- ~~22.1 Signing of Integrity Pact (as per Appendix XVI) is mandatory for every bidder participating in this tender and the contractor, who is awarded the work. The Pact signed on each page by the person authorized by bidder / sub-contractor / associate to sign the bid for submission or the person authorized to sign the contract on behalf of successful bidder. The scanned copy of signed Integrity Pact has to be submitted in the CPP e-tender portal.~~
- ~~22.2 The Bidder/contractor shall commit itself to ensure taking all measures necessary to prevent corrupt practices, unfair means and illegal activities during any stage of its bid or during any pre-contract or post-contract stage as specified in section 2 of the integrity pact.~~
- ~~22.3 Any breach of the aforesaid provisions by the Bidder or any one employed by it or acting on its behalf (whether with or without the knowledge of the Bidder) shall entitle the authority to take all or any one of the actions as specified in section 5 of the integrity pact.~~
- ~~22.4 Integrity Pact shall be signed on plane papers, which is pre-signed by tender issuing authority / contract signing authority.~~
- ~~22.5 Updates with regard to Integrity Pact may please see on AAI website by following the access path www.aai.aero > Vigilance > Vigilance Events > Integrity Pact.~~
- ~~22.6 The Independent External Monitor (IEM) for this work will be:~~
- ~~22.7 The duties, responsibilities and powers of IEM are detailed in section 8 of the IPS Act.~~
- ~~22.8 In case any violation of above conduct is established, AAI reserves right to take following actions:~~
- ~~22.9 If contractor commits a violation of its commitments and obligations under the Integrity Pact Program during bidding process, he shall be liable for disqualification from tender process.~~
- ~~22.10 In case of violation of the Integrity Pact after award of the contract, Authority is entitled to terminate the contract and shall be entitled to demand and recover from the contractor damages~~

~~equivalent to 5% of the contract value or the amount equivalent to Security Deposit or Performance Bank Guarantee, whichever is higher.~~

~~22.11 Authority may initiate appropriate proceedings against the contractor.~~

~~22.12 Contractor will be liable to pay damages as determined by the Authority.~~

~~22.13 Contractor against whom an action for violation of its commitments and obligations has been taken earlier again commits a violation, the Authority is entitled to debar such contractor for future tender/ contract processes for a period as deemed fit.~~

~~22.14 A violation is considered to have occurred if the Authority is fully satisfied with the available documents and evidence submitted along with Independent External Monitor's recommendations / suggestions that no reasonable doubt exist in the matter.~~

23. **GUIDANCE FOR SUBMISSION OF TENDER**

23.1 The tenderer should download the tender document or any other file from the "Tender Document" or "Amendments / Corrigendum" uploaded in the CPP e- tender portal and uploads the digitally signed file of the same in the **Envelope-I**

AAI will not be responsible for not getting internet connection / power supply while downloading the Electronic bid sheets / documents or while uploading their bids.

23.2 Tender for the present work shall be submitted online through CPP e-tender portal. The required documents as per NIT are to be uploaded in respective Envelope-I as listed in NIT para-2.

23.3 For price bid, tenderer shall use Envelope-II (Finance). All rates shall be quoted in the format provided and no other format is acceptable. If the price bid has been given as a standard BOQ format with the tender document, then the same is to be downloaded and to be filled by all the bidders. Bidders are required to download the BOQ file, open it and complete the white colored (unprotected) cells with their respective financial quotes and other details (such as name of the bidder). No other cells should be changed. Once the details have been completed, the bidder should save it and submit it online, without changing the filename, tampering/modification in BOQ file.

~~23.4 Once the contractor has uploaded the digitally signed file of tender documents along with unconditional acceptance Letter as an attachment, he is not permitted to upload any additional files / or put any remark(s) / condition(s) along with the tender documents~~

23.5 In case the condition 23.3 & 23.4 above is found violated, the tender shall be rejected.

24. **PROCEDURE FOR OPENING OF TENDER**

Following steps shall be followed for opening of tender documents.

24.1 The **Envelope-I** containing documents for pre-qualification bid shall be opened as prescribed in the bid invitation information in the CPP e-tendering on scheduled date. Revised date, if any, shall be intimated through CPP e-tender portal.

24.2 The **Envelope-II** shall be opened only of those tenderers who are found eligible as per eligibility criteria spelt out in **para 02 of NIT**.

25. **COMPARISON AND EVALUATION OF TENDER**

25.1 Prior to detailed evaluation, the Purchaser will determine the substantial responsiveness of each Tender document. A substantial responsive Tender is one, which confirms to all the terms and conditions of the Tender.

25.2 A tender is determined as not responsive, if tender is submitted incomplete, annexures are not filled up, unconditional acceptance letter, power of attorney, and ~~integrity pact~~ not found in proper form, such tenders are liable to be rejected by AAI.

- 25.3 **Envelope-II** (Financial) of only those tenderers whose documents submitted in **Envelope-I** is acceptable to AAI will be evaluated as under:
- ~~25.3.1 The cost of all inclusive comprehensive maintenance cost shall also be taken into consideration for evaluation.~~
- ~~25.3.2 The cost which is to be reimbursed by AAI on production of documentary proof shall not be taken into consideration for evaluation of Bids.~~
26. **The Public Procurement Policy (Preference to Make in India), order 2017** issued vide order No. P-45021/2/2017-PP (BE-II)-Part(4)Vol.II dt. 19.07.2024 with up-to-date amendment, shall be applicable for this work ~~(applied on SITC portion only).~~
Bidders are advised to go through the "Make in India policy" of Government of India for detailed Under standing
27. **Restrictions under Rule 144(xi) of the General Financial Rules (GFRs) 2017** issued vide order no F.No. 6/18/2019-PPD dt 23.07.2020 with up-to-date amendments shall be applicable for this work.
Bidders are advised to go through the " General Financial Rules (GFRs) 2017 " of Government of India for detailed understanding
28. **REJECTION OF TENDER**
- 28.1 Airports Authority of India reserves the right to reject all the tenders or any of the tender or any part of tender without assigning any reason.
- 28.2 AAI also reserves the right at its sole discretion not to award any work under this tender. AAI shall not pay any costs or loss incurred by the tenderers in the preparation and submission of any requisite tender or technical proposal or to procure contract for any of the items described herein.
- 28.3 If the tenderer deliberately gives wrong information or suppress any information in his tender, AAI reserves the right to reject such tender at any stage or to cancel the contract, if awarded, absolutely, in addition to any other appropriate/legal action.
- 28.4 Canvassing in any form in connection with the tenders is strictly prohibited and the tenders submitted by firms who resort to canvassing are liable for rejection.
- 28.5 Any deviation in the tender submission procedure will be considered as non- responsive bid and liable to be rejected.
- 28.6 A tenderer shall submit a responsive bid, failing which his tender will be liable to be rejected.
- 28.7 Tender in which any of the particulars and prescribed information are missing or are incomplete, in any respect and / or prescribed conditions are not fulfilled, shall be considered non-responsive and is liable to be rejected.
- 28.8 The tenderer is expected to examine the tender document including all instructions, forms, terms, specifications, drawings, etc. Failure to furnish all information required as per the tender documents or submission of a tender not substantially responsive to the tender document in any respect may result in the rejection of the tender.
- 28.9 The work being executed under this tender shall be in operational / Security areas of the Airport. AAI reserves the right to accept or reject the tender in full or in part if so required due to security reasons.
- 28.10 A tenderer shall submit the tender which satisfy each and every condition laid down in this notice failing which the Tender will be liable to be rejected.
29. **OTHER CONDITIONS**
- 29.1 No correspondence shall be entertained from the tenderers after the opening of Cover-II (Financial bid) of the tender, other than asked by AAI for any clarification if required by AAI.

- 29.2 AAI shall be the sole judge in the matter of evaluating & accepting Documents submitted in Cover-I, financial bids and award of contract and the decision of AAI shall be final and binding.

30. **ADDRESS FOR CORRESPONDANCE**

Address for correspondence in respect of this tender is mentioned below:

Asst. General Manager (Engg-E),
Airports Authority of India,
LBSI Airport,
Varanasi-226001, India

31. **PERIOD OF VALIDITY OF TENDER**

- i. **The tender for work shall remain open for acceptance for a period of 90 days (ninety days) from the date of Opening of Envelope-II (Financial Bid).** If any tenderer withdraws his tender before the said period or makes any modification in the terms and conditions of the tender which are not acceptable to AAI, the tenderer shall be suspended for 1 year and shall not be eligible to bid for AAI tenders from date of issue of suspension order.
 - ii. Notwithstanding **Clause 31(i)** above, AAI solicit the tenderers consent to an extension of the period of tender validity. The requests and the responses thereto shall be made in writing or by cable, telex or facsimile. A tenderer agreeing the request will not be required to permit to modify their bid.
32. Queries, if any, related to the tender may be sent through CPP e-tender portal as per the critical date mentioned for clarification in Tender form only.
33. The contractor shall submit irrevocable Bank Guarantee for the purpose of Performance Guarantee, Security Deposit & levy of Compensation for delay of required amount Commercial Bank (i.e. Indian or Foreign Banks included in the Second Schedule of Reserve Bank of India Act, 1934 excluding Co-Operative/Regional Rural Banks) having office in India. Insurance Surety Bonds is also acceptable against Performance Guarantee.
Any other form of Bank Guarantee except irrevocable Bank Guarantee as mentioned above shall not be considered.

34. **LANGUAGE**

- 34.1 This Contract will be executed in the English language, which shall be the binding and controlling language for all matters relating to the meaning or interpretation of this contract.
- 34.2 The Proposal with all accompanying documents and related correspondence shall be in English language and strictly on the forms provided in this Bid document. No supporting document or printed literature shall be submitted with the Proposal unless specifically asked for and in case any of these documents is in another language, it should be accompanied by an accurate translation of the relevant passages in English, in which case, for all purposes of interpretation of the Proposal, the translation in English shall prevail.

35. **OTHERS**

- 35.1 No single firm shall be permitted to submit two separate tenders either as individual or otherwise. No two concerns in which an individual has interest involved, as proprietor, shareholder and / or partner shall tender for the execution of the same works. If they do so, all such tenders shall be liable to rejected. In case such involvement is detected at a later date during the currency of the project, the agreement shall be terminated without notice and appropriate legal action shall be taken including debarring the agency from bidding in AAI for a period of 3 years (or as per AAI Policy).

- 35.2 Submission of bids by a bidder implies that he has read this notice and all other contract documents and has made himself aware of the scope of the works to be done and local conditions, local material rates and other factors bearing on the performance of the contract / execution of the works.
- 35.3 This notice of bid shall form part of the contract documents. The successful tenderer on acceptance of his bid by the Accepting Authority, shall within 10 days from the date of issue of award letter shall sign the contract consisting of Notice Inviting Tenders, Tender provisions / conditions as issued at the time of invitation of bid and acceptance thereof with any correspondence leading there to.

36. **GUIDANCE ON NAVIGATION THROUGH CPP PORTAL**

The Tender document has been published on the Central Public procurement Portal (URL NIC CPP Portal <http://etenders.gov.in/eprocure/app>). The Bidders are required to submit soft copies of their bid electronically on the CPP Portal, using valid Digital Signature Certificates. The instructions given below are meant to assist the Bidders in registration on the CPP Portal, prepare their bid in accordance with the requirements and submitting their Bid online on the CPP Portal. More information useful for submitting online bid on the CPP Portal may be obtained at <http://etenders.gov.in/eprocure/app>.

37.1 **REGISTRATION**

- a) Bidders are required to enroll on the e-Procurement Module of the Central Public procurement Portal ((URL NIC CPP Portal <https://etenders.gov.in/eprocure/app> by clicking on the “Click here to Enroll” on the CPP Portal Enrolment which is free of charge.
- b) As part of the enrolment process, the Bidders will be required to choose a unique user name and assign a password for their accounts.
- c) Bidders are advised to register their valid email address and mobile numbers as part of the registration process. These would be used for any communication from the CPP Portal.
- d) Upon enrolment, the Bidders will be required to register their valid Digital Signature Certificate (Class II or Class III Certificates with signing key usage) issued by any Certifying Authority recognized by CCA India (e.g. Sify/TCS/nCode/eMudra etc.) with their profile.
- e) Only one valid DSC should be registered by a firm. Please note that the Bidders are responsible to ensure that they do not lend their DSC’s to others which may lead to misuse.
- f) Bidders then log in to the site through the secured log-in by entering their user
- g) ID/ password and the password of the DSC/e-Token.

37.2 **PREPARATION OF BIDS**

- a) Agency/Firm should take into account any corrigendum published on the Bid document before submitting their Bid. Please go through the Tender document carefully to understand the documents required to be submitted as part of the Bid. Please note the number of covers in which the Bid documents have to be submitted, the number of documents – including the names and content of each of the document that need to be submitted.
- b) Agency/Firm, in advance, should get ready the Bid documents to be submitted as indicated in the Bid document/schedule and generally, it can be in PDF/SLS/RAR/DWF formats. Bid documents may be preferably scanned with 100 dpi with black and white option.
- c) To avoid the time and effort required in uploading the same set of standard documents which are required to be submitted as a part of every Bid, a provision of uploading such standard documents (e.g. PAN card copy, annual reports, completion certificates etc.) has been provided to the Bidders. Bidders can use “My Space” area available to them to upload such documents. Those documents may be directly submitted from the “My Space” area while

submitting a Bid, and need not to be uploaded again and again. This will lead to a reduction in the time required for Bid submission process.


37.3 SUBMISSION OF BIDS

- a) Bidders should log into the NIC-CPP Portal well in advance for Bid submission so that they upload the Bid in time i.e. on or before the Bid submission time. Firm will be responsible for any delay due to other issues.
- b) The Agency/Firm has to digitally sign and upload the required Bid documents one by one as indicated in the Bid document.
- c) The Tender Inviting Authority (TIA) will not be held responsible for any sort of delay or the difficulties faced during the submission of Bid online by the Bidders. The Agency/ Firm should see that the Bid documents submitted should be free from virus and if the documents could not be opened, due to virus, during Bid opening, the Bid is liable to be rejected.
- d) The server time (which is displayed on the Bidders' dashboard) will be considered as the standard time for referencing the deadlines for submission of the Bids by the Bidders, opening of Bids etc. The Bidders should follow this time during Bid submission. The Bidders are requested to submit the Bids through online e tendering system to the Bid Inviting Authority well before the Bid submission end date & time (as per Server System Clock).
- e) All the documents being submitted by the Bidders would be encrypted using PKI encryption techniques to ensure the secrecy of the data. The data entered cannot be viewed by unauthorized persons until the time of Bid opening. The confidentiality of the Bids is maintained using the secured Socket Layer 128bit encryption technology. Data storage encryption of sensitive fields is done.
- f) The uploaded Bid documents become readable only after the Bid opening by the authorized Bid openers.
- g) Upon the successful and timely submission of Bids, the portal will give a successful Bid submission message & a Bid summary will be displayed with the Bid no. and the date & time of submission of the Bid with all other relevant details.
- h) The Bid summary has to be printed and kept as an acknowledgement of the submission of the Bid. This acknowledgement may be used as an entry pass for any Bid opening meetings.

Asst. General Manager (Engg-E),
Airports Authority of India,
LBSI Airport,
Varanasi-226001.

Procedure for Online Collection of Tender Fee & EMD from Bidders

1. Bidder will login to the portal <https://etenders.gov.in/> with valid User ID (i.e. User ID mapped with Digital Signature Certificate) and follow the process of participation to the tender.
2. After Login search the tender in "Search Active Tender" tab with different criteria after that click on "set as favourite" to move on "My Tender". Then click on "My tender" and view the tender details and click on proceed for Bid Submission.
3. For submission of online Tender Fee and EMD, click on Button as "Pay Online"
4. **In case of Tender Fee** If the Bidder is exempted from the tender fee payment, then select the option to "Yes" otherwise "NO" as per below screenshot:

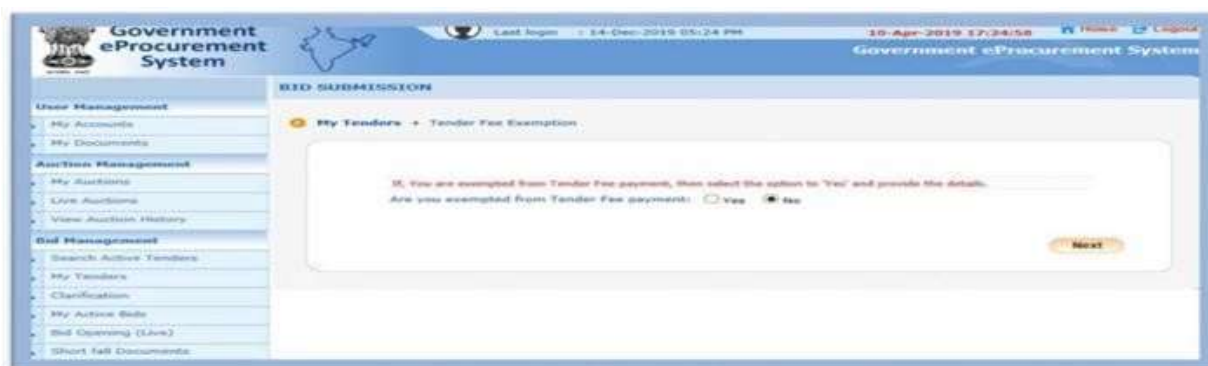

5. **In case of EMD:** If Bidder is paying EMD through any of below options, Select the option "Yes" (as per below screenshot) and provide the details and upload copy as a proof.
 - Bank Guarantee (BG)/Swift Transfer (ST)
 - Exempted from EMD Payment

Note: For submitting "EMD through BG/ST" or "Exemption from EMD payment" bidder must select " Yes " otherwise bidders will not have the option to pay EMD through Bank Guarantee . Once proceeded it is not possible to revert the option
6. Select option " NO " (as per below screenshot) for proceeding for Online EMD payment.



After selecting the option, click on “Next” Button as per above screenshot. Further process to be followed as per subsequent screen.

screenshot. Further process to be


National Informatics Centre

Payment Gateway

STEPS FOR MAKING TENDER PAYMENTS IN ETENDERS SYSTEM VIA SBI BANK GATEWAY **(SBI AND NON SBI ACCOUNT HOLDERS)**

Home Page.

Login as a bidder into etenders.gov.in to proceed for payment.

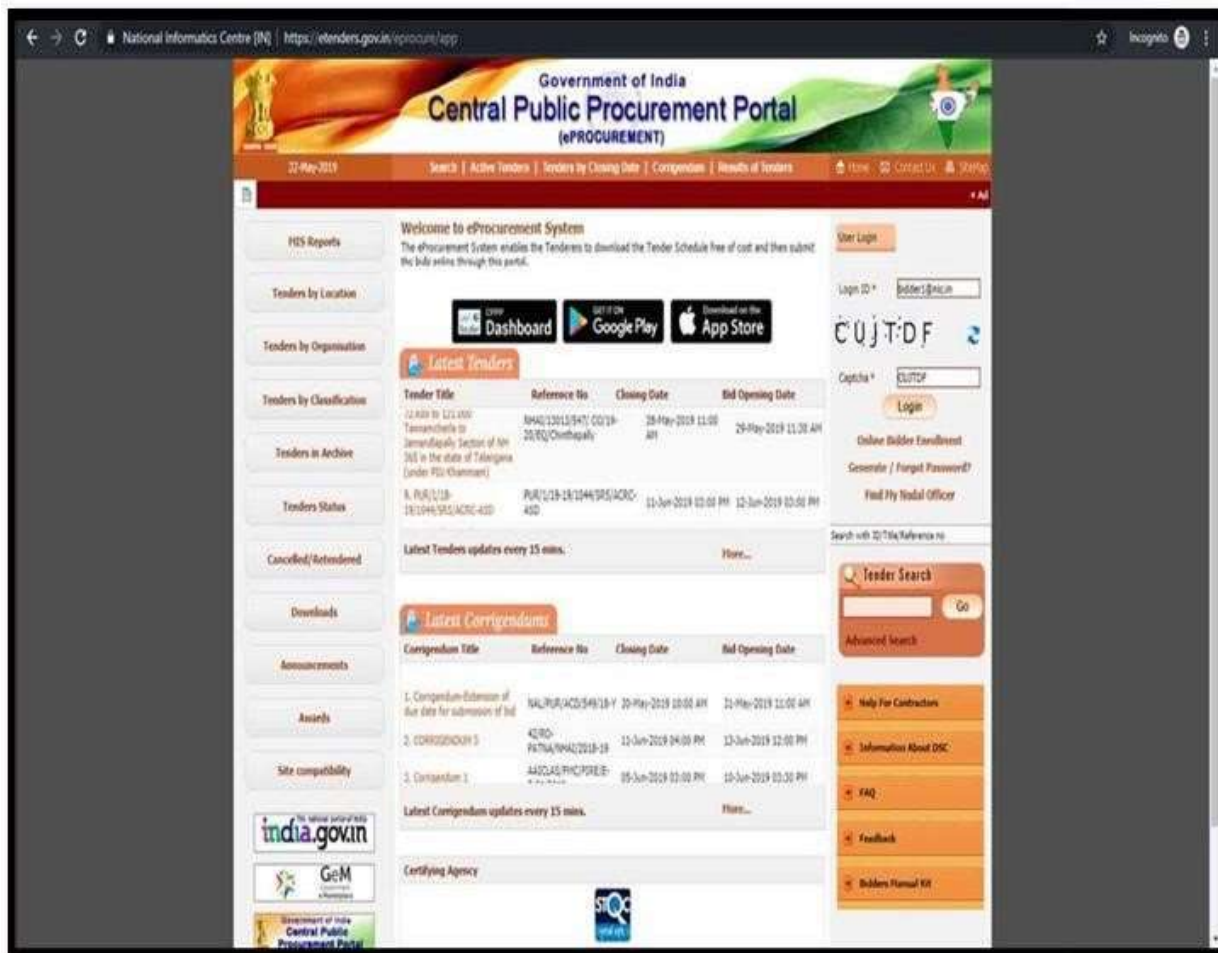

Step 1) Click **"Pay Online"** when you reach below page while Online Bid Submission.

User Management

My Accounts

My Documents

Auction Management

My Auctions

Live Auctions

View Auction History

Bid Management

Search Active Tenders

My Tenders

Clarification

My Active Bids

Bid Opening (Live)

Short Fall Documents

Online Payment Status

My Bids History

Short Fall Documents History

Archived Clarification

Tender Status

My Withdrawn Bids

BID MANAGEMENT

My Tenders

2018_LSGD_204397_1

Transaction Message

Organization Chain : NIC||NIC Contracts

Tender Reference Number : PW3/23401/18

Tender ID : 2018_LSGD_204397_1

Tender Title : PW3/23401/18 PRO.NO.604/18-19 DYN.30 VARIOUS LANES INTERLOCKING AND CONCRETING

Bid Process List

S.No	Bid Process	Action
1	Profile	

Bid Payment Details

S.No	Fee Type	Actual Fee	Exempted Fee	Fee To Be Paid	Paid Fee
1	Tender Fee	2500.00 (INR)	0.00	2500.00 (INR)	0.00
2	Emd Fee	37500.00 (INR)	0.00	37500.00 (INR)	0.00

Pay Online

Encrypt&Upload

Version:1.09.06 04-Feb-2018

(c) 2008 Tenders NIC, All rights reserved.

Step 2) Click “Confirm to Pay” to proceed with the payment gateway, as below.

Note: Please ensure that you have availed Tender Fee / EMD Exemption, if eligible. Further, there would not be any provision to change back, under any circumstances.

User Management

My Accounts

My Documents

Auction Management

My Auctions

Live Auctions

View Auction History

Bid Management

Search Active Tenders

My Tenders

Clarification

My Active Bids

Bid Opening (Live)

Short fail Documents

Online Payment Status

My Bids History

Short fail Documents History

Archived Clarification

Tender Status

My Withdrawn Bids

BID MANAGEMENT

Offline/OnLine Payment Confirmation

Organization Chain : NIC||NIC Contracts

Tender Reference Number : PW3/23401/18

Tender ID : 2018_LSGD_204397_1

Tender Title : PW3/23401/18 PRO.NO.604/18-19 DVN.30 VARIOUS LANES INTERLOCKING AND CONCRETING

Bid Payment Details

S.No	Fee Type	Actual Fee	Exempted Fee	Fee To Be Paid
1	Tender Fee	2128.00 (INR)	0.00	2128.00 (INR)
2	Emd Fee	23100.00 (INR)	0.00	23100.00 (INR)

Portal Alert :

Beyond this stage, you will not be able to edit Fee or Exemption details.

Please confirm that the exemption and amount to be paid are correct.

I hereby confirm that the above payment details are correct.

Back

Confirm to Pay

Version:1.09.06 04-Feb-2018

(c) 2008 Tenders NIC, All rights reserved.

Step3) Verify that the Tender fee and EMD shown are correct, as per tender document. Then, select the payment option **SBI MOPS** and Submit, as below.

Note: In case of any mismatch in tender payments, with reference to tender documents, please contact TIA for clarifications.

BID MANAGEMENT

User Management

My Accounts

My Documents

Auction Management

My Auctions

Live Auctions

View Auction History

Bid Management

Search Active Tenders

My Tenders

Clarification

My Active Bids

Bid Opening (Live)

Short fall Documents

Online Payment Status

My Bids History

Short Fall Documents History

Archived Clarification

Tender Status

My Withdrawn Bids

OnLine Payment Gateway

Organization Chain : NIC|NIC Contracts

Tender Reference Number : PW3/23401/18

Tender ID : 2018_LSGD_204397_1

Tender Title : PW3/23401/18 PRO.NO.604/18-19 DVN.30 VARIOUS LANES INTERLOCKING AND CONCRETING

Bid Payment Details

Fee Type	Actual Fee	Exempted Fee	Fee To be Paid
Tender Fee	2,500	0	2,500
Emd Fee	37,500	0	37,500
Total Fee			40,000

Choose Payment Option

☒ SBI MOPS

Back

Submit

Version:1.09.06 04-Feb-2018

(c) 2008 Tenders NIC, All rights reserved.

Step 4) Check and Follow the Terms and Conditions, and then Submit, as below.



BID MANAGEMENT

OnLine Payment Gateway

Payment Verification

Organization Chain : NIC|NIC Contracts
Tender Reference Number : PW3/23401/18
Tender ID : 2018_LSGD_204397_1
Tender Title : PW3/23401/18 PRO.NO.604/18-19 DVN.30 VARIOUS LANES INTERLOCKING AND CONCRETING

Pay Model : SBI MOPS


✓ **Terms And Conditions.**

- You are being redirected to the SBI MOPS site.
- You have to complete the transaction with in the session time which is approximately 15 minutes.
- Money once transferred towards tender fee shall not be refunded at any point of time. This is applicable even in case you have not completed the tender process.
- Once payment is successfully completed, you will be automatically redirected back to e-Procurement site.
- It is the responsibility of the Individual to ensure that the payment is successfully completed and eProcurement system is not responsible for any malfunctions in the Bank payment gateway.
- please take print screen for bank acknowledgement page.

Back Submit

Version: 1.09.06.04-Feb-2018 (c) 2008 Tenders NIC, All rights reserved.

Step 5) Bidders may choose the type of transaction and proceed for payment.

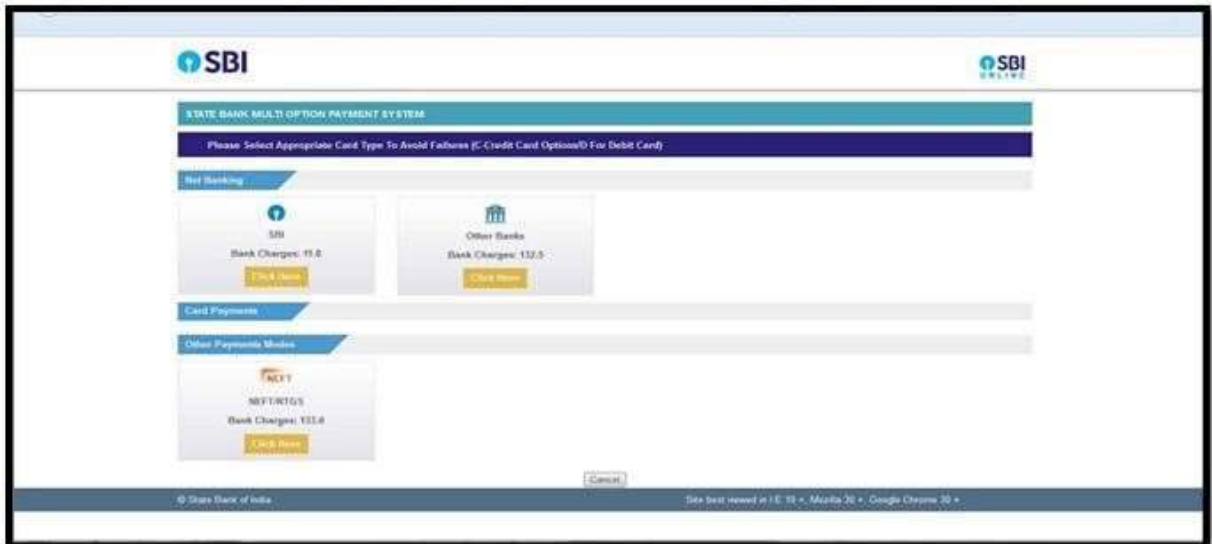

SBI

STATE BANK MULTI OPTION PAYMENT SYSTEM

Please Select Appropriate Card Type To Avoid Failures (C-Credit Card Options/D For Debit Card)

Net Banking

SBI
Bank Charges: ₹1.0
Click Here

Other Banks
Bank Charges: ₹12.5
Click Here

Card Payments

Debit Payments Method

CREDIT
SBFTRTGS
Bank Charges: ₹13.0
Click Here


Cancel

© State Bank of India Site best viewed in I.E. 11 - Mozilla 36 - Google Chrome 30

Step 6) Once the Payment type is selected it navigates to the respective landing page.


a) SBI

i. Bidders with SBI account may click **SBI** option to proceed to its Net Banking Page

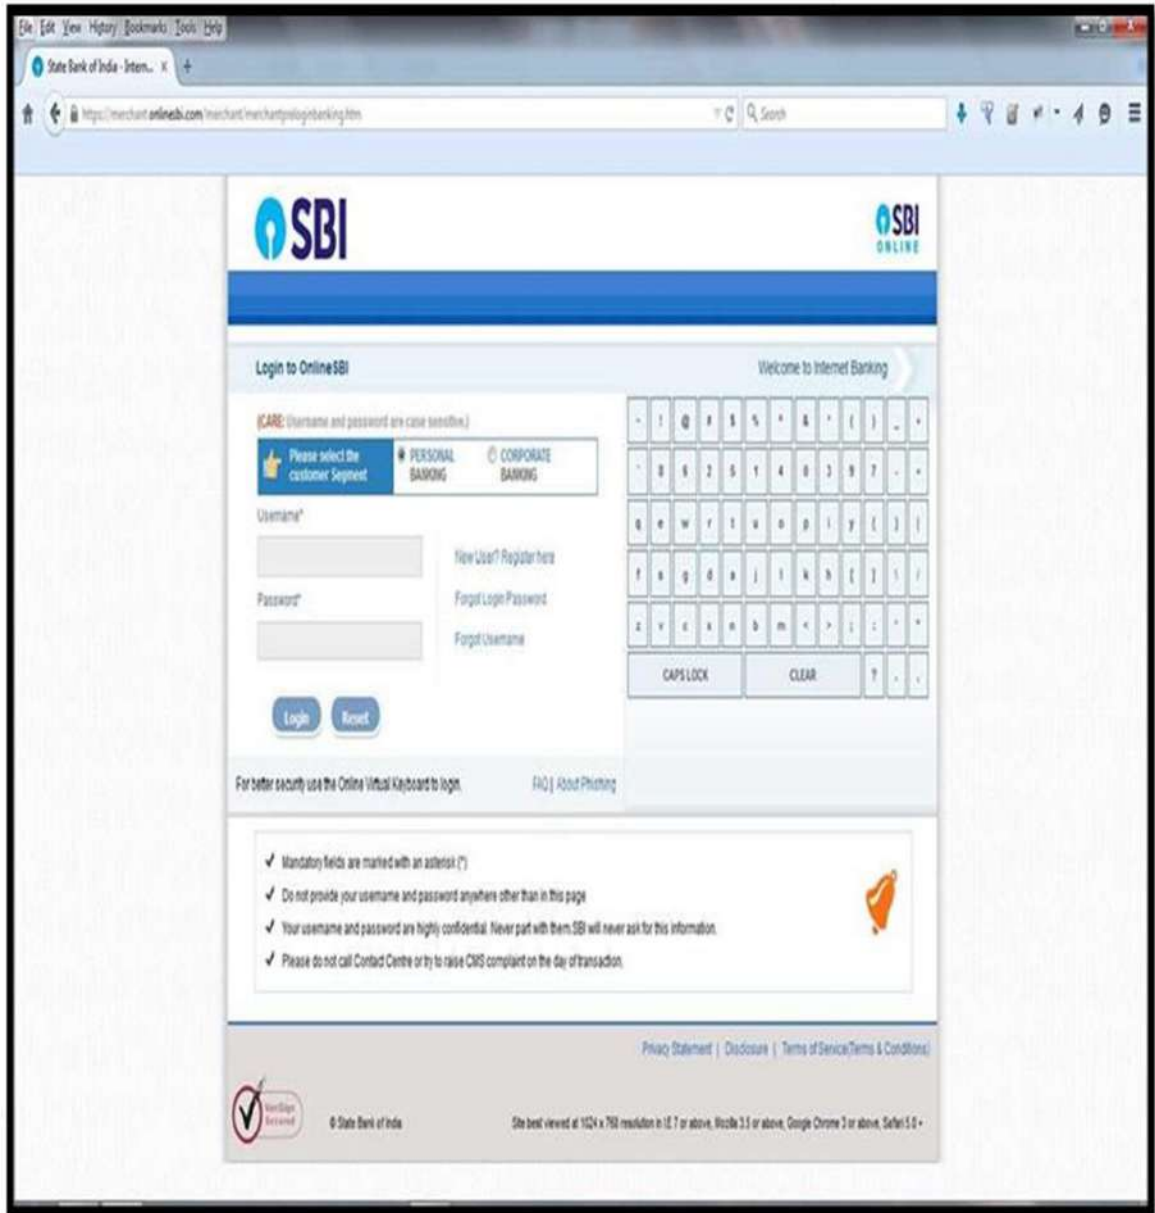

The screenshot displays the SBI Online Banking login interface. At the top, the SBI logo is visible on the left, and 'SBI ONLINE' is on the right. The main heading is 'Login to Online SBI'. Below this, a message states '(CARE: Username and password are case sensitive)'. There are two tabs: 'PERSONAL BANKING' (selected) and 'CORPORATE BANKING'. The login form includes fields for 'Username*' and 'Password*', with links for 'New User? Register here', 'Forgot Login Password', and 'Forgot Username'. A 'Login' button is present. To the right of the form is a virtual keyboard with a 'CAPS LOCK' and 'CLEAR' button. Below the login form, a security notice states: 'For better security use the Online Virtual Keyboard to login.' and a link to 'FAQ | About Phishing'. At the bottom, there are links for 'Privacy Statement', 'Disclosure', and 'Terms of Service/Terms & Conditions'. A 'Verified' badge is shown on the left, and the footer includes '© State Bank of India' and a note about the best viewing resolution and browser versions.

ii. Bidders may enter SBI Net banking user ID and Password and Click on **Login** to proceed.

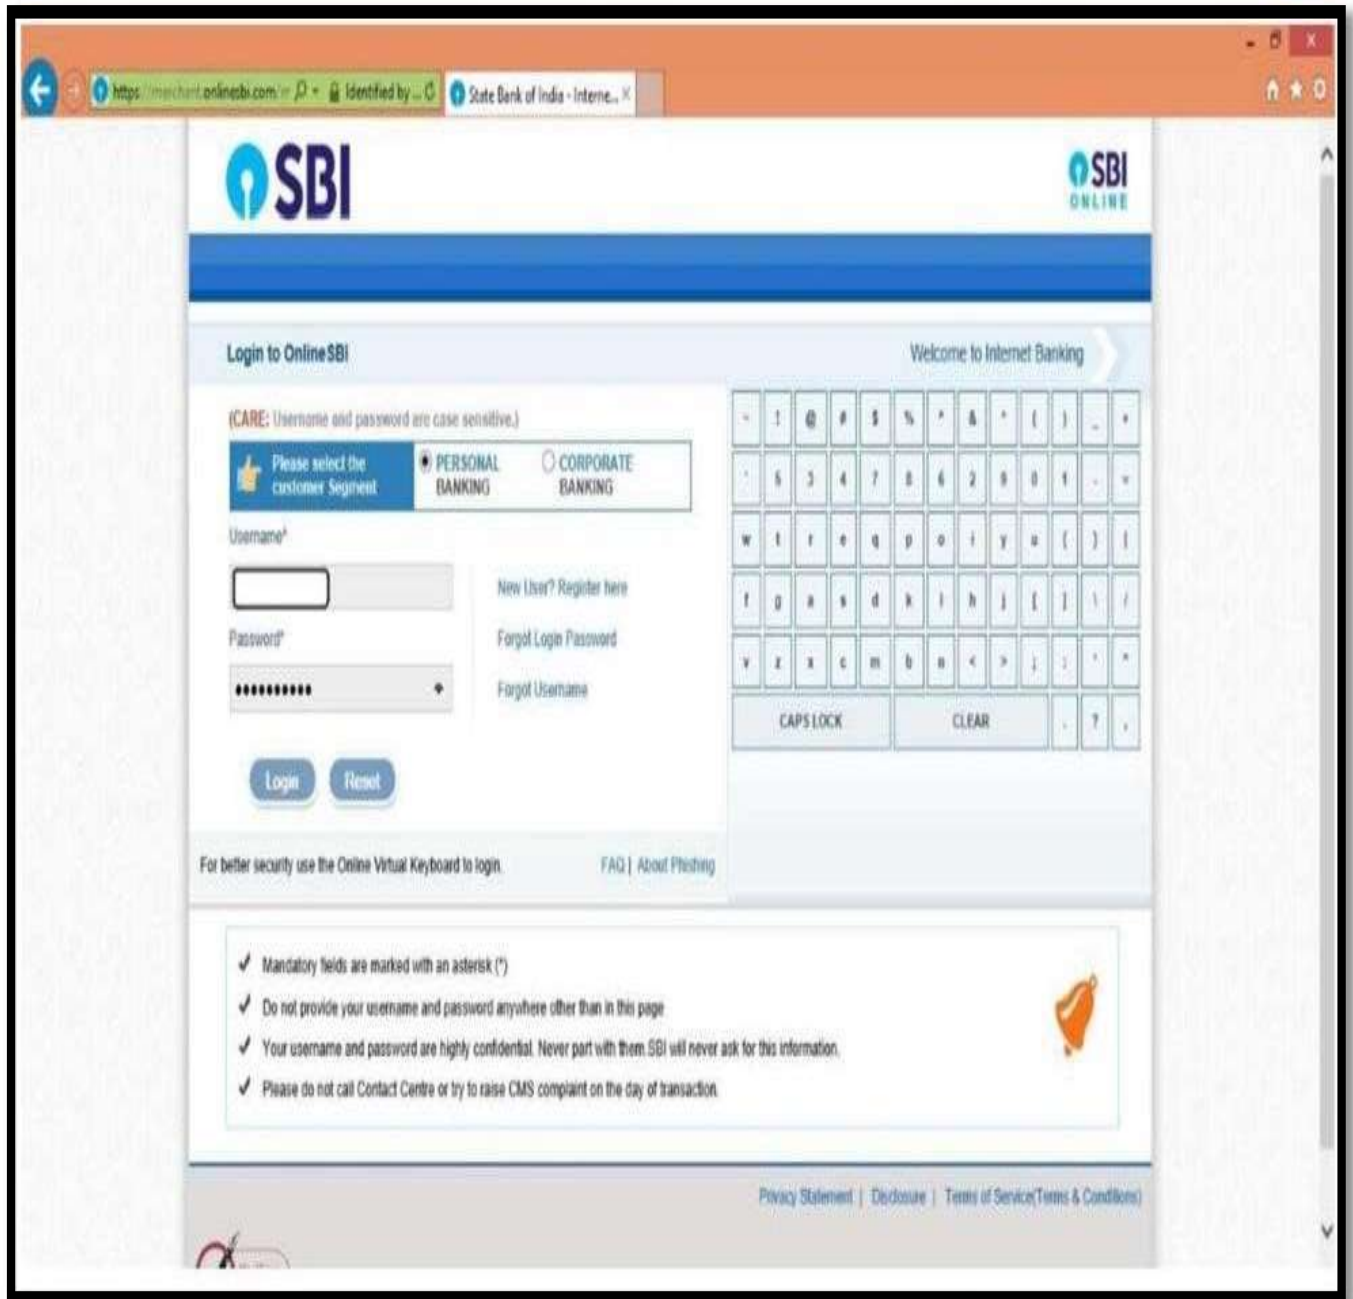

The screenshot displays the SBI Online Banking login interface. At the top, the SBI logo and 'SBI ONLINE' text are visible. The main heading is 'Login to OnlineSBI', with a 'Welcome to Internet Banking' message on the right. A note states '(CARE: Username and password are case sensitive.)'. Below this, there are two tabs: 'PERSONAL BANKING' (selected) and 'CORPORATE BANKING'. The login fields include 'Username*' and 'Password*', both marked as mandatory. A 'New User? Register here' link is provided next to the username field. Below the password field, there are links for 'Forgot Login Password' and 'Forgot Username'. A 'Login' button is present, along with a 'Reset' button. To the right of the login fields is an 'Online Virtual Keyboard' with a grid of characters and buttons for 'CAPS LOCK' and 'CLEAR'. At the bottom, there is a security notice with four bullet points: 'Mandatory fields are marked with an asterisk (*)', 'Do not provide your username and password anywhere other than in this page', 'Your username and password are highly confidential. Never part with them. SBI will never ask for this information.', and 'Please do not call Contact Centre or try to raise CMS complaint on the day of transaction.' The footer contains links for 'Privacy Statement', 'Disclosure', and 'Terms of Service(Terms & Conditions)'.

https://merchant.onlinesbi.com/... Identified by ... State Bank of India - Intern... X

SBI **SBI ONLINE**

Login to OnlineSBI **Welcome to Internet Banking**

(CARE: Username and password are case sensitive.)

Please select the customer Segment

☒ PERSONAL BANKING ☐ CORPORATE BANKING

Username*

Password*

New User? Register here

[Forgot Login Password](#)

[Forgot Username](#)

[Login](#) [Reset](#)

For better security use the Online Virtual Keyboard to login. [FAQ](#) | [About Phishing](#)

✓ Mandatory fields are marked with an asterisk (*)

✓ Do not provide your username and password anywhere other than in this page

✓ Your username and password are highly confidential. Never part with them. SBI will never ask for this information.


✓ Please do not call Contact Centre or try to raise CMS complaint on the day of transaction.

[Privacy Statement](#) | [Disclosure](#) | [Terms of Service\(Terms & Conditions\)](#)

National Informatics Centre

Payment Gateway

iii. Please ensure that your account has sufficient balance, before proceeding further. After checking the same, Click **Confirm** button as below, to transfer payment. After account debit, MOPS gateway will automatically re-direct to the eProcurement System, with the Success transaction.

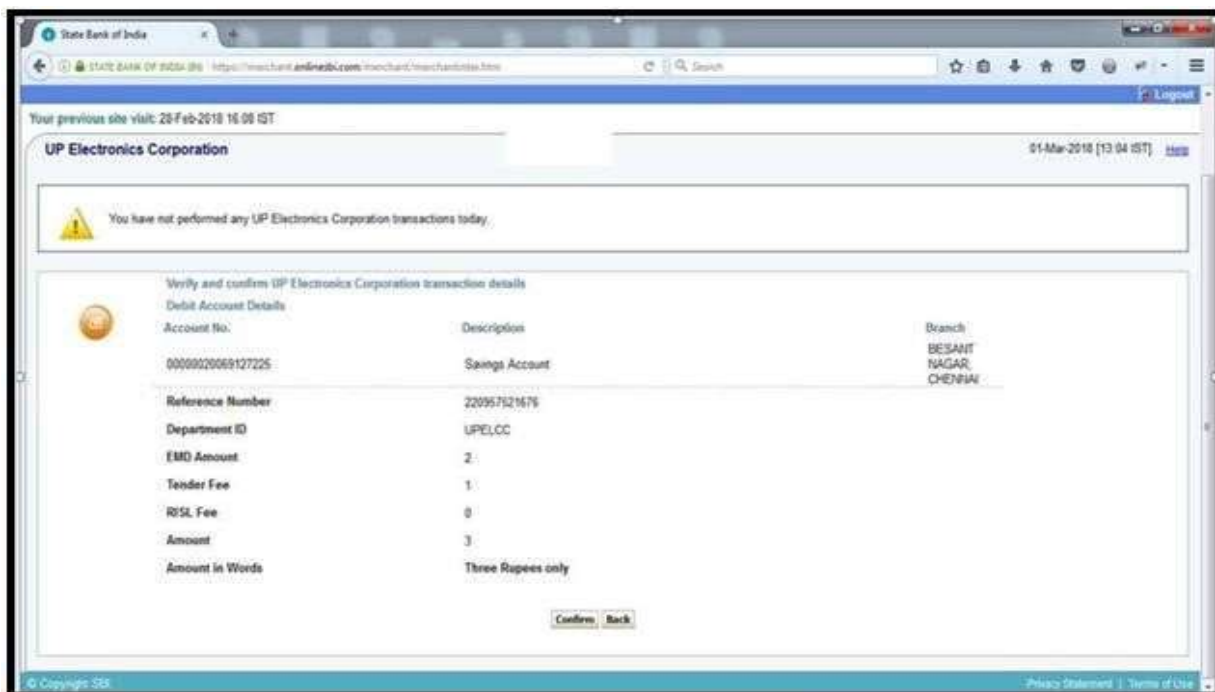

State Bank of India
STATE BANK OF INDIA (SBI) | https://merchant.sbi.com/merchant/merchantdetails.htm

Your previous site visit: 28-Feb-2018 16:08 IST

UP Electronics Corporation 01-Mar-2018 [13:04 IST]


You have not performed any UP Electronics Corporation transactions today.

Verify and confirm UP Electronics Corporation transaction details

Debit Account Details	Description	Branch
Account No.:	0000020069127225	Savings Account
Reference Number	220957121676	
Department ID	UPELCC	
EMD Amount	2	
Tender Fee	1	
RISL Fee	0	
Amount	3	
Amount in Words	Three Rupees only	

Confirm Back

© Copyright SBI Privacy Statement Terms of Use

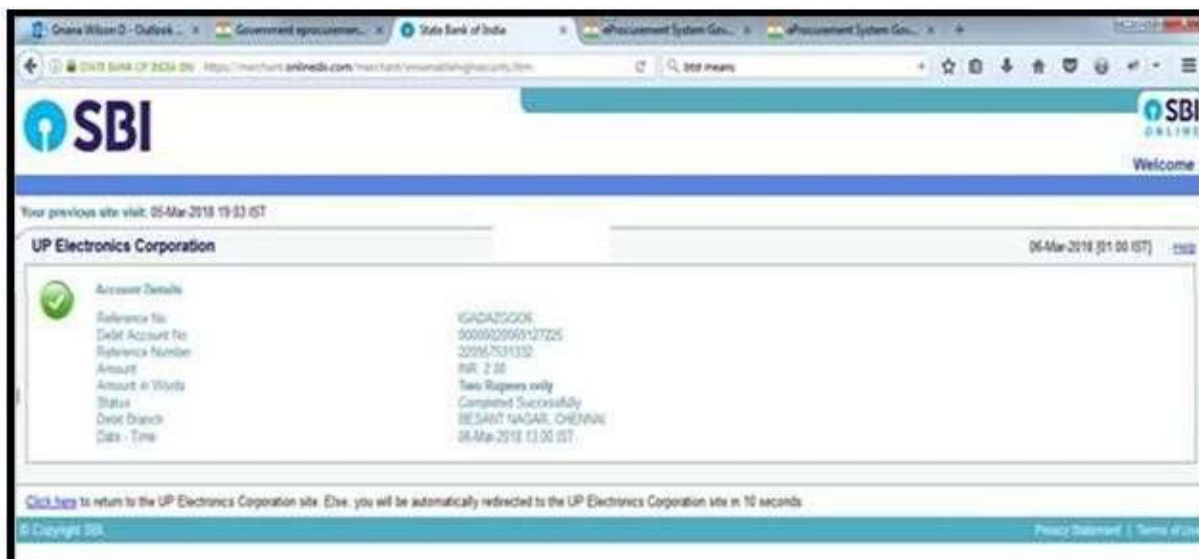

State Bank of India
STATE BANK OF INDIA (SBI) | https://merchant.sbi.com/merchant/merchantdetails.htm

Your previous site visit: 05-Mar-2018 19:53 IST

UP Electronics Corporation 06-Mar-2018 [01:00 IST]

Account Details

Reference No.	KGAD25G06
Debit Account No.	0000020069127225
Reference Number	220957121676
Amount	₹ 2.00
Amount in Words	Two Rupees only
Status	Completed Successfully
Order Branch	BESANT NAGAR, CHENNAI
Date - Time	06-Mar-2018 13:00 IST

Click here to return to the UP Electronics Corporation site. Else, you will be automatically redirected to the UP Electronics Corporation site in 10 seconds.


© Copyright SBI Privacy Statement Terms of Use

National Informatics Centre

Payment Gateway

iv. As in below, you will receive bank response immediately by verifying the payment status, whether **Success** or not. In case, payment was debited from account and further, **Payment Failure** is shown, immediately contact the eProcurement helpdesk, for resolution, before tender closing time.

Click **Next** to go to Bid Preparation details, as in screenshot.

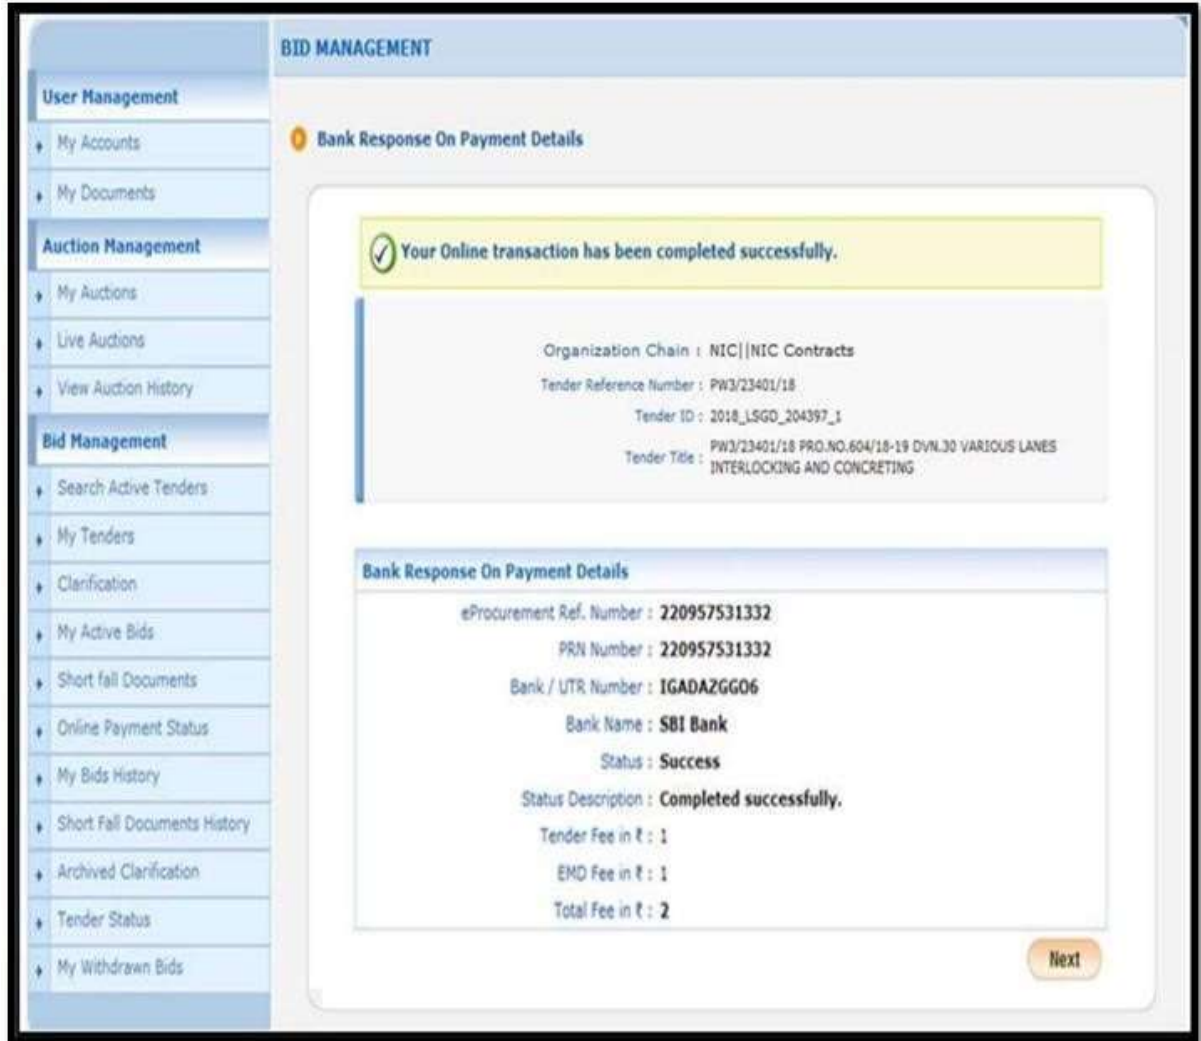

BID MANAGEMENT

Bank Response On Payment Details

✓ Your Online transaction has been completed successfully.

Organization Chain : NIC||NIC Contracts
Tender Reference Number : PW3/23401/18
Tender ID : 2018_LSGD_204397_1
Tender Title : PW3/23401/18 PRO.NO.604/18-19 DYN.30 VARIOUS LANES INTERLOCKING AND CONCRETING


Bank Response On Payment Details

eProcurement Ref. Number : **220957531332**
PRN Number : **220957531332**
Bank / UTR Number : **IGADAZGG06**
Bank Name : **SBI Bank**
Status : **Success**
Status Description : **Completed successfully.**
Tender Fee in ₹ : 1
EMD Fee in ₹ : 1
Total Fee in ₹ : 2


Next

b) OTHER BANKS :

- i) Bidders with other bank account may click Other Banks option to proceed to SBI Net Banking Page.

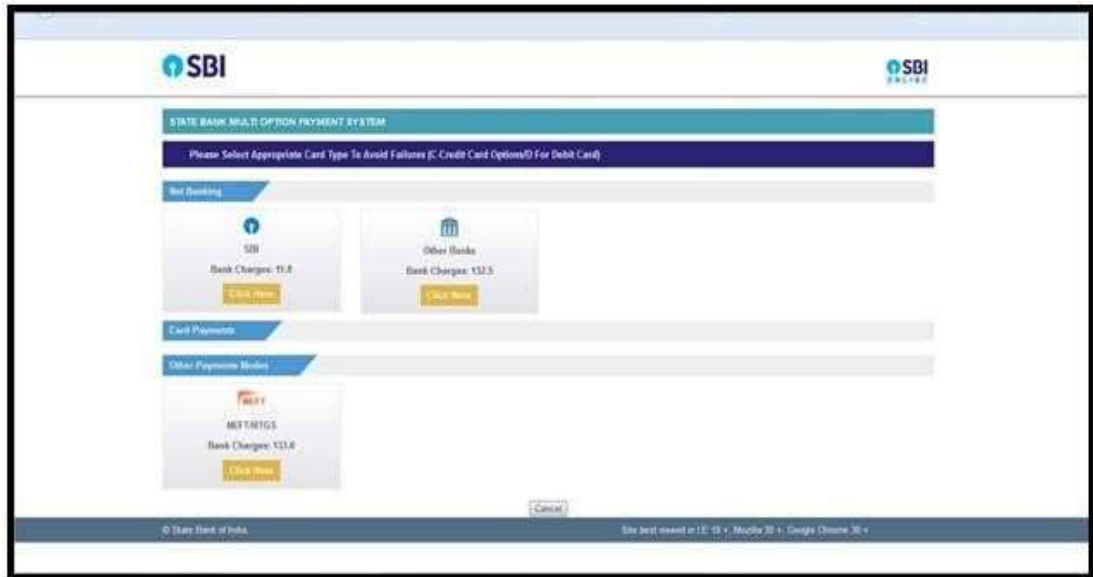


You may select the appropriate Bank from selection page. As an example, we are proceeding with ICICI Bank in the provided dropdown box of **All Banks**.


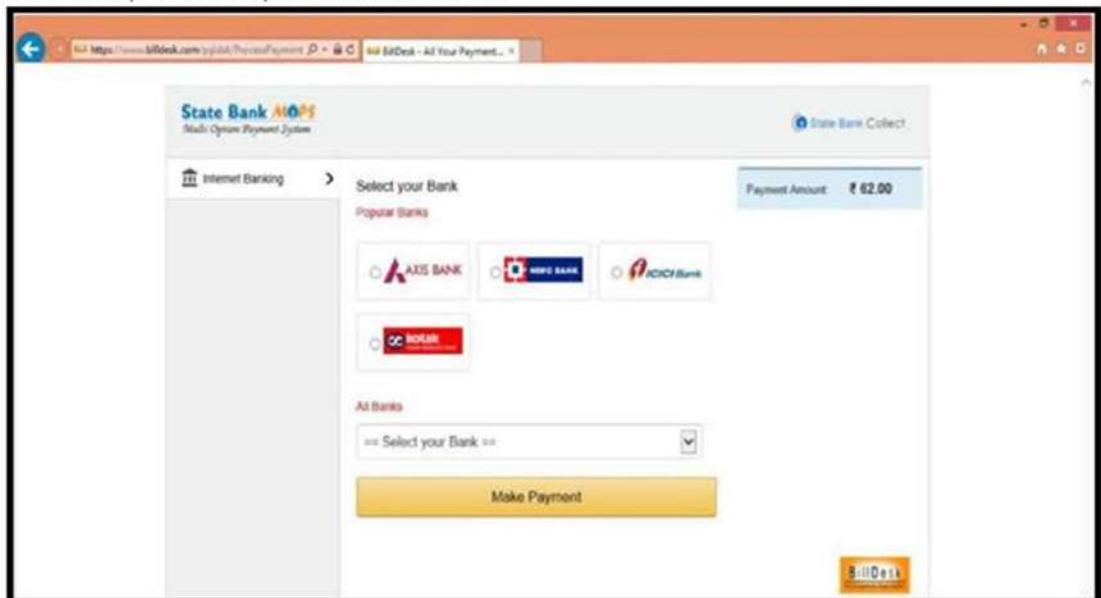



National Informatics Centre

Payment Gateway

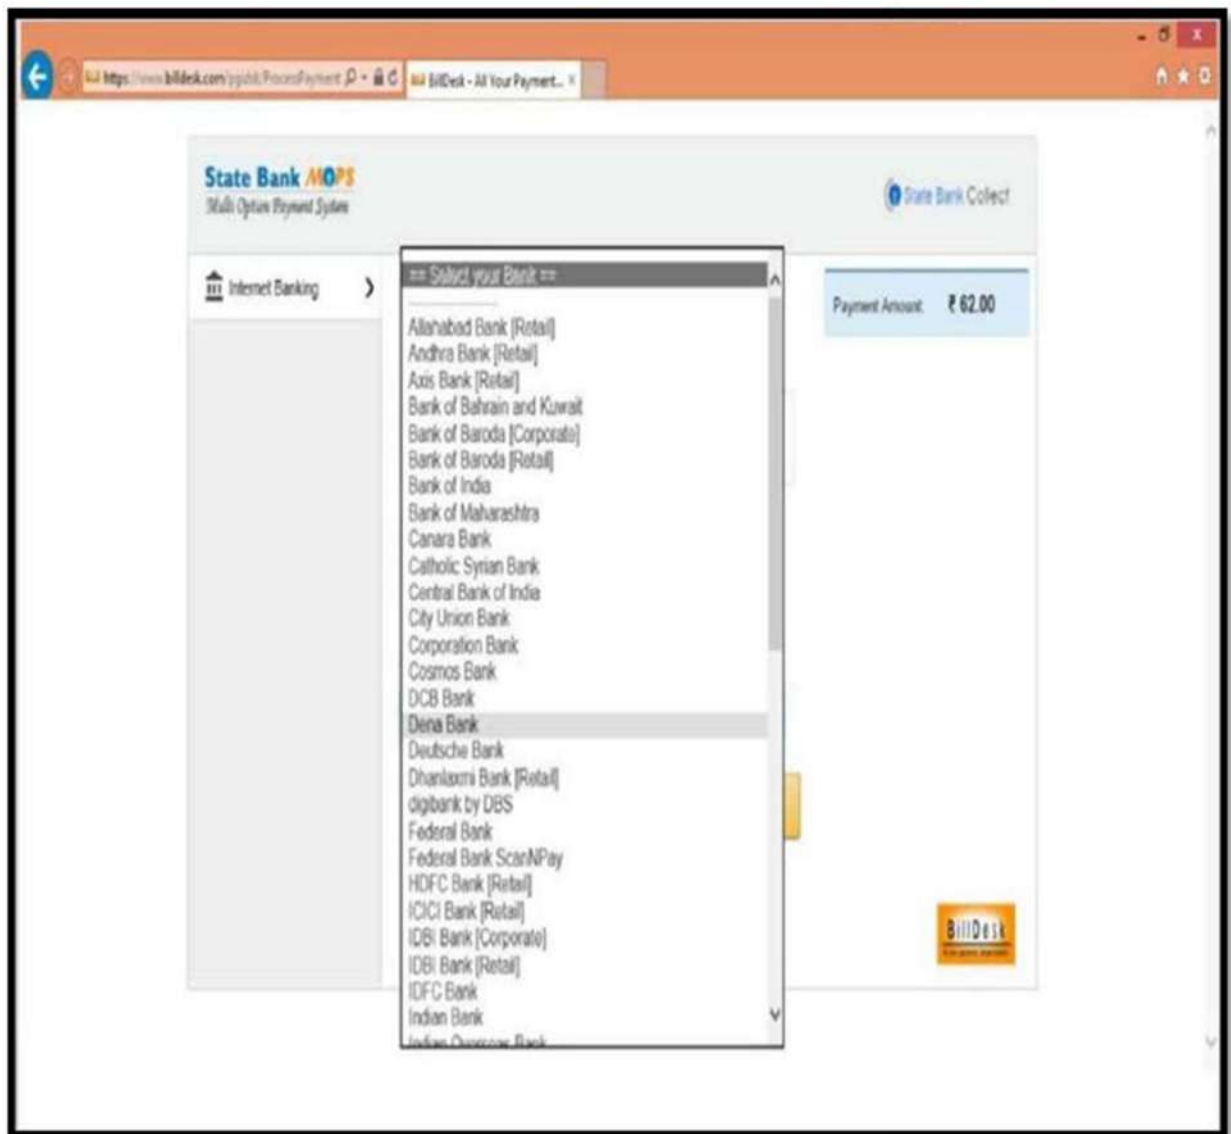

After selecting ICICI Retail Banking, Click **Make Payment** Button to banking page. Further steps may depend on the Bank Procedure.

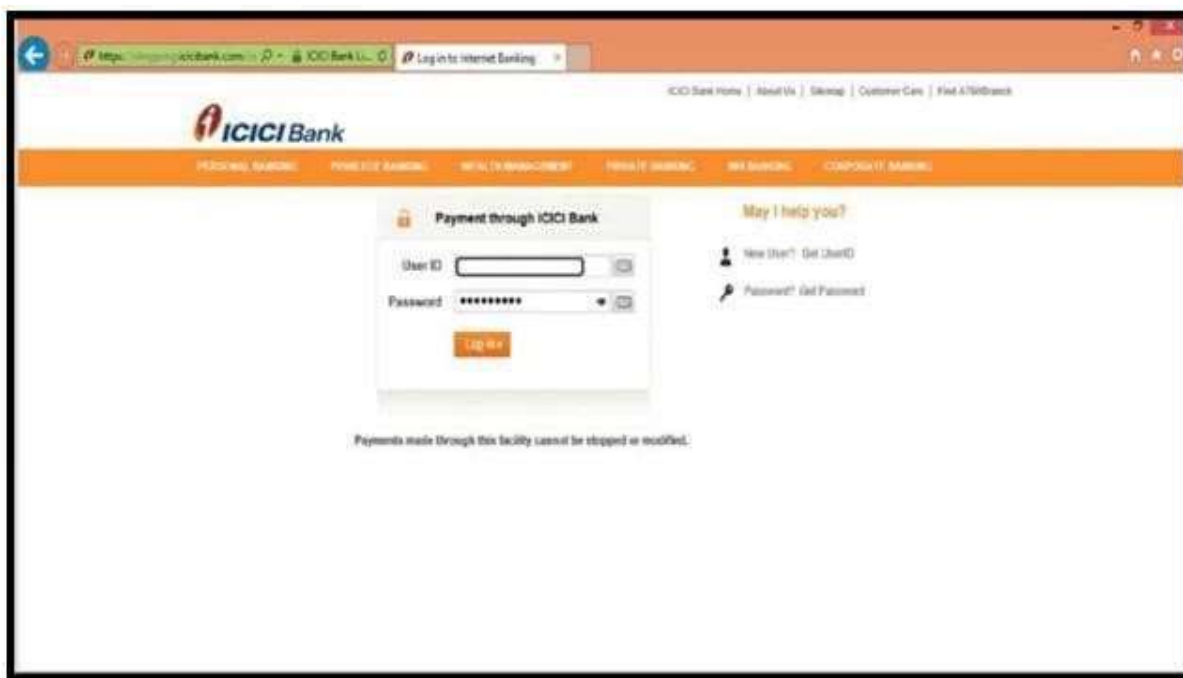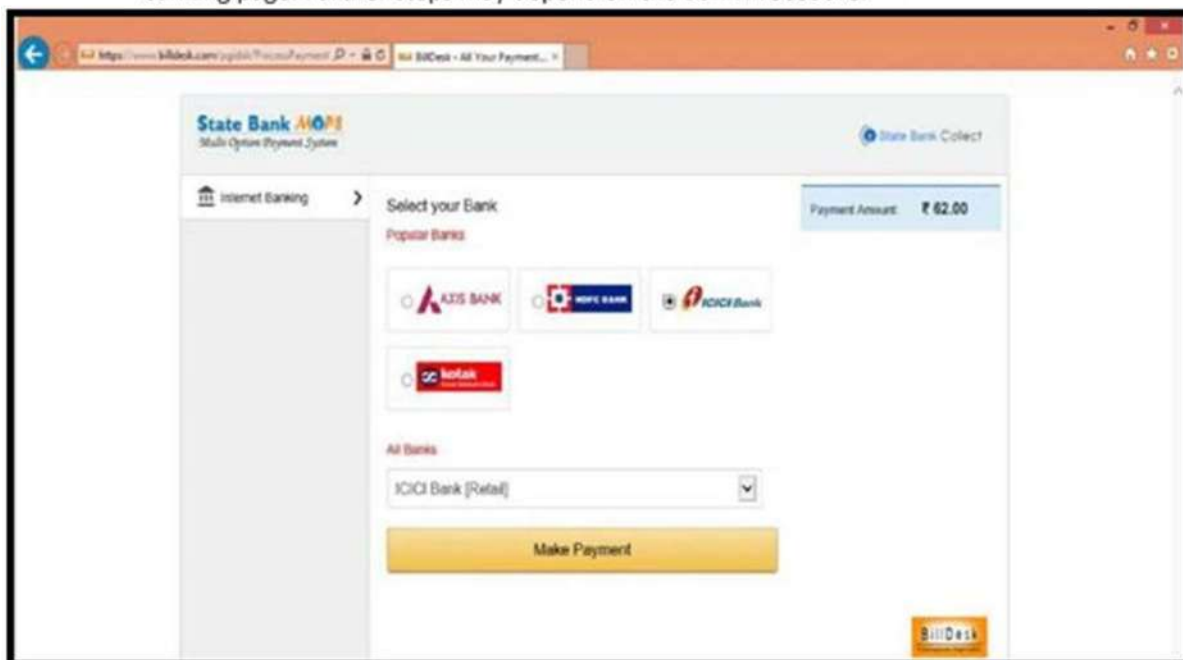

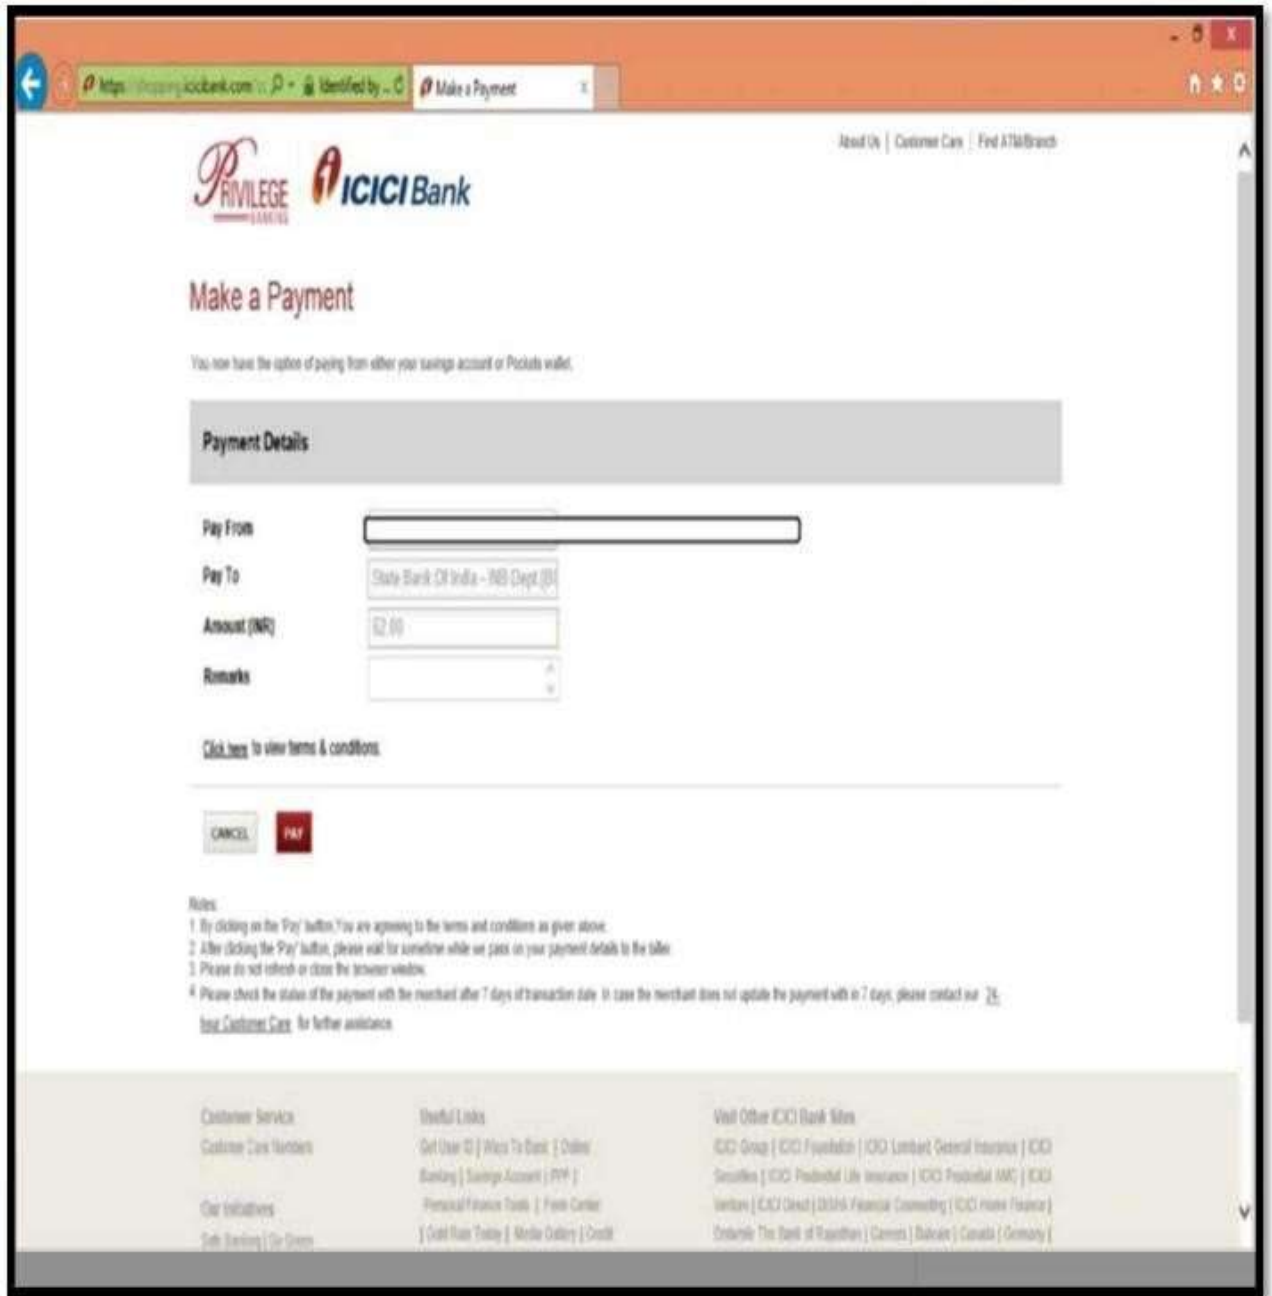

https://paying.icicibank.com/ Identified by ... Make a Payment

About Us | Customer Care | Find ATMs/Branch

PRIVILEGE **ICICI Bank**

Make a Payment

You now have the option of paying from either your savings account or Pockets wallet.

Payment Details

Pay From:

Pay To: State Bank Of India - NBS Dept (B)

Amount (INR): 62.00

Remarks:

[Click here to view terms & conditions.](#)

Notes:

1. By clicking on the 'Pay' button, you are agreeing to the terms and conditions as given above.
2. After clicking the 'Pay' button, please wait for sometime while we pass on your payment details to the bank.
3. Please do not refresh or close the browser window.
4. Please check the status of the payment with the merchant after 7 days of transaction date. In case the merchant does not update the payment with in 7 days, please contact our [24x7 Customer Care](#) for further assistance.

Customer Service
Customer Care Numbers

Useful Links
Get User ID | What To Bank | Online Banking | Savings Account | PPF | Personal Finance Tools | Free Credit | Gold Loan Tracker | Media Gallery | Credit

Visit Other ICICI Bank Sites
ICICI Group | ICICI Foundation | ICICI Lombard General Insurance | ICICI Securities | ICICI Prudential Life Insurance | ICICI Prudential AMC | ICICI Ventures | ICICI Direct | ICICI Financial Consulting | ICICI Home Finance | ICICI The Bank of Transitions | Carrots | Balcony | Canada | Germany |

National Informatics Centre

Payment Gateway




The screenshot shows the 'Confirm Details' page on the ICICI Bank Privilege portal. The page includes the bank's logo and navigation links. The transaction details are as follows:

Details	
Pay From	
Pay To	State Bank Of India - INB Dept.(BILL DESK BPC)
Amount (INR)	52.00
Remarks	

Please enter these details to authorize the transaction

Grid Card



Please enter the following digits of your Grid Card (This will be on the back of your card) for Account Number: 00001501890

One Time Password

OTP has been generated and sent to your registered Mobile Number.



The screenshot shows the 'Payment Successful' page on the ICICI Bank Privilege portal. The page includes the bank's logo and navigation links. The transaction details are as follows:

Payment Successful

Your payment of INR 52.00 has been made successfully to State Bank Of India - INB Dept.(BILL DESK BPC)

Your Merchant Reference Number is MCR028234178

Your Transaction Reference Number is 1448580348

Kindly wait while we pass on your payment confirmation to State Bank Of India - INB Dept.(BILL DESK BPC)

Please Note - For any transaction related queries, please contact the merchant and quote the Merchant Reference Number mentioned above.

National Informatics Centre


Payment Gateway

iii) After, successful payment, system will direct you to payment confirmation page.



iv) As in below, you will receive bank response immediate ly by verifying the payment status, whether Success or not. In case, payment was debited from account and further, Payment Failure is shown, immediately contact the e -Procurement helpdesk, for resolution, before tender closing time.

Click **Next** to go to Bid Preparation details, as in screenshot.

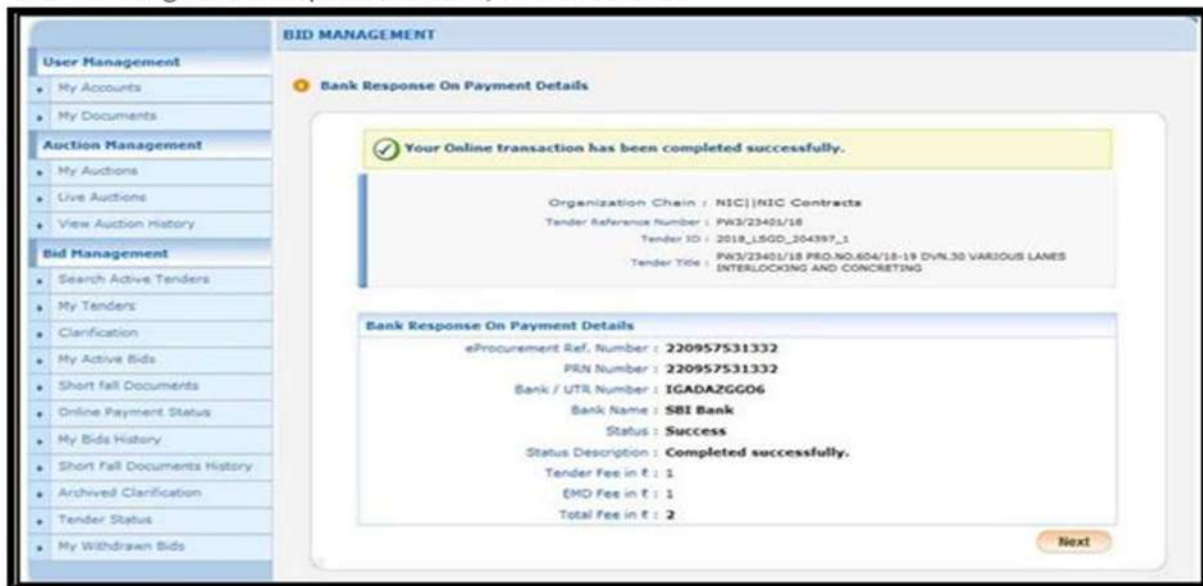

v. Please ensure that the **Pay Online** option is not shown after successful payment, as below, for confirmation. From here, you may proceed with **Encrypt and Upload** to upload tender documents, and further submission process.

BID MANAGEMENT

My Tenders ▾ 2018_KSETH_203918_2 ▸ Transaction Message

Organization Chain : NIC|NIC Contracts
Tender Reference Number : PW3/23401/18
Tender ID : 2018_LSGD_204397_1
Tender Title : PW3/23401/18 PRO.NO.604/18-19 DYN.30 VARIOUS LANES INTERLOCKING AND CONCRETING

Bid Process List

S.No	Bid Process	Action
1	Profile	

Bid Payment Details

S.No	Fee Type	Actual Fee	Exempted Fee	Fee To Be Paid	Paid Fee
1	Tender Fee	1.00 (INR)	0.00	0.00	1.00 (INR)
2	Emd Fee	2.00 (INR)	0.00	0.00	2.00 (INR)

Encrypt&Upload

C) NEFT / RTGS

i) Bidders may choose the type of transaction and proceed for payment.

SBI ONLINE

STATE BANK MULTI OPTION PAYMENT SYSTEM

Please Select Appropriate Card Type To Avoid Failures (C:Credit Card Options/D For Debit Card)

Net Banking

SBI
Bank Charges:
[Click Here](#)

Other Banks
Bank Charges: 55.0
[Click Here](#)

Card Payments

Other Payments Modes

NEFT/RTGS
Bank Charges: 0.0
[Click Here](#)

[Cancel](#)

© State Bank of India Site best viewed in I.E. 10 +, Mozilla 30 +, Google Chrome 30 +

National Informatics Centre

Payment Gateway

ii) Please click the check Box to proceed to the payment and click on the Confirm Button



SBI

Disclaimer Clause

SBI does not have any control over third party websites and accepts no responsibility or liability for any of the material contained on those servers. You will be using such third party websites at your own risk and responsibility and SBI will not be responsible for any loss, damage, costs & charges, direct or indirect incurred by you, arising out of or in connection with your access to the external website or for any deficiency in the products and services of the third party or for the failure or disruption of the website of the third party.


SBI is not in any way liable for the contents of any linked websites or webpages. By integrating with an external website or web-page, SBI shall not be deemed to endorse, recommend, approve, guarantee, indemnify or introduce any third parties or the services/products they provide on their websites. Please note SBI is only facilitating the online transaction and will not be a party to any contractual arrangements entered into between you and the provider of the external website unless otherwise expressly specified or agreed to by SBI. Such external websites are governed by their respective policies.

☐ I have read and accepted the terms and conditions stated above.
(Click Check Box to proceed for payment)

[Confirm](#)

© Copyright SBI

iii) Please ensure that your account has sufficient balance , before proceeding further. After checking the same, Click Confirm button as below, to transfer payment.

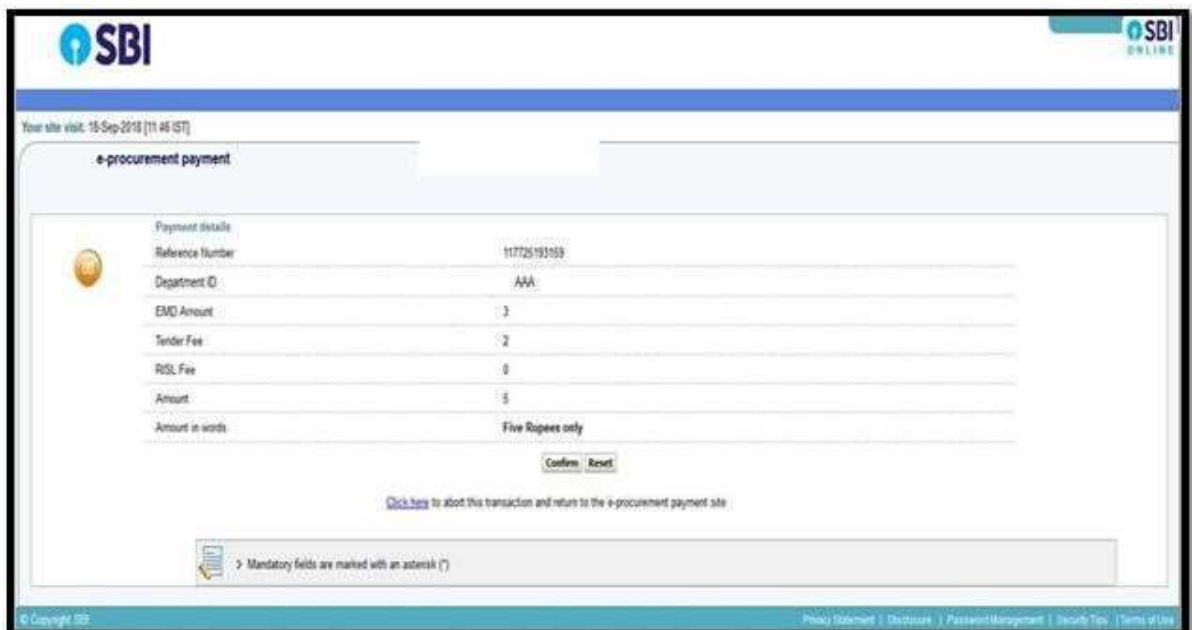

SBI **ONLINE**

Your site visit: 15-Sep-2018 [11:46 IST]

e-procurement payment

Payment details	
Reference Number	117725191509
Department ID	AAA
EMD Amount	3
Tender Fee	2
RSL Fee	0
Amount	5
Amount in words	Five Rupees only

[Confirm](#) [Reset](#)

[Click here](#) to abort this transaction and return to the e-procurement payment site

 > Mandatory fields are marked with an asterisk (*)


© Copyright SBI

[Privacy Statement](#) | [Disclaimers](#) | [Password Management](#) | [Security Tips](#) | [Terms of Use](#)

National Informatics Centre

Payment Gateway

iv) Click Confirm button as below, to transfer payment.

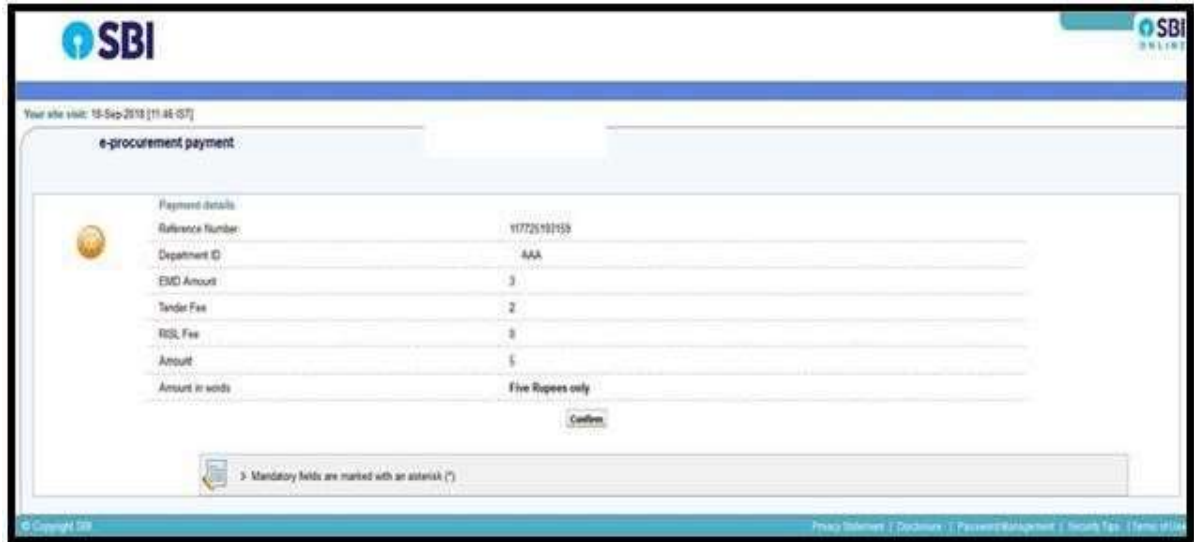

SBI

Your visit: 18-Sep-2018 [11:41:57]

e-procurement payment

Payment details	
Reference Number:	817726101158
Department ID	AAA
EMD Amount	3
Tender Fee	2
TSL Fee	0
Amount	5
Amount in words	Five Rupees only

[Confirm](#)

> Mandatory fields are marked with an asterisk (*)

© Copyright 2018 Privacy Statement | Disclaimer | Password Management | Security Tips | Terms of Use

v) The challan is generated after successful transaction.



SBI

Your visit: 18-Sep-2018 [11:41:57]

e-procurement payment 817726101158 Form

Beneficiary Details	
Beneficiary Account Number (as he entered as it appears)	817726101158
Amount	Rs. 5
Amount in Words	Five Rupees only
Beneficiary Bank	State Bank of India
Beneficiary IFSC Code	SBIN0017516
Name & Address	e-procurement payment
Beneficiary Reference Number	817726101158

TERMS & CONDITIONS:

- The transaction should be within the prescribed time and for the same and conditions specified in tender.
- Please ensure the correctness of details reported while submitting through 817726101158 and first would not be responsible for the transaction reported due to incorrect details reported.
- For 817726101158 transactions, Bank and time at which payment is received in 817726101158 would be relevant for the purpose of determining the time at which payment was received in one or not. Therefore, Bankers should make transactions well in advance so as to ensure that the payment is received well before the payment deadline.
- Bank for which payment is received after closing date time for submission of tender bid would be reported and would not be considered for further processing. The payment would be returned back to the bank account from which the transaction was made.
- Bankers should not report the payment value in a premature period. The transaction for which payment is received before the tender closing date and time would be displayed as 817726101158 in the portal. Therefore Bankers may consider their Bank from which the transaction was made.
- Bankers should ensure that tender document, bid and EMD are received in one single transaction and not separately.
- Bankers should ensure that account no. entered during 817726101158 transaction at any bank counter or Internet banking site is the same as it appears in the beneficiary account details. Bankers should not include the account number.
- For additional information like Bankers name, company name etc. should be entered in the payment system along with account no. for 817726101158 transactions.
- Enter on Tender document the account in 817726101158 and Account Details not allowed and the payment up, as stated in tender and the transaction bid is liable to be rejected.
- Please check 817726101158 for your tendering bid, for your tendering bid.
- Please note that this is only a reference information, firm and not an acknowledgment of receipt.

In case the above points are not followed, the payment may be rejected or delayed and the responsibility shall be on the tenderer.

Disclaimer:

817726101158 may have any content from third party website and accepts no responsibility in liability for any of the material contained on these website. This will be using our third party website at your own risk and responsibility and 817726101158 will not be responsible for any loss, damage, cost or charges, direct or indirect, incurred by you, arising out of or in connection with your access to the external website or for any deficiency in the products and services of the third party or for the failure or disruption of the website of the third party.

817726101158 is not in any way liable for the contents of any linked website or webpage. By registering with an external website or web page, 817726101158 will not be deemed as endorsing, recommending, guaranteeing, indemnifying or rendering any third parties or the services provided by them possible on their website. Please note 817726101158 is only facilitating the online transaction and will not be a party in any contractual arrangements entered into between you and the provider of the external website unless otherwise agreed upon by you. Such external website are governed by their respective policies.

[Click here to view the Privacy Statement](#)
[Click here to view the Terms of Use](#)
[Click here to view the Security Tips](#)

© Copyright 2018 Privacy Statement | Disclaimer | Password Management | Security Tips | Terms of Use



GENERAL CONDITIONS OF CONTRACT

2017

AIRPORTS AUTHORITY OF INDIA

INDEX

Sl. No.	Details of Pages	Page No.
1.	General Guidelines	2
2.	Tender Forms	3 - 4
i)	General Rules and Directions.	5 - 12
ii)	Conditions of Contract	13-15
iii)	Clauses of Contract	16 - 86
iv)	AA I Safety Code	87 - 91
v)	Model Rules	92 - 96
vi)	AAI Contractor's Labour Regulations	97 - 101
vii)	Various Formats to be maintained (Appendix I to XIX)	102 - 135
3.	Proforma of Schedules A to F	136 - 142
4	Annexure to Clause 34 (X)	143 - 144

GENERAL GUIDELINES

1. This book of “General Conditions of Contract” is applicable to both types of tenders i. e. “Percentage Rate Tenders and Item Rate Tenders”. Accordingly, alternative provisions for Conditions Nos. 4, 10 & 12 of the General Rules and Directions are given in this book. The appropriate alternatives will be applicable in specific cases depending on whether this is used for Percentage Rate Tenders or Item RateTenders.
2. Notice Inviting Tender, Schedules A to F, Special Conditions/Specifications and Drawings only will be issued to intending Bidders. The Standard Form will not be issued along with the Tender Documents but the same shall form part of the agreement to be drawn and signed by both parties after acceptance oftender.
3. All blanks are confined to Notice Inviting Tender and Schedules A to F.
4. Authority approving the Notice Inviting Tenders (NIT) shall fill up all the blanks in Notice Inviting Tender and in Schedules B to F before issue of Tenderdocuments.
5. The intending bidders will quote their rates in ScheduleA.
6. The Proforma for registers and Schedules A to F are only for information and guidance. These are not to be filled in the Standard Form. The Schedules with all blanks, duly filled, shall be separately issued to all intendingtenderers.



AIRPORTS AUTHORITY OF INDIA

~~Percentage Rate Tender~~/Item Rate Tender & Contract for Work

Airport : **LBSI Airport, Varanasi.**

Branch: **ELECTRICAL**

Office of: **AGM (E-E)**

- A. Tender for the Work of “**Development of Lal Bahadur Shastri International Airport, Varanasi; SH: SITC of Perimeter Lighting, WDI and Landing T.**” to be submitted/uploaded shall be as per date mentioned in CPP Portal.

As per Critical data sheet

Issued to -----*

Signature of Officer Issuing Documents -----*

Designation -----*

Date of issue -----*

***(ii) Not applicable for e-Tendering**

TENDER

I/We have read and examined the Notice Inviting Tender, Schedule A, B, C, D, E & F, Specifications applicable, Drawings & Designs, General Rules and Directions, Conditions of Contract, Clauses of Contract, Special Conditions, Schedule of Rates & other Documents and Rules referred to in the Conditions of Contract and all other contents in the Tender Document for the work.

I/We hereby tender for the execution of the work specified for the Chairman, Airports Authority of India within the time specified in Schedule 'F', viz., Schedule of Quantities and in accordance in all respects with the referred to in Rule-1 of General Rules and Directions and in Clause 11 of the Conditions of Contract and with such material as are provided for, by and in respects in accordance with, such conditions so far as applicable.

We agree to keep the tender open for Ninety (90) days from the date of opening of financial Bid in 3/2 Bid System and not to make any modifications in its terms and conditions.

I/We undertake and confirm that for eligibility of similar work(s) has / have not been got executed on back to back basis through another Contractor. Further that, if such a violation comes to the notice of AAI, then I/We shall accept the decision of AAI if we are debarred for tendering in AAI in future works. Also, if such a violation comes to the notice of AAI before date of start of work, the Engineer-in-Charge shall be free to forfeit the entire amount of Earnest Money Deposit / Performance Guarantee.

I/We further undertake and confirm that Information/Documents submitted by us are genuine, and if at any stage such Documents/Information found false, then we shall be liable for debarment from tendering in AAI, and any other appropriate legal action.



A sum of **14,58,466.00 (Rupees Fourteen Lakhs Fifty Eight Thousand Four Hundred Sixty-Six Only)** is paid through online through Payment Gateway of CPP Portal or BG* in the format prescribed in Tender Documents as Earnest Money (~~Appendix I C and I D~~). If I/we, fail to furnish the prescribed Performance Bank Guarantee within prescribed period, I/we agree that the said Chairman, AAI or his successors in Office shall without prejudice to any other right or remedy, be at liberty to take appropriate action as per terms of Contract. Further, if I/we fail to commence work as specified, I/we agree that Chairman, AAI or his successors in office shall without prejudice to any other right or remedy available in law, be at liberty to forfeit the said Earnest Money absolutely, otherwise the said Earnest Money shall be retained by AAI towards Security Deposit to execute all the works referred to in the tender documents upon the terms and conditions contained or referred to therein and to carry out such deviations as may be ordered, up-to maximum of the percentage mentioned in Schedule 'F' and those in excess of that limit at the rates to be determined in accordance with the provision contained in Clause 12.2 and 12.3 of the tender form. Further, I/We agree that in case of forfeiture of Earnest Money or Performance Guarantee or both Earnest Money & Performance Guarantee as aforesaid, I/We shall be debarred for participation in the re-tendering process of the work.

I/We hereby declare that I/we shall treat the tender documents, drawings and other records connected with the work as secret/confidential documents and shall not communicate information/derived there from to any person other than a person to whom I/we am/are authorized to communicate the same or use the information in any manner prejudicial to the safety of the State.

(* To be deleted which are not applicable)

Date: _____ Signatures of Contractor :

Witness: _____ Postal Address:

Occupation: _____

ACCEPTANCE

The above tender (as modified by you as provided in the letters mentioned hereunder) is accepted by competent authority on behalf of the Chairman, Airports Authority of India for sum of Rs. _____ (Rupees _____ only).

The letters referred to below shall form part of this Contract Agreement:-

- (i)
- (ii)
- (i)

For & on behalf of Chairman,
Airports Authority of India

Signature-----

Designation-----

Date-----

AIRPORTS AUTHORITY OF INDIA

General Rules & Directions

1.	General Rules & Directions	All work proposed for execution by Contract are notified in a form of invitation to tender pasted in public places/CPP Portal and signed by the officer inviting tender or by publication in Newspapers and posted on AAI web-site and CPP Portal http://etenders.gov.in and www.aai.aero (for reference only). This form will state the work to be carried out, as well as the date for submitting and opening tenders and the time allowed for carrying out the work, also the amount of earnest money to be deposited with the tender, and the amount of the security deposit and Performance guarantee to be deposited by the successful tenderer and the percentage, if any, to be deducted from bills. Copies of the specifications, designs and drawings and any other documents required in connection with the work signed for the purpose of identification by the officer inviting tender shall also be open for inspection by the Contractor at the office of Officer inviting tender during office hours.
2.		In the event of the e-tender being submitted by a firm, it must be digitally signed. Such tender will be treated as signed tender. For physical tender it must be signed separately by each partner thereof or in the event of the absence of any partner, it must be signed on his behalf by a person holding a power-of-attorney authorizing him to do so, such power of attorney to be produced with the tender, and it must disclose that the firm is duly registered under the Indian Partnership Act, 1952.
2. (A)		In case of the tender submitted by a Joint Venture / Consortium, a copy of joint venture / consortium agreement in the specified Proforma defining the lead partner should be submitted. The lead partner shall sign all the documents in respect of the works. The documents signed by any other person or firm other than the lead partner shall not be entertained.
3.		Receipts for payment made on account of work, when executed by a firm, must also be signed by all the partners, except where Contractors are described in their tender as a firm, in which case the receipts must be signed in the name of the firm by one of the partners, or by some other person having due authority to give effectual receipts for the firm. Bank details shall be furnished by the firm through an application duly signed by all partners for payment to the firm through bank transfer.
4.	Applicable for Item Rate Tender only.	Any person who submits a tender shall fill up the usual printed form, stating at what rate he is willing to undertake each item of the work. Tenderers, which propose any alteration in the work specified in the said form of invitation to tender, or in the time allowed for carrying out the work, or which contain any other conditions of any sort, including conditional rebates, will be summarily rejected. No single tender shall include more than one work, but Contractors who wish to tender for two or more works shall submit separate tender for each. Tender shall have the name and number of the works to which they refer, written on the envelopes. The rate(s) must be quoted in decimal coinage. Amount must be quoted in full Rupees by ignoring 50 paise and considering more than 50 paise as Rupee one. In case the lowest tendered amount (worked out on the basis of quoted rate of Individual items) of two or more Contractors is same, then such lowest Contractors will be asked to submit revised offer quoting rate of each item of the Schedule of quantity for all sub sections/sub heads as the case may be, but the revised quoted rate of each item of Schedule of quantity for all sub sections/sub Heads should not be higher than their respective original rate quoted already at the time of submission of tender. The lowest tender shall be decided on the basis



		of revised offer.
		If the revised tendered amount (worked out on the basis of quoted rate of individual items) of two or more Contractors received in revised offer is again found to be equal, then the lowest tender, among such Contractors, shall be decided by draw of lots in the presence of Jt. GM (Engg)/DGM (Engg)/AGM (Engg)/Sr Manager (Engg) in-Charge of major and minor component(s) work and the lowest Contractors those have quoted equal amount of their tenders. In case of any such lowest Contractor in his revised offer quotes rate of any item more than their respective original rate quoted earlier at the time of submission of tender, then such revised offer shall be treated invalid. Such case of revised offer of the lowest Contractor or case of refusal to submit revised offer by the lowest Contractor shall be treated as withdrawal of his tender before acceptance and 50% of his earnest money shall be forfeited. In case all the lowest Contractors those have same tendered amount (as a result of their quoted rate of individual items), refuse to submit revised offers, then tenders are to be recalled after forfeiting 50% of EMD of each lowest Contractors. Contractor, whose earnest money is forfeited because of non-submission of revised offer, or quoting higher revised rate(s) of any item(s) than their respective original rate quoted already at the time of submission of his bid shall not be allowed to participate in the retendering process of the work. Note: Till the time software supports the above provisions, revised offers from tenderers forming the tie shall be obtained and procedure prescribed for "Restricted call of tenders" shall be adopted (for e-tenders).



4. (A)	Applicable for Percentage Rate Tender only.	In case of Percentage Rate Tenders, tenderer shall fill up the usual printed form, stating at what percentage below/above (in figures as well as in words) the total estimated cost given in Schedule of Quantities at Schedule A, he will be willing to execute the work. The tender submitted shall be treated as invalid if; 1. The Contractor does not quote percentage above/below on the total amount of tender or any section/sub head of the tender. 2. The percentage above/below is not quoted in figures & words both on the total amount of tender or any section/sub head of the tender. 3. The percentage quoted above/below is different in figures and words on the total amount of tender or any section/sub head of the tender. Tenders, which propose any alteration in the work specified in the said form of invitation to tender, or in the time allowed for carrying out the work, or which contain any other conditions of any sort including conditional rebates, will be summarily rejected. No single tender shall include more than one work, but Contractors who wish to tender for two or more works shall submit separate tender for each. Tender shall have the name and number of the works to which they refer, written on the envelopes. In case the lowest tendered amount (estimated cost + amount worked on the basis of percentage above/below) of two or more bidders is same, such lowest bidders will be asked to submit revised offer in the form of letter mentioning percentage above/below on estimated cost of tender including all sub sections/sub heads as the case may be, but the revised percentage quoted above/below on tendered cost or on each sub section/sub head should not be higher than the percentage quoted at the time of submission of tender. The lowest tender shall be decided on the basis of revised offers. In case any of such Contractor refuses to submit revised offer, then it shall be treated as withdrawal of his tender before acceptance and 50% of earnest money shall be forfeited. If the revised tendered amount of two or more bidders received in revised offer is again found to be equal, the lowest tender, among such bidders, shall be decided by draw of lots in the presence of Jt. GM (Engg)/DGM (Engg)/AGM (Engg)/Sr
--------	--	---

		Manager (Engg) in Charge of work & the lowest bidders those who have quoted equal amount of their tenders. In case all the lowest bidders those have quoted same tendered amount, refuse to submit revised offers, then tenders are to be recalled after forfeiting 50% of EMD of each bidder. Bidders, whose earnest money is forfeited because of non submission of revised offer, shall not be allowed to participate in the re-tendering process of the work. Note: Till the time software supports the above provisions, revised offers from tenderers forming the tie shall be obtained and procedure prescribed for “Restricted call of tenders” shall be adopted.
4. (B)		In case the lowest tendered amount (estimated cost $\pm$ amount worked on the basis of percentage above/below) of two or more Contractor is same, such lowest Contractor will be asked to submit sealed revised offer in the form of letter mentioning percentage above/below on estimated cost of tender including all sub section/sub heads as the case may be, but the revised percentage quoted above/below on tendered cost or on each sub section/sub head should not be higher than the percentage quoted at the time of submission of tender. The lowest tender shall be decided on the basis of revised offers. In case any of such Contractor refuses to submit revised offer, then it shall be treated as withdrawal of his tender before acceptance and 50% of earnest money shall be forfeited. If the revised tendered amount of two more Contractors received in revised offers is again found to be equal, the lowest tender, among such Contractor, shall be decided by draw of lots in the presence of Jt.GM (Engg)/DGM (Engg)/AGM (Engg)/Sr. Manager (Engg) in Charge of major & minor component(s) of work & the lowest bidders those who have quoted same tendered amount of their tenders. In case all the lowest Contractors those have quoted same tendered amount, refuse to submit revised offers, then tenders are to be recalled after forfeiting 50% of EMD of each bidder. Bidders, whose earnest money is forfeited because of non submission of revised offer, shall not be allowed to participate in the re-tendering process of the work.
5.		The officer inviting tender or his duly authorized representative, will open tenders in the presence of any intending bidders who may be present at the time, and will enter the amounts of the several tenders in a comparative statement in a suitable form. In the event of a tender being accepted, a receipt for the earnest money shall thereupon be given to the Contractor who shall thereupon for the purpose of identification sign copies of the specifications and other documents mentioned in Rule -I. In the event of a tender being rejected, the earnest money shall thereupon be returned to the Contractor remitting the same, without any interest.
6.		The officer inviting tenders shall have the right of rejecting all or any of the tenders and will not be bound to accept the lowest or any other tender.
7.		The receipt of an accountant or clerk for any money paid by the bidder towards tender fee will not be considered as any acknowledgement or payment to the officer inviting tender and the bidder shall be responsible for seeing that he procures a receipt signed by the officer inviting tender or a duly authorized cashier.
8.		The memorandum of work tendered for and the Schedule of materials to be supplied by the department and their issue rates, shall be filled and completed in the office of the officer inviting tender before the tender form is issued. If a form is issued to an intending bidder without having been so filled in and incomplete, he shall request the officer to have this done before he completes and delivers his tender.

9.		The bidders shall sign a declaration under the Officials Secret Act 1923, for maintaining secrecy of the tender documents, drawings or other records connected with the work given to them. The unsuccessful bidders shall return all the drawings given to them.
9(A).		Use of correcting fluid anywhere in tender document is not permitted. Such tender is liable for rejection. If there is any correction it should be cut with a straight line and should be initialed and cello tape to be provided on all the rates quoted in case of physical tenders.
10.	Applicable for Item Rate Tender Only.	In the case of Item Rate Tenders, only rates quoted shall be considered. Any tender containing percentage below / above the rates quoted is liable to be rejected. Rates quoted by the bidder in item rate tender in figures and words shall be accurately filled in so that there is no discrepancy in the rates written in figures and words. However, i. if a discrepancy is found between rates in figures and in words, then the rates which correspond with the amount worked out by the bidder shall unless otherwise proved be taken as correct. ii. If the amount of an item is not worked out by the bidder or it does not correspond with the rates written either in figures or in words, then the rates quoted by the Contractor in words shall be taken as correct. iii. Where the rates quoted by the bidder in figures and in words tally, but the amount is not worked out correctly, the rates quoted by the Contractor will unless otherwise proved be taken as correct and not the amount. iv. In event no rate has been quoted for any item(s) leaving space blank both in figure(s) and word(s) or cancelled the quoted rate in figure(s), and word(s) but the amount corresponding to the item(s) is worked out by the bidder and added to the grand total, then rate(s) of the item(s) shall be derived from the amount(s) quoted by the Contractor against such item(s). v. In event no rate has been quoted for any item(s), leaving space both in figure(s), word(s), and amount blank, it will be presumed that the bidder has included the cost of this/these item(s) in other items and rate for such item(s) will be considered as zero and work will be required to be executed accordingly. vi. Sub Para i to iv above shall not be applicable in case of e-tendering.
	Applicable for percentage rate tender only.	In case of percentage Rate Tenders only percentage quoted shall be considered. Any tender containing item rates is liable to be rejected Percentage quoted by the bidder in percentage rate tender shall be accurately filled in figures and words, so that there is no discrepancy. However, if the bidder has worked out the amount of the tender and if any discrepancy is found in the percentage quoted in words and figures, i. The percentage which corresponds with the amount worked out by the bidder shall, unless otherwise proved, be taken as correct. ii. If the amount of the tender is not worked out by the bidder or it does not correspond with the percentage written either in figures or in words, then the percentage quoted by the bidder in words shall be taken as correct. iii. Where the percentage quoted by the bidder in figures and in words tally but the amount is not worked out correctly, the percentage quoted by the bidder will, unless otherwise proved, be taken as correct and not the amount.
11.		In the case of any tender where unit rate of any item / items appear unrealistic, such tender will be considered as unbalanced and in case the tenderer is unable to provide satisfactory explanation, such a tender is liable to be disqualified and rejected.
12.	Applicable for Item Rate Tender Only.	All rates shall be quoted on the tender form. The amount for each item should be worked out and requisite totals given. Special care should be taken to write the rates in figures as well as in words and the amount in figures only, in such a way that interpolation is not possible. The total amount should be written both in

		figures and in words. In case of figures, the word 'Rs' should be written before the figure of rupees and word 'P' after the decimal figures, e.g. 'Rs. 2.15 P' and in case of words, the word 'Rupees' should precede and the word 'Paise' should be written at the end. Unless the rate is in whole rupees and followed by the word 'only' it should invariably be up to two decimal places. While quoting the rate in Schedule of quantities, the word 'only' should be written closely following the amount and it should not be written in the next line.
12(A).	Applicable for percentage rate tender only.	In Percentage Rate Tender, the tenderer shall quote percentage below / above (in figures as well as in words) at which he will be willing to execute the work. He shall also work out the total amount of his offer and the same should be written in figures as well as in words in such a way that no interpolation is possible. In case of figures, the word 'Rs' should be written before the figure of rupees and word 'P' after the decimal figures, e.g. 'Rs. 2.15 P' and in case of words, the word 'Rupees' should precede and the word 'Paise' should be written at the end. (quoting of rates in Paise is not applicable in e-tenders)
13	Acceptance of abnormally low quoted bid	Deleted
14		i. The bidder, whose tender is accepted, will be required to furnish of 5% (Five Percent) of the tendered amount within the period specified in Schedule F. This guarantee shall be in the form of Fixed Deposit Receipts or Guarantee Bonds of any Scheduled Bank but not co-operative or Gramin Bank, in accordance with the prescribed form, provided confirmatory advice is enclosed. ii. The bidder, whose tender is accepted, will also be required to furnish by way of Security Deposit for the fulfillment of his Contract, an amount equal to 10% of the Contract amount of the work. iii. In works where condition of submission of Performance Guarantee is not applicable, the security deposit @ 10% of the tendered value shall be deducted. iv. The Security deposit (under ii & iii above) will be collected by deductions from the running bills of the Contractor at the rates mentioned above and the earnest money deposited at the time of tenders, will be treated as a part of the Security Deposit. v. Security deposit will also be accepted in form of Fixed Deposit Receipts / Guarantee Bonds of any Scheduled Bank but not co-operative or Gramin Bank in accordance with the prescribed form, provided confirmatory advice is enclosed. vi. The contractor shall submit an irrevocable additional performance security in the form of an irrevocable Insurance Surety bond, demand draft, bank guarantee issued from Scheduled Commercial Bank (i.e Indian or Foreign Banks included in the Second Schedule of Reserve Bank of India Act, 1934 excluding Co-Operative / Regional Rural Banks, if the Bid price offered by the selected bidder is lower than 10% of the estimated cost put to tender. This clause shall be binding and enforceable in relation to all works, irrespective of their nature, scope, or value. Additional Performance Security Amount and Treatment- The additional performance security shall be calculated as below- (i) Where the bid price is below 10% but not below 20% of the project cost put to bid, the additional performance security percentage shall be incremented by 0.25% for every percentage of bid price below 10% of the



		project cost put to bid starting at 11% with the additional bid performance security being 0.25% and this additional performance security percentage shall be applied on the bid price; (ii) Where the bid price is below 20% but not below 25% of the project cost put to bid, the additional performance security percentage shall be incremented by 0.50% for every percentage of bid price below 20% of the project cost put to bid starting at 21% with the additional bid performance security being 0.50% and this additional performance security percentage shall be applied on the bid price; (iii) Where the bid price is below 25% but not below 30% of the project cost put to bid, the additional performance security percentage shall be incremented by 0.75% for every percentage of bid price below 25% of the project cost put to bid starting at 26% with the additional bid performance security being 0.75% and this additional performance security percentage shall be applied on the bid price; (iv) Where the bid price is below 30%, the additional performance security percentage shall be incremented by 1% for every percentage of bid price below 30% of the project cost put to bid starting at 31% with the additional bid performance security percentage shall be applied on the bid price; (v) The additional performance security percentage shall be rounded off to the next lower percentage based on whether the decimal point of the percentage of bid price is below 0.5% or next higher percentage based on whether the decimal point to the percentage of bid price is 0.5% or more. (vi) All matters pertaining to validity, extension, claims, forfeiture, and any other conditions in relation to the additional performance security shall be governed by the provisions of clause 1: Performance Security.
15.		On acceptance of the tender, the name of the accredited representative(s) of the Contractor who would be responsible for taking instructions from the Engineer-in-Charge shall be communicated in writing to the Engineer-in-Charge.
16.		1. Rates to be quoted by the Parties should be inclusive of all Taxes, Duties, CESS, Fee, Royalty Charges etc., levied under any Statute but Exclusive of GST for all the Items. 2. However GST, as applicable, shall be paid to the Contractor, for any taxable Supply / Services / Construction rendered by the Agency to AAI, against a valid GST Invoice as per Terms And Conditions of the Contract. 3. In case Supplies / Services / Works involve Imports, the same should be identified separately. Basic Custom Duty & IGST will be paid directly by AAI by utilizing EPCG License/ Duty Credit Scrip under Service Export from India Scheme (SEIS) of Govt. of India.
17.		The Contractor/Bidder shall give a List of AAI Employees related to him.
18.		The tender for the work shall not be witnessed by a Contractor or Contractors/ bidders who himself / themselves has / have tendered or who may and has / have tendered for the same work. Failure to observe this condition would render tenders of the Contractors tendering, as well as witnessing the tender, liable to summary rejection.

GENERAL RULES & DIRECTIONS



19.		The tender for composite work includes, in addition to building work, all other works such as sanitary and water supply installations, drainage installation, electrical work, horticulture work, roads and paths etc. The tenderer apart from being a registered Contractor (B&R) of appropriate class, must associate himself with agencies of appropriate class which are eligible to tender for sanitary and water supply drainage, electrical and horticulture works in the composite tender.
20.		The Contractor/ bidder shall submit list of works completed in last 5 years as well as which are in hand (in progress) in the following format in Envelope II for assessing bidding capacity of the bidders:-

NAME OF WORK	NAME AND PARTICULARS OF OFFICE WHERE WORK WAS/IS BEING EXECUTED	VALUE OF WORK	DATE OF COMPLETION/ POSITION OF WORKS IN-PROGRESS	REMARKS
1	2	3	4	5

21		The Contractor/bidder shall comply with the provisions of the Apprentices Act 1961, and the rules and orders issued there under from time to time. If he fails to do so, his failure will be a breach of the Contract and the Executive Director (Engg.) may in his discretion, without prejudice to any other right or remedy available in law, cancel the Contract. The Contractor shall also be liable for any pecuniary liability arising on account of any violation by him of the provisions of the said Act.
22		If complete site is available for work, the work shall be completed in the manner specified here in special condition of Contract and NIT specifications. Note: In such case para 23 below may be deleted by NIT approving authority
23		If complete site is not available for taking up the work, the same shall be made available in phases. The scope of work covered in each phase, time for completion of work in each phase and methodology of taking over completed work in phased manner has been specified under special conditions of Contract. The completion time for each phase shall be applicable as indicated in tender documents. The work shall also be taken over by Engineer in Charge in phases. The warranty for the works executed in each phase shall be applied independently w.e.f. date of completion /taking over of individual phase. Note: In such case para 22 above may be deleted by NIT approving authority

CONDITIONS OF CONTRACT

DEFINITIONS:

1.		The Contract means the Documents forming the Tender and Acceptance thereof and the formal Agreement / Agreements executed between the Competent Authority(s) on behalf of the Chairman, Airports Authority of India and the Contractor, together with the Documents referred to therein including these Conditions, the Specifications, Designs, Drawings and Instructions issued from time to time by the Engineer-in-Charge and all these Documents taken together, shall be deemed to form One Contract / Two Contracts and shall be complimentary to one another. Contractor has to sign Two Agreements, one consisting BOQ for Civil Works and another one for SITC and O&M / AMC / AICMC Part. Engineer-in-charge could be common for both the agreements. Separate Invoices for the Civil / Construction Works and SITC / O&M / AICMC / AMC Works have to be raised by the Agency referring to the respective Agreements to facilitate AAI to claim Input Tax Credit on such SITC / O&M / AICMC / AMC Works as mentioned in Schedule 'F' Para 2 (v).
2.		In the Contract, the following expressions shall, unless the context otherwise requires, have the meanings, hereby respectively assigned to them :-
		i. The expression works or work shall, unless there be something either in the subject or context repugnant to such construction, be construed and taken to mean the works by or by virtue of the Contract Contracted to be executed whether temporary or permanent, and whether original, altered, substituted or additional. ii. The site shall mean the land / or other places on, into or through which work is to be executed under the Contract or any adjacent land, path or street through which work is to be executed under the Contract or any adjacent land, path or street which may be allotted or used for the purpose of carrying out the Contract. iii. The Contractor/tenderer/bidder shall mean the individual, firm or company whether incorporated or not, Joint Venture / Consortium undertaking the works and shall include the legal personal representative of such individual or the persons constituting such firm or company, or the successors of such firm or company and the permitted assignees of such individual, firm or company. iv. The Chairman means the Chairman Airports Authority of India and his Successors. v. The Engineer-in-Charge means the Engineering Officer who shall supervise and be in-charge of the work and who shall sign the Contract on behalf of the Chairman, Airports Authority of India as mentioned in Schedule 'F' hereunder. vi. AAI or Airports Authority of India shall mean the Chairman Airports Authority of India. vii. The terms Member(Planning) means the head of Department of Engineering, Airports Authority of India. viii. Accepting Authority shall mean the authority mentioned in Schedule 'F'. ix. Excepted Risk are risks due to riots (other than those on account of Contractor's employees), war (whether declared or not) invasion, act of foreign enemies, hostilities, civil war, rebellion revolution, insurrection, terrorism, military or usurped power, any acts of Airports Authority of India, damages from aircraft, acts of God, such as earthquake, lightening and unprecedented floods, and other causes over which the Contractor has no control and accepted as such by the Accepting Authority or causes solely due to use or occupation by Airports Authority of India of the part of the works in respect of which a certificate of completion has been issued or a cause solely due to Airports Authority of India's faulty design of works. x. Market Rate shall be the rate as decided by the Engineer-in-Charge on the basis of the prevailing cost of materials and labour at the site where the work is to be executed plus the percentage mentioned in Schedule 'F' to cover, all overheads and profits. Provided that no extra overheads and profits shall be payable on the parts of works assigned to other Agency(s) by the Contractor as per terms of Contract.

		xi. Schedule(s) referred to in these conditions shall mean the relevant Schedule(s) annexed to the tender papers or the standard Schedule of Rates of the government mentioned in Schedule 'F' hereunder, with the amendments thereto issued up-to the date of receipt of the tender. xii. Department means Airports Authority of India, which invites tender on behalf of Chairman, Airports Authority of India. xiii. Tendered value means the value of the entire work as stipulated in the letter of award.
3.	Scope and Performance	Where the context so requires, words imparting the singular only also include the plural and vice versa. Any reference to masculine gender shall whenever required include feminine gender and vice versa.
4.		Headings and Marginal notes to these General Conditions of Contract shall not be deemed to form part thereof or be taken into consideration in the interpretation or construction thereof or of the Contract.
5.		The Contractor shall be furnished, free of cost one certified copy of the Contract documents except standard specifications, Schedule of Rates and such other printed and published documents, together with all drawings as may be forming part of the tender papers. None of these documents shall be used for any purpose other than that of this Contract.
6.	Works to be carried out	The work to be carried out under the Contract shall, except as otherwise provided in these conditions, include all labour, materials, tools, plants, equipment and transport which may be required in preparation of and for and in the full and entire execution and completion of the works. The descriptions given in the Schedule of Quantities (Schedule – A) shall, unless otherwise stated, be held to include wastage on materials, carriage and cartage, carrying and return of empties, hoisting, setting, fitting and fixing in position and all other labours necessary in and for the full and entire execution and completion of the work as aforesaid in accordance with good practice and recognized principles.
7.	Sufficiency of Tender	The Contractor shall be deemed to have satisfied himself before tendering as to the correctness and sufficiency of his tender for the works and of the rates and prices quoted in the Schedule of Quantities, which rates and prices shall, except as otherwise provided, cover all his obligations under the Contract and all matters and things necessary for the proper completion and maintenance of the works.
8.	Discrepancies and Adjustment of Errors	The several documents forming the Contract are to be taken as mutually explanatory of one another, detailed drawings being followed in preference to small scale drawing and figured dimensions in preference to scale and special conditions in preference to General Conditions.
8.1		In the case of discrepancy between the Schedule of Quantities, the Specifications and / or the Drawings, the following order of preference shall be observed :-
		i. Description of Schedule of Quantities. ii. Particular/Technical Specification and Special Condition, if any. iii. Drawings. iv. C P W D Specifications. v. Indian Standard Specifications of B I S./ IRC Code of Practice / ASTM Standards. vi. Sound Engineering Practice as directed by the Engineer-in-Charge, whose decision in this regard shall be final and binding on the Contractor.
8.2		If there are varying or conflicting provisions made in any one document forming part of the Contract, the Accepting Authority shall be the deciding authority with regard to the intention of the Document and his decision shall be final and binding on the Contractor.



8.3		Any error in description, quantity or rate in Schedule of Quantities or any omission therefrom shall not vitiate the Contract or release the Contractor from the execution of the whole or any part of the works comprised therein according to drawings and specifications or from any of his obligations under the Contract.
8.4	Payment for similar items with different quoted rates in different subheads of the Contract agreement	If the Contractor has quoted different rates for the same item appearing in two or more subheads, then the lowest of the rates quoted shall only be considered for payments during execution of work. In case of deviation of quantity of such item, payments shall be made at the lowest quoted rate for quantity executed up-to the deviation limit specified in the Contract. Beyond the deviation limit the rate shall be derived as per relevant Contract provision.
9.	Reverse Auction for purchase tenders	AAI may opt for reverse auction in case of purchase tender if value of supplies put to tender is more than Rs.2Crores.
10.	Signing of Contract	The successful Tenderer / Contractor, on acceptance of his tender by the Accepting Authority, shall within 15 days from the stipulated date of start of the work, shall sign either Single or Two Agreements , as the case may be, one consisting BOQ for Civil Works and another one for SITC and O&M / AMC / AICMC Part.
i)		i. The Notice Inviting Tender, all the documents including drawings, if any, forming the tender as issued at the time of invitation of tender and acceptance thereof together with any correspondence leading thereto. ii. Standard AAI Form as mentioned in Schedule 'F' consisting of: - Various standard Clauses with corrections up-to the date stipulated in Schedule 'F' alongwith Annexure thereto. - AAI Safety Code. - Model Rules for the protection of health, sanitary arrangements for workers employed by AAI or its Contractors. - AAI Contractor's Labour Regulations. - List of Acts and omissions for which fines can be imposed. iii. No payment for the work done will be made unless Contract in form of agreement is signed by the Contractor.

CLAUSES OF CONTRACT

CLAUSE 1

	Performance Guarantee	This Clause is applicable for the works for which the estimated cost put to tender is more than Rs.5 Crores.
		i. The Contractor shall submit an irrevocable Performance Guarantee of 5% (Five percent) of the Tendered amount in addition to other deposits mentioned elsewhere in the Contract for his proper performance of the Contract agreement, (not withstanding and/or without prejudice to any other provisions in the Contract) within period specified in Schedule 'F' from the date of issue of award letter. This guarantee shall be in the form of Insurance surety Bonds, Account Payee Demand Draft or Bank Guarantee (including e-Bank Guarantee) from any of the Scheduled Commercial Banks (i.e. Indian or Foreign Banks included in the Second Schedule of Reserve Bank of India Act, 1934 excluding Co-operative / Regional Rural Banks) in accordance with the form annexed hereto. (Appendix-IA and ID).
		ii. Performance guarantee should be furnished within 30 days of issue of letter of intent. The award letter will be issued on receipt of Performance guarantee and contract agreement shall be signed within 10 days of issue of award letter. In case the Contractor fails to deposit performance guarantee within the stipulated period the tender shall stand cancelled without any notice. Further, EMD (Earnest money deposit) shall be forfeited, and the contractor shall be liable for debarment up to a period of Two (02) years.
		iii. The Performance Guarantee shall be initially valid up to the stipulated date of completion plus 180 days beyond that. In case the time for completion of work gets enlarged, the Contractor shall get the validity of Performance Guarantee extended to cover such enlarged time for completion of work. After recording of the completion certificate for the work by the competent authority, the performance guarantee shall be returned to the Contractor, without any interest. However, in case of Contracts involving maintenance of buildings and services / any other work thereafter, 50% of Performance Guarantee shall be retained as Security Deposit as per Contract conditions. The same shall be returned on successful completion of commitment yearwise proportionately.
		iv. The Engineer-in-Charge shall not make a claim under the performance guarantee except for amounts to which the AAI is entitled under the Contract (not withstanding and/or without prejudice to any other provisions in the Contract agreement) in the event of: - Failure by the Contractor to extend the validity of the Performance Guarantee as described herein above, in which event the Engineer-in-Charge may claim the full amount of the Performance Guarantee. - Failure by the Contractor to pay the Chairman, AAI any amount due, either as agreed by the Contractor or determined under any of the Clauses/Conditions of the agreement, within 30 days of the service of notice to this effect by Engineer-in-Charge.
		v. In the event of the Contract being determined or rescinded under provision of any of the Clause/Condition of the agreement, the performance guarantee shall stand forfeited in full and shall be absolutely at the disposal of the Chairman, AAI.

CLAUSE 1 A

	Recovery of Security Deposit	The person/persons whose tender(s) may be accepted (hereinafter called the Contractor) shall permit AAI at the time of making any payment to him for work done under the Contract to deduct a sum at the rate of 5% of the gross amount of each running and final bill till the sum deducted will amount to Security deposit of 5% of the tendered value of the work. Such deductions will be made and held by AAI by way of Security Deposit unless he/they has/have deposited the amount of Security at the rate mentioned above in the form of Bank Guarantee (including e-bank Guarantee) from any of the Commercial Bank (i.e Indian or Foreign banks included in the Second Schedule of Reserve bank of India Act, 1943 excluding Co-operative / Regional Rural Banks). In case a Guarantee Bonds of any Bank is furnished by the Contractor to the AAI as part of the security deposit and the Bank is unable to make payment against the said Guarantee Bond, the loss caused thereby shall fall on the Contractor and the Contractor shall forthwith on demand furnish additional security to the AAI to make good the deficit. In works where condition of submission of performance guarantee is not applicable, the security deposit at the rate of 10% (Ten Percent) of gross amount of each running bill shall be deducted instead of 5%, till the sum will amount to security deposit of 10% of the Contract value of work. Other conditions shall remain same as stated above. All compensations or the other sums of money payable by the Contractor under the terms of this Contract may be deducted from, or paid by the sale of a sufficient part of his security deposit or from the interest arising therefrom, or from any sums which may be due to or may become due to the Contractor by AAI on any account whatsoever and in the event of his Security Deposit being reduced by reason of any such deductions or sale as aforesaid, the Contractor shall within 10 days make good in fixed deposit receipts, Insurance surety Bonds, Account Payee Demand Draft or bank Guarantee from any of the Commercial Bank (if deposited for more than 12 months) endorsed in favour of the Airports Authority of India, any sum or sums which may have been deducted from, or raised by sale of his security deposit or any part thereof. The security deposit shall be collected from the running bills and the running bill of the Contractor at the rates mentioned above. The security deposit as deducted above can be released against bank guarantee issued by any Commercial Bank (Indian or Foreign Banks included in the Second Schedule or Reserve bank of India Act, 1943 excluding Co-Operative / Regional Rural Banks), on its accumulations to a minimum of Rs. 5 lakh subject to the condition that amount of such bank guarantee, except last one, shall not be less than Rs. 5lakh. Note 1: Provided further that the validity of Bank Guarantee shall be in conformity with provisions contained in the Clause 17 which shall be extended from time to time depending upon extension of Contract under provision of Clause 2 & Clause 5. Note 2: Note 1 above shall be applicable for both Clause 1 and 1 A.
--	--	---

CLAUSE 1 B

	Additional Performance Security	The contractor shall submit an irrevocable additional performance security in the form of an irrevocable Insurance Surety bond, demand draft, bank guarantee issue from Scheduled Commercial Bank (i.e. Indian or Foreign Banks included in the Second Schedule of Reserve Bank of India Act, 1934 excluding co-operative / regional Rural Banks, if the Bid Price offered by the selected bidder is lower than 10% of the estimated cost put to tender. This clause shall be binding and enforceable in relation to all works, irrespective of their nature, scope, or value. Additional Performance Security Amount and Treatment – The additional performance security shall be calculated as below – (i) Where the bid price is below 10% but not below 20% of the project cost put to bid, the additional performance security percentage shall be incremented by 0.25% for every percentage of bid price below 10% of the project cost put to bid starting at 11% with the additional bid performance security being 0.25% and this additional performance security percentage shall be applied on the bid price; (ii) Where the bid price is below 20% but not below 25% of the project cost put to bid, the additional performance security percentage shall be incremented by 0.50% for every percentage of bid price below 20% of the project cost put to bid starting at 21% with the additional bid performance security being 0.50% and this additional performance security percentage shall be applied on the bid price; (iii) Where the bid price is below 25% but not below 30% of the project cost put to bid, the additional performance security percentage shall be incremented by 0.75% for every percentage of bid price below 25% of the project cost put to bid starting at 26% with the additional bid performance security being 0.75% and this additional performance security percentage shall be applied on the bid price; (iv) Where the bid price is below 30% but not below 30%, the additional performance security percentage shall be incremented by 1% for every percentage of bid price below 30% of the project cost put to bid starting at 31% with the additional bid performance security being 1% and this additional performance security percentage shall be applied on the bid price; (v) The additional performance security percentage shall rounded off the next lower percentage based on whether the decimal point of the percentage of bid price is below 0.5% or next higher percentage based on whether the decimal point of the percentage of bid price is 0.5% or more. (vi) All matters pertaining to validity, extension, claims forfeiture, and any other conditions in relation to the additional performance security shall be governed by the provisions of Clause 1 : PerformanceSecurity. Additional Performance Security should be furnished within 30 days of issue of letter of intent. The award letter will be issued on receipt of Additional Performance Security and contract agreement shall be signed within 10 days of issue of award letter. In case the Contractor fails to deposit Additional Performance Security within the stipulated period the tender shall be stands cancelled without any noticed. Further, EMD (Earnest money deposit) shall be forfeited, and the contractor shall be
--	---	--



		liable for debarment upto a period of Two (02) years
--	--	--

Clause 2

	Compensation for Delay	If the Contractor fails to maintain the required progress in terms of Clause 5 or to complete the Work and clear the site on or before the Contract or justified extended date of completion as per Clause 5(excluding any extension under Clause 5.5) as well as any extension granted under Clause 12 and 15, he shall, without prejudice to any other right or remedy available under the law to the AAI on account of such breach, pay as compensation the amount calculated at the rates stipulated below as the authority specified in Schedule 'F' may decide on the amount of Tendered Value of the work for every completed day/month (as determined) that the progress remains below that specified in Clause 5 or that the work remains incomplete. This will also apply to items or group of items for which a separate period of completion has been specified.	
	i) Compensation for delay of work	If the completion of work is delayed due to reasons attributed to Contractor, AAI shall be entitled for compensation for delay as detailed below : i. For works costing up-to Rs. 10Lac: 1.0% (one percent) of tendered value per week of delay or lesser amount as decided by the competent authority subject to a maximum of 10% of Contract value. - ii For the works costing more than Rs 10Lac: 0.5% (half percent) of tendered value per week of delay or lesser amount as decided by the competent authority subject to a maximum of 10% of the tendered value.	
		Provided always that the total amount of compensation for delay to be paid under this condition shall not exceed 10% of the Tendered Value of work or of the Tendered Value of the Sectional part of work as mentioned in Schedule 'F' for which a separate period of completion is originally given. In case no compensation has been decided by the authority in Schedule 'F' during the progress of work, this shall be no waiver of right to levy compensation by the said authority if the work remains incomplete on final justified extended date of completion. If the Engineer in Charge decides to give further extension of time allowing performance of work beyond the justified extended date, the Contractor shall be liable to pay compensation for such extended period. If any variation in amount of Contract takes place during such extended period beyond justified extended date and the Contractor becomes entitled to additional time under Clause 12, the net period for such variation shall be accounted for while deciding the period for levy of compensation. However, during such further extended period beyond the justified extended period, if any delay occurs by events under Sub-Clause 5.2, the Contractor shall be liable to pay compensation for such delay. Provided that compensation during the progress of work beyond the justified extended date of completion for delay under this Clause shall be for non-achievement of sectional completion or part handing over of work on stipulated/justified extended date for such part work or if delay affects any other works/services. This is without prejudice to right of action by Engineer-in-Charge under Clause 3 for delay in performance and claim of compensation under that Clause.	



		In case action under Clause 2 has not been finalized and the work has been determined under Clause 3, the right of action under this Clause shall remain post determination of Contract but levy of compensation shall be for days the progress is behind the Schedule on date of determination, as assessed by the authority in Schedule 'F', after due consideration of justified extension. The compensation for delay, if not decided before the determination of Contract, shall be decided after of determination of Contract. The amount of compensation may be adjusted or set-off against any sum payable to the Contractor under this or any other Contract with AAI. In case, the Contractor does not achieve a particular milestone mentioned in Schedule F, or the re-Scheduled milestone(s) in terms of Clause 5.4, the amount shown against that milestone shall be withheld, to be adjusted against the compensation levied as above. With-holding of this amount on failure to achieve a milestone, shall be automatic without any notice to the Contractor. However, if the Contractor catches up with the progress of work on the subsequent milestone(s), the withheld amount shall be released. In case the Contractor fails to make up for the delay in subsequent milestone(s), amount mentioned against each milestone missed subsequently also shall be withheld. However, no interest, whatsoever, shall be payable on such withheld amount.
--	--	--

Clause 2A

	Incentive for early completion	In case, the Contractor completes the work ahead of stipulated date of completion so provided in 'Schedule F', a bonus @ 1 % (one per cent) of the tendered value per month computed on per day basis, shall be payable to the Contractor, subject to a maximum limit of 5% (five per cent) of the tendered value. The amount of bonus, if payable, shall be paid along with final bill after completion of work. Bonus / Incentive shall be applicable for the contract completed before stipulated dates of completion and shall not be applicable for the contract extended beyond the stipulated period even with justified hindrance and without any action of compensation for delay. This clause shall not be applicable for the works which estimated cost put to tender is less than Rs.50.00 Cr.
--	---------------------------------------	--

Clause 2B

	Release of withheld amount against compensation for delay.	Withheld amount towards compensation for delay over and above Rs. 50.00 lacs, can be released against Bank Guarantee (on the format given at Appendix-1) or in the form of fixed deposit receipts or guarantee bonds of any Scheduled Bank but not Co-operative or Gramin Bank, pending finalization of case of extension of time by competent authority as per delegation of powers. Concerned Executive Director (Engg) will authorize such action on receipt of proposal from the Engineer-in-Charge through proper channel.
--	---	--

Clause 3

	When Contract can be Determined	Subject to other provisions contained in this Clause, the Engineer-in-Charge may, without prejudice to his any other rights or remedy against the Contractor in respect of any delay, inferior workmanship, any claims for damages and/or any other provisions of this Contract or otherwise, and whether the date of completion has or has not elapsed, by notice in writing absolutely determine the Contract in any of the following cases:
--	--	---

		i. If the Contractor having been given a notice by the Engineer-in-Charge in writing to rectify, reconstruct or replace any defective work or that the work is being performed in an inefficient or otherwise improper or un-workman like manner shall omit to comply with the requirement of such notice for a period of seven days thereafter. ii. If the Contractor has, without reasonable cause, suspended the progress of the work or has failed to proceed with the work with due diligence and continues to do so after a notice in writing of seven days from the Engineer-in-Charge. iii. If the Contractor fails to complete the work or section of work with individual date of completion on or before the stipulated or justified extended date on or before such date of completion, and the Engineer in Charge without any prejudice to any other right or remedy under any other provision in the Contract has given further reasonable time in a notice given in writing in that behalf as either mutually agreed or in absence of such mutual agreement by his own assessment making such time essence of Contract and in the opinion of Engineer in Charge, the Contractor will be unable to complete the same or does not complete the same within the periods specified. iv. If the Contractor persistently neglects to carry out his obligations under the Contract and / or commits default in complying with any of the terms and conditions of the Contract and does not remedy it or take effective steps to remedy it within 7 days after a notice in writing is given to him in that behalf by the Engineer-in-Charge. v. If the Contractor shall offer or give or agree to give to any person in AAI service or to any other person on his behalf any gift or consideration of any kind as an inducement or reward for doing or forbearing to do or for having done or forborne to do any act in relation to the obtaining or execution of this or any other Contract for AAI. vi. If the Contractor shall enter into a Contract with Airports Authority of India in connection with which commission has been paid or agreed to be paid by him or to his knowledge, unless the particulars of any such commission and the terms of payment thereof have been previously disclosed in writing to the Engineer-in-charge. vii. If the Contractor shall obtain a Contract with AAI as a result of wrong tendering or other non-bonafide methods of competitive tendering or commits any breach of Integrity Pact. viii. If the Contractor being an individual, or if a firm, any partner thereof shall at any time be adjudged insolvent or have a receiving order or order for administration of his estate made against him or shall take any proceedings for liquidation or composition (other than a voluntary liquidation for the purpose of amalgamation or reconstruction) under any Insolvency Act for the time being in force or make any conveyance or assignment of his effects or composition or arrangement for the benefit of his creditors or purport so to do, or if any application be made under any Insolvency Act for the time being in force for the sequestration of his estate or if a trust deed be executed by him for benefit of his creditors. ix. If the Contractor being a company shall pass a resolution or the court shall make an order that the company shall be wound up or if a receiver or a manager on behalf of a creditor shall be appointed or if circumstances shall arise which entitle the court or the creditor to appoint a receiver or a manager or which entitle the court to make a winding up order. x. If the Contractor shall suffer an execution being levied on his goods and allow it to be continued for a period of 21 days.
--	--	---

		xi. If the Contractor assigns (excluding part(s) of work assigned to other Agency(s) by the Contractor as per terms of Contract), transfers, sublets (engagement of labour on a piece-work basis or of labour with materials not to be incorporated in the work, shall not be deemed to be subletting) or otherwise parts with or attempts to assign, transfer, sublet or otherwise parts with the entire works or any portion thereof without the prior written approval of the Engineer-in-Charge. When the Contractor has made himself liable for action under any of the cases aforesaid, the Engineer-in-Charge on behalf of the Chairman, AAI shall have powers: - To determine the Contract as aforesaid so far as performance of work by the Contractor of work by the Contractor is concerned (of which determination notice in writing to the Contractor under the hand of the Engineer-in-Charge shall be conclusive evidence). Upon such determination, the Earnest Money Deposit, Security Deposit already recovered and Performance Guarantee under the Contract shall be liable to be forfeited and shall be absolutely at the disposal of the AAI. - After giving notice to the Contractor to measure up the work of the Contractor and to take such whole, or the balance or part thereof, as shall be un-executed out of his hands and to give it to another Contractor or any other means to complete the work. The Contractor, whose Contract is determined as above, shall not be allowed to participate in the tendering process for the balance work. In the event of above courses being adopted by the Engineer-in-Charge, the Contractor shall have no claim to compensation for any loss sustained by him by reasons of his having purchased or procured any materials or entered into any engagements or made any advances on account or with a view to the execution of the work or the performance of the Contract. And in case action is taken under any of the provision aforesaid, the Contractor shall not be entitled to recover or be paid any sum for any work thereof or actually performed under this Contract unless and until the Engineer-in-Charge has certified in writing the performance of such work and the value payable in respect thereof and he shall only be entitled to be paid the value so certified.
--	--	--

CLAUSE 3 A

		In case, the work cannot be started due to reasons not within the control of the Contractor within 1/8th of the stipulated time for completion of work or one month whichever is higher, either party may close the Contract by giving notice to the other party stating the reasons. In such eventuality, the Earnest Money Deposit and the Performance Guarantee of the Contractor shall be refunded within 30 days. Neither party shall claim any compensation for such eventuality. This Clause is not applicable for any breach of the Contract by either party.
--	--	--

CLAUSE 3 B

	Debarment of contractor	Contractor may be debarred if it is determined under breached the Integrity Pact of Clause 41(a) and code of Integrity of clause 41(b). - Contractor can also be debarred for the reasons like supply of sub-standard material, non-supply of material, abandonment of work, sub-standard quality of work, poor / unsatisfactory performance. - The period of debarment shall be upto two years.
--	--------------------------------	---

CLAUSE 4

	Contractor liable to pay compensation even if action not taken under Clause-3	In any case in which any of the powers conferred upon the Engineer-in-Charge by Clause-3 thereof, shall have become exercisable and the same are not exercised, the non-exercise thereof shall not constitute a waiver of any of the conditions hereof and such powers shall notwithstanding be exercisable in the event of any future case of default by the Contractor and the liability of the Contractor for compensation shall remain unaffected. In the event of the Engineer-in-Charge putting in force all or any of the powers vested in him under the preceding Clause he may, if he so desires after giving a notice in writing to the Contractor, take possession of (or at the sole discretion of the Engineer-in-Charge which shall be final and binding on the Contractor) use as on hire (the amount of the hire money being also in the final determination of the Engineer-in-Charge) all or any tools, plant, materials and stores, in or upon the works, or the site thereof belonging to the Contractor, or procured by the Contractor and intended to be used for the execution of the work/or any part thereof, paying or allowing for the same in account at the Contract rates, or in the case of these not being applicable, at current market rates to be certified by the Engineer-in-Charge, whose certificate thereof shall be final and binding on the Contractor, clerk of the works, foreman or other authorised agent to remove such tools, plant, materials, or stores from the premises (within a time to be specified in such notice) in the event of the Contractor failing to comply with any such requisition, the Engineer- in-Charge may remove them at the Contractor's expense or sell them by auction or private sale on account of the Contractor and his risk in all respects and the certificate of the Engineer-in-Charge as to the expenses of any such removal and the amount of the proceeds and expenses of any such sales shall be final and conclusive against the Contractor.
--	--	--

CLAUSE 5

	Time and Extension for Delay	The time allowed for execution of the Works as specified in the Schedule 'F' or the extended time in accordance with these conditions shall be the essence of the Contract. The execution of the works shall commence from such time period as mentioned in Schedule 'F' or from the date of handing over of the site whichever is later. If the Contractor commits default in commencing the execution of the work as aforesaid, AAI shall without prejudice to any other right or remedy available in law, be at liberty to forfeit the earnest money & performance guarantee absolutely.
--	-------------------------------------	--



5.1		After the Contract is awarded, within 15 days, the Contractor shall submit a Time and Progress Chart for each mile stone and get it approved by the Engineer in charge. The Chart shall be prepared in direct relation to the time stated in the Contract documents for completion of items of the works. It shall indicate the forecast of the dates of commencement and completion of various trades of sections of the work and may be amended as necessary by agreement between the Engineer in Charge and the Contractor within the limitations of time imposed in the Contract documents, and further to ensure good progress during the execution of the work, the Contractor shall in all cases in which the time allowed for any work, exceeds one month (save for special jobs for which a separate Programme has been agreed upon) complete the work as per mile stones given in Schedule 'F'. Project Management shall be done: a. For works costing up to Rs. 5.00 Cr. — CPM/PERT Chart
-----	--	---



		b. Works costing more than Rs. 5.00 Cr. By using Project Management Software like Primavera/MS Project or any other software with the approval of Engineer in charge. e. Contractor shall submit monthly progress reports (2 copies) highlighting status of various activities and physical completion of work. PROGRAMME CHART i. The Contractor shall prepare an integrated Programme chart in Project Management Software for the execution of work, showing clearly all activities from the start of work to completion, with details of manpower, equipment and machinery required for the fulfillment of the Programme within the stipulated period or earlier and submit the same for approval to the Engineer in Charge within fifteen days of award of the Contract. A recovery of Rs. 2500/- (for works costing up to Rs. 5.00 Crores) / Rs. 5000/- (for works costing more than Rs. 5.00 Crores) shall be made on per day basis in case of delay in submission of the above Programme. ii. The Programme chart should include the following: Descriptive note explaining sequence of the various activities. Network (PERT / CPM / BAR CHART). Programme for procurement of materials by the Contractor. Programme for deployment of machinery / equipment's having adequate capacity, commensurate with the quantum of work to be done within the stipulated period, by the Contractor. In addition to above, to achieve the progress of work as per Programme, the Contractor must bring at site adequate shuttering material required for cement concrete and R.C.C. works etc. for three floors within one month from the date of start of work till the completion of RCC work as per requirement of work. The Contractor shall submit shuttering Schedule adequate to complete structure work within laid down physical milestone. iii. If at any time, it appears to the Engineer in Charge that the actual progress of work does not conform to the approved Programme referred above or after rescheduling of milestones, the Contractor shall produce a revised Programme within 7 (seven) days, showing the modifications to the approved Programme to ensure timely completion of the work. The modified Schedule of Programme shall be approved by the Engineer in Charge. A recovery of Rs. 2500/- (for works costing up to Rs.5.00 Crores) / Rs. 5000/- (for works costing more than Rs.5.00 Crores) shall be made on per day basis in case of delay in submission of the modified Programme. iv. The submission for approval by the Engineer in Charge of such Programme or such particulars shall not relieve the Contractor of any of the duties or responsibilities under the Contract. This is without prejudice to the right of Engineer in Charge to take action against the Contractor as per terms and conditions of the agreement. v. The Contractor shall submit the progress report using MS Project/Primavera software with base line Programme referred above for the work done during previous month to the Engineer in Charge on or before 5th day of each month failing which a recovery Rs.2500/- (for works costing up to Rs.5.00 Crores) / Rs. 5000/- (for works costing more than Rs.5.00 Crores) shall be made on per day basis in case of delay in submission of the monthly progress report.
--	--	---

5.2		If the work(s) be delayed by:- - Force majeure, or an act of terrorism - Abnormally bad weather, or - Serious loss or damage by fire, or - Civil commotion, local commotion of workmen, strike or lockout, affecting any of the trades employed on the work, or - Delay on the part of other Contractors or tradesmen engaged by Engineer-in-Charge for executing work not forming part of the Contract, or - Non-availability of stores, which are the responsibility of AAI to supply or - Non-availability or break down of tools and Plant to be supplied or supplied by AAI or - Any other cause which, in the absolute discretion of the Engineer-in-Charge is beyond the Contractor's control. then upon the happening of any such event causing delay, the Contractor shall immediately give notice thereof in writing to the Engineer-in-Charge but shall nevertheless use constantly his best endeavors to prevent or make good the delay and shall do all that may be reasonably required to the satisfaction of the Engineer-in-Charge to proceed with the works. All correspondence with the agency and concerned stakeholders during execution of works will be taken into consideration for evaluation of hindrances causing delay, for grant of extension of time by the Competent Authority.
5.3		Request for rescheduling of Milestones and extension of time, to be eligible for consideration, shall be made by the Contractor in writing within fourteen days of the happening of the event causing delay on the prescribed form to the authority indicated in Schedule 'F'. The Contractor may also, if practicable, indicate in such a request the period for which extension is desired.
5.4		In any such case the Engineer-in-Charge with the approval of authority indicated in Schedule 'F' may give a fair and reasonable extension of time and reschedule the Milestones for completion of work. Such extension or re-scheduling of the milestone shall be communicated to the Contractor by the Engineer-in-Charge in writing, within 1 month or 4 weeks of the date of receipt of such request respectively. Non-application by the Contractor for extension of time/re-scheduling of milestones shall not be a bar for giving a fair and reasonable extension/re-scheduling of milestones by the Engineer-in-Charge with the approval of authority indicated in Schedule 'F' and this shall be binding on the Contractor.

CLAUSE 6

	Measurements of Work Done	Engineer-in-Charge shall, except as otherwise provided, ascertain and determine by measurement, the value in accordance with the Contract of work done. All measurement of all items having financial value shall be entered in Measurement Book and/or level field book so that a complete record is obtained of all works performed under the Contract. All measurements and levels shall be taken jointly by the Engineer-in-Charge or his authorised representative and by the Contractor or his authorised representative from time to time during the progress of the work and such measurements shall be signed and dated by the Engineer-in-Charge and the Contractor or their representatives in token of their acceptance. If the Contractor objects to any of the measurements recorded, a note shall be made to that effect with reason and signed by both the parties. If for any reason the Contractor or his authorised representative is not available and the work of recording measurements is suspended by the Engineer-in-
--	---	--



		Charge or his representative, the Engineer-in-Charge and the Department shall not entertain any claim from Contractor for any loss or damages on this account. If the Contractor or his authorised representative does not remain present at the time of such measurements after the Contractor or his authorised representative has been given a notice in writing three (3) days in advance or fails to countersign or to record objection within a week from the date of the measurement, then such measurements recorded in his absence by the Engineer-in-Charge or his representative shall be deemed to be accepted by the Contractor. The Contractor shall, without extra charge, provide all assistance with every appliance, labour and other things necessary for measurements and recording levels. Except where any general or detailed description of the work expressly shows to the contrary, measurements shall be taken in accordance with the procedure set forth in the specifications notwithstanding any provision in the relevant Standard Method of measurement or any general or local custom. In the case of items which are not covered by specifications, measurements shall be taken in accordance with the relevant standard method of measurement issued by the Bureau of Indian Standards and if for any item no such standard is available, then a mutually agreed method shall be followed. The Contractor shall give, not less than seven days' notice to the Engineer-in-Charge or his authorised representative in-charge of the work, before covering up or otherwise placing beyond the reach of measurement any work in order that the same may be measured and correct dimensions thereof be taken before the same is covered up or placed beyond the reach of measurement and shall not cover up and place beyond reach of measurement any work without consent in writing of the Engineer-in-Charge or his authorised representative in-charge of the work who shall within the aforesaid period of seven days inspect the work, and if any work shall be covered up or placed beyond the reach of measurements without such notice having been given or the Engineer-in-Charge's consent being obtained in writing, the same shall be uncovered at the Contractor's expense, or in default thereof no payment or allowance shall be made for such work or the materials with which the same was executed. Engineer-in-Charge or his authorised representative may cause either themselves or through another officer of the department to check the measurements recorded jointly or otherwise as aforesaid and all provisions stipulated herein above shall be applicable to such checking of measurements or levels. It is also a term of this Contract that recording of measurements of any item of work in the measurement book and/or its payment in the interim, on account or final bill shall not be considered as conclusive evidence as to the sufficiency of any work or material to which it relates nor shall it relieve the Contractor from liabilities from any over measurement or defects noticed till completion of the defects liability period.
--	--	--

Clause 6 A

	Computerized Measurement Book	Computerized measurement is mandatory for works costing more than Rs 5.00 Lacs. However in case of works costing lesser than Rs. 5.00 Lacs Engineer-in-Charge may decide for adopting computerized measurement if required, except as otherwise provided, ascertain and determine by measurement the value of work done in accordance with the Contract. All measurements of all items having financial value shall be entered by the Contractor and compiled in the shape of the Computerized Measurement Book having pages of A-4 size as per.
--	--------------------------------------	---



		the format of the department so that a complete record is obtained of all the items of works performed under the Contract.
		All such measurements and levels recorded by the Contractor or his authorised representative from time to time, during the progress of the work, shall be got checked by the Contractor from the Engineer-in-Charge or his authorised representative as per interval or program fixed in consultation with Engineer-in-Charge or his authorised representative. After the necessary corrections made by the Engineer-in-Charge, the measurement sheets shall be returned to the Contractor for incorporating the corrections and for resubmission to the Engineer-in-Charge for the dated signatures by the Engineer-in-Charge and the Contractor or their representatives in token of their acceptance. Whenever bill is due for payment, the Contractor would initially submit draft computerized measurement sheets and these measurements would be got checked/test checked from the Engineer-in-Charge and/or his authorized representative. The Contractor will, thereafter, incorporate such changes as may be done during these checks/test checks in his draft computerised measurements, and submit to the department a computerised measurement book, duly bound, and with its pages machine numbered. The Engineer-in-Charge and/or his authorised representative would thereafter check this MB, and record the necessary certificates for their checks/test checks. The final, fair, computerised measurement book given by the Contractor, duly bound, with its pages machine numbered, should be 100% correct, and no cutting or overwriting in the measurements would thereafter be allowed. If at all any error is noticed, the Contractor shall have to submit a fresh computerized MB with its pages duly machine numbered and bound, after getting the earlier MB cancelled by the department. Thereafter, the MB shall be taken in the records of Engineer-in-charge, and allotted a number as per the Register of Computerized MBs. This should be done before the corresponding bill is submitted to the Engineer-in-Charge for payment. The Contractor shall submit two spare copies of such computerized MB's for the purpose of reference and record by the various officers of the department. The Contractor shall also submit to the department separately his computerized Abstract of Cost and the bill based on these measurements, duly bound, and its pages machine numbered along with two spare copies of the "bill. Thereafter, this bill will be processed by the Engineer-in-Charge and allotted a number as per the computerized record in the same way as done for the measurement book meant for measurements. The Contractor shall, without extra charge, provide all assistance with every appliance, labour and other things necessary for checking of measurements / levels by the Engineer-in-Charge or his representative. Except where any general or detailed description of the work expressly shows to the contrary, measurements shall be taken in accordance with the procedure set forth in the specifications notwithstanding any provision in the relevant Standard Method of measurement or any general of local custom. In the case of item which are not covered by specifications, measurements shall be taken in accordance with the relevant standard method of measurement issued by the Bureau of Indian Standards and if for any item no such standard is available then a mutually agreed method shall be followed. The Contractor shall give not less than seven days' notice to the Engineer-in-Charge or his authorized representative in-charge of the work before covering up or otherwise placing beyond the reach of checking and / or test checking the measurement of any work in order that the same be checked and / or test checked and correct dimensions thereof be taken before the same is covered up or placed beyond the reach of checking and / or test checking measurement and shall not cover up and place beyond reach of measurement any work without

		consent in writing of the Engineer-in-Charge or his authorized representative in-charge of the work who shall within the aforesaid period of seven days inspect the work, and if any work shall be covered up or placed beyond the reach of checking and / or test checking measurements without such notice having been given or the Engineer-in-charge's consent being obtained in writing the same shall be uncovered at the Contractor's expense, or in default thereof no payment or allowance shall be made for such work or the materials with which the same was executed.
		Engineer-in-Charge or his authorised representative may cause either themselves or through another officer of the department to check the measurements recorded by Contractor and all provisions stipulated herein above shall be applicable to such checking of measurements or levels. It is also a term of this Contract that checking and/or test checking the measurements of any item of work in the measurement book and/or its payment in the interim, on account of final bill shall not be considered as conclusive evidence as to the sufficiency of any work or material to which it relates nor shall it relieve the Contractor from liabilities from any over measurement or defects noticed till completion of the defects liability period.

CLAUSE 7

	Payment on Intermediate Certificate to be regarded as Advances	No payment shall be made for work, estimated to cost Rs. One lac or less till after the whole of the work shall have been completed and certificate of completion given. For works estimated to cost over Rs. One lac, the interim or running account bills shall be submitted by the Contractor for the work executed on the basis of such recorded measurements on the format of the Department in triplicate on or before the date of every month fixed for the same by the Engineer in Charge. The Contractor shall not be entitled to be paid any such interim payment if the gross work done together with net payment/ adjustment of advances for material collected, if any, since the last such payment is less than the amount specified in Schedule 'F', in which case the interim bill shall be prepared on the appointed date of the month after the requisite progress is achieved. Engineer in Charge shall arrange to have the bill verified by taking or causing to be taken, where necessary, the requisite measurements of the work. In the event of the failure of the Contractor to submit the bills, Engineer in Charge shall prepare or cause to be prepared such bills in which event no claims whatsoever due to delays on payment including that of interest shall be payable to the Contractor. Payment on account of amount admissible shall be made by the Engineer in Charge certifying the sum to which the Contractor is considered entitled by way of interim payment at such rates as decided by the Engineer in Charge. An amount of ad hoc payment not less than 75% of the working days of submission of the bill by the contractor to the Engineer in Charge or his authorized Engineer together with the account of the material issued by the department, or dismantled materials, if any. The remaining payment is also to be made after final checking of the bill within 28 working days of submission of bill by the contractor. In case of delay in payment of intermediate bills after 30 days of submission of bill by the contractor, provided the bill submitted by contractor found to be in order, a simple interest @ prevailing rate of interest of General Provident Fund shall be paid to the contractor from the date of expiry of prescribed time limit. All such interim payments shall be regarded as payment by way of advances against final payment only and shall not preclude the requiring of bad, unsound and imperfect or unskilled work to be rejected, removed, taken away and reconstructed or re-erected. Any certificate given by the Engineer in Charge relating to the work done or materials delivered forming part of such payment, may be modified or corrected by any subsequent such certificate(s) or by the final certificate and shall not by itself be conclusive evidence that any work or materials to which it relates is in accordance with the Contract and
--	--	--



		specifications. Any such interim payment, or any part thereof shall not in any respect conclude, determine or affect in any way powers of the Engineer in-charge under the Contract or any of such payments be treated as final settlement and adjustment of accounts or in any way vary or affect the Contract. Pending consideration or extension of date of completion, interim payments shall continue to be made as herein provided without prejudice to the right of the department to take action under the terms of this Contract for delay in the completion of work, if the extension of date of completion is not granted by the competent authority. The Engineer in Charge in his sole discretion on the basis of a certificate from the Asstt. Manager / Manager (Engg) to the effect that the work has been completed up to the level in question make interim advance payments without detailed measurements for work done (other than foundations, items to be covered under finishing items) up to lintel level (including sunshade etc.) and slab level, for each floor working out at 75% of the assessed value. The advance payments so allowed shall be adjusted in the subsequent interim bill(s) to be submitted by the contractor within 10 days of the interim payment. In case of delay in submission of bill by the contractor a simple interest @ 10% (percent) per annum on the advance payment made shall be paid to the AAI from the date of expiry of prescribed 10 days.
--	--	---

CLAUSE 7 A

		No running account bill shall be paid for the work till the applicable labour licenses, registration with EPFO, ESIC and BOCW Welfare Board, whatever applicable are submitted by the contractor to the Engineer In Charge.
--	--	--

CLAUSE 8

	Completion Certificate and Completion Plans	Within ten days of the completion of the work, the Contractor shall give notice of such completion to the Engineer-in-Charge and within thirty days of the receipt of such notice, the Engineer-in-Charge shall inspect the work and if there is no defect in the work, shall furnish the Contractor with a final certificate of completion, otherwise a provisional certificate of physical completion indicating defects (a) to be rectified by the Contractor and/or (b) for which payment will be made at reduced rates, shall be issued. But no final certificate of completion shall be issued, nor shall the work be considered to be complete for 'Civil Construction Works' until the Contractor shall have removed from the premises on which the work shall be executed all scaffolding, surplus materials, rubbish and all huts and sanitary arrangements required for his/their work people on the site in connection with the execution of the works as shall have been erected or constructed by the Contractor(s) and cleaned off the dirt from all wood work, doors, windows, walls, floor or other parts of the building, in, upon, or about which the work is to be executed or of which he may have had possession for the purpose of the execution; thereof, and not until the work shall have been measured by the Engineer-in-charge. If the Contractor shall fail to comply with the requirements of this Clause as to removal of scaffolding, surplus materials and rubbish and all huts and sanitary arrangement as aforesaid and cleaning off dirt on or before the date fixed for the completion of work, the Engineer-in-charge may at the expense of the Contractor remove such scaffolding, surplus materials and rubbish etc., and dispose of the same as he thinks fit and clean off such dirt as aforesaid, and the Contractor shall have no claim in respect of scaffolding or surplus materials as aforesaid except for any sum actually realised by the sale thereof. a. For Electrical and Mechanical Capital Works: The Contractor shall remove the rubbish from the site. Following conditions must be met before recording completion certificate: Submits Completion Plan, Maintenance Manual, Manufactures Catalogue and gives Performance Test for system. b. For Repair Works: The performance of the repaired system has been tested and found satisfactory. c. For AMC Work: The system has been tested for its performance/completeness and taken over by AAI/next Agency for operation and maintenance.
--	---	--

CLAUSE 8 A

	Contractor to keep site clean	When the annual repairs and maintenance of works are carried out, the splashes and droppings from white washing, colour washing, painting etc., on walls, floor, windows etc. shall be removed and the surface cleaned simultaneously with the completion of these items of work in the individual rooms, quarters or premises etc. Where the work is done without waiting for the actual completion of all the other items of work in the Contract, in case the Contractor fails to comply with the requirements of this Clause, the Engineer-in-Charge shall have the right to get this work done at the cost of the Contractor either departmentally or through any other Agency. Before taking such action, the Engineer-in-Charge shall give ten days' notice in writing to the Contractor.
--	--------------------------------------	--

CLAUSE 8 B

	Completion Plans to be Submitted by the Contractor	The Contractor shall submit completion plan as required vide General Specifications for Electrical works (Part-I Internal) 2013 and (Part-II External) 1994 or latest available Specifications, as applicable within thirty days of the completion of the work. The Contractor shall submit completion plan for building works, all services, and obtain occupancy certificate from local bodies on the basis of completion drawings within a period of 30 days from the date of completion. The Contractor shall also submit catalogues of all equipment's and maintenance manual for the complete E & M systems. If Contractor fails to submit completion plans of all works, he shall be liable to pay compensation @ 0.5% of the tendered value of works costing up to Rs. 5 Crores subject to maximum of Rs. 1.00 Lac and 0.25% for works costing more than Rs. 5 crores subject to maximum of Rs. 1.5 Lac. The decision of Project-in-charge in this regard shall be final and binding on the Contractor.
--	---	--

CLAUSE 9

	Payment of final bill	The corrected final bill shall be submitted by the Contractor in the same manner as specified in interim bills within three months of physical completion of the work or within one month of the date of the final certificate of completion furnished by the Engineer-in-Charge whichever is earlier. No further claims shall be made by the Contractor after submission of the final bill and these shall be deemed to have been waived and extinguished. Payments of those items of the bill in respect of which there is no dispute and for those items which are in dispute on account of quantity and / or rates shall be paid at approved quantity and / or rates by the Engineer-in-charge, within three months period reckoned from the date of receipt of the bill by the Engineer in-charge or his authorized representative, complete with account of materials issued by the Department and dismantled materials.
--	------------------------------	--

		If the final bill is submitted by the contractor within the period specified above and payment of final bills is made by the AAI within above prescribed time limit, if delay in payment, a simple interest @ prevailing rate if interest of General Provident Fund shall be paid to the contractor from the date of expiry of prescribed time limit, provided the final bill submitted by the contractor is found to be in order.. The Final bill shall be prepared for both L1 & L2 bidders for all tendered items (excluding Extra Items based on market rate) and payment shall be made on the basis of lower of the two.
--	--	---

CLAUSE 9 A

	Payment of Contractor's bills to Banks	Payments due to the Contractor and refund of various nature may, if so desired by him and wherever possible in banks be made through electronic payment mechanism instead of direct to him, provided that the Contractor furnishes to the Engineer-in-Charge. - Information as per Proforma attached. - An authorisation in the form of a legally valid document such as power of attorney conferring authority on the bank to receive payments and - His own acceptance of the correctness of the amount made out as being due to him by Authority or his signature on the bill or other claim preferred against Authority before settlement by the Engineer-in-Charge of the account or claim by payment to the bank. While the receipt given by such banks shall constitute a full and sufficient discharge for the payment, the Contractor shall whenever possible present his bills duly receipted and discharged through his bank. Nothing herein contained shall operate to create in favour of the bank any rights or equities vis-à-vis the Airports Authority of India.
--	---	---

CLAUSE 10

	Materials supplied by Authority	Materials which Authority will supply are shown in Schedule 'B' which also stipulates quantum, place of issue and rate(s) to be charged in respect thereof. The Contractor shall be bound to procure them from the Engineer-in-charge. As soon as the work is awarded, the Contractor shall finalise the Programme for the completion of work as per Clause 5 of this Contract and shall give his estimates of materials required on the basis of drawings/or Schedule of Quantities of the work. The Contractor shall give in writing his requirement to the Engineer-in-Charge, which shall be issued to him keeping in view the progress of work as assessed by the Engineer-in-Charge in accordance with the agreed phased Programme of work indicating monthly requirements of various materials. The Contractor shall place his indent in writing for issue of such materials at least 7 days in advance of his requirement. Such materials shall be supplied for the purpose of the Contract only and the value of the materials so supplied at the rates specified in the aforesaid Schedule shall be set off or deducted, as and when materials are consumed in items of work (including normal wastage) for which payment is being made to the Contractor, from any sum then due or which may therefore become due to the Contractor under the Contract or otherwise or from the security deposit. At the time of submission of bills, the Contractor shall certify that balance of materials supplied is available at site in original good condition. The Contractor shall submit along with every running bill (on account or interim bill) material-wise reconciliation statements supported by complete calculations
--	--	---

		reconciling total issue, total consumption and certified balance (diameter/section-wise in the case of steel) and resulting variations and reasons thereof. Engineer-in-Charge shall (whose decision shall be final and binding on the Contractor) be within his rights to follow the procedure of recovery in Clause 42 at any stage of the work if reconciliation is not found to be satisfactory. The Contractor shall bear the cost of getting the material issued, loading, transporting to site, unloading, storing under cover as required, cutting assembling and joining the several parts together as necessary. Notwithstanding anything to the contrary contained in any other Clause of the Contract and all stores/materials so supplied to the Contractor or procured with the assistance of the AAI shall remain the absolute property of Authority and the Contractor shall be the trustee of the stores/materials, and the said stores/materials shall not be removed/disposed of from the site of the work on any account and shall be at all times open to inspection by the Engineer-in-Charge or his authorised agent. Any such stores/materials remaining unused shall be returned to the Engineer-in-Charge in as good a condition in which they were originally supplied at a place directed by him, at a place of issue or any other place specified by him as he shall require, but in case it is decided not to take back the stores/materials the Contractor shall have no claim for compensation on any account of such stores/materials so supplied to him as aforesaid and not used by him or for any wastage in or damage to in such stores/materials. On being required to return the stores/materials, the Contractor shall hand over the stores/materials on being paid or credited such price as the Engineer-in-charge shall determine, having due regard to the condition of the stores/materials. The price allowed for credit to the Contractor, however, shall be at the prevailing market rate not exceeding the amount charged to him, excluding the storage charge, if any. The decision of the Engineer-in-Charge shall be final and conclusive. In the event of breach of the aforesaid condition, the Contractor shall in addition to throwing himself open to account for contravention of the terms of the licenses or permit and/or for criminal breach of trust, be liable to Authority for all advantages or profits resulting or which in the usual course would have resulted to him by reason of such breach. Provided that the Contractor shall in no case be entitled to any compensation or damages on account of any delay in supply or non-supply thereof all or any such materials and stores provided further that the Contractor shall be bound to execute the entire work if the materials are supplied by the Authority within the original Scheduled time for completion of the work plus 50% thereof or Schedule time plus 6 months whichever is more if the time of completion of work exceeds 12 months, but if a part of the materials only has been supplied within the aforesaid period, then the Contractor shall be bound to do so much of the work as may be possible with the materials and stores supplied in the aforesaid period. For the completion of the rest of the work, the Contractor shall be entitled to such extension of time as may be determined by the Engineer-in-Charge whose decision in this regard shall be final and binding on the Contractor. The Contractor shall see that only the required quantities of materials are got issued. Any such material remaining unused and in perfectly good/original condition at the time of completion or determination of the Contract shall be returned to the Engineer-in-charge at the stores from which it was issued or at a place directed by him by a notice in writing. The Contractor shall not be entitled for loading transporting, unloading and stacking of such unused material except for the extra lead, if any involved, beyond the original place of issue.
--	--	---

CLAUSE 10 A

	Materials to be provided by the Contractor and Mandatory Tests	1. The Contractor shall, at his own expense, provide all materials, required for the works other than those which are stipulated to be supplied by the Authority. 2. The Contractor shall, at his own expense and without delay; supply to the Engineer in- charge samples of materials to be used on the work and shall get these approved in advance. All such materials to be provided by the Contractor shall be in conformity with the specifications laid down or referred to in the Contract. The Contractor shall, if requested by the Engineer-in-Charge furnish proof, to the satisfaction of the Engineer-in-charge that the materials so comply. The Engineer-in-Charge shall within thirty (30) days of supply of samples or within such further period as he may require intimate to the Contractor in writing whether samples are approved by him or not. If samples are not approved, the Contractor shall forthwith arrange to supply to the Engineer-in-Charge for his approval, fresh samples complying with the specifications laid down in the Contract. When materials are required to be tested in accordance with specifications, approval of the Engineer-in-Charge shall be issued after the test results are received. 3. The Contractor shall at his cost submit the samples of materials to be tested or analyzed and shall not make use of or incorporate in the work any materials represented by the samples until the required tests or analysis have been made and materials finally accepted by the Engineer-in-charge. 4. If any additional tests apart from mandatory tests specified in the Contract are required to be carried out at the instance of AAI or any other advisory body, to ensure conformity of the item to the Contract specifications, the cost of such tests shall be borne by AAI. In case the material / equipment fails in the above tests, the expenditure incurred by AAI on testing of such material or equipment along with incidental charges borne by AAI (if any) shall be recovered from the dues of the Contractor and action shall be taken under Clause 16 and other relevant Clauses of the Contract. 5. The Contractor shall not be eligible for any claim or compensation either arising out of any delay in the work or due to any corrective measures required to be taken on account of and as a result of testing of materials. 6. The Contractor shall, at his cost, make all arrangements and shall provide all facilities as the Engineer-in-Charge may require for collecting and preparing the required number of samples for such tests at such time and to such place or places as may be directed by the Engineer-in-Charge and bear all charges including testing charge. The Engineer-in- charge or his authorised representative shall always have access to the works and to all workshops and places where work component is being prepared or from where material manufactured articles or machinery are being obtained for the works and the Contractor shall afford every facility and every assistance in obtaining the right to such access. 7. The Engineer-in-Charge shall have full powers to require the removal from the premises of all materials which in his opinion are not in accordance with the specifications and in case of default, the Engineer-in-Charge shall be at liberty to employ at the expense of the Contractor, other persons to remove the same without being answerable or accountable for any loss or damage that may happen or arise to such materials. The Engineer-in-charges shall also have full powers to require other proper materials to be substituted thereof and in case of default, the Engineer-in-Charge may cause
--	--	---

		the same to be supplied and all costs which may be attracted for such removal and substitution shall be borne by the Contractor. 8. The Contractor shall at his own expense, provide a material testing lab at the site for conducting routine field tests. The lab shall be equipped atleast with the testing equipment as specified in Schedule F. 9. Details in respect of all mandatory tests shall be maintained in the desired format and attached with each Running Account Bill.
--	--	---

CLAUSE 10 B

(I)	Secured-Advance on-Nonperishable materials	The Contractor, on signing an indenture in the form to be specified in Appendix-XIX, shall be entitled to be paid during the progress of the execution of the work up to 75% of the assessed value of any materials, which are in the opinion of the Engineer in Charge non-perishable, non-fragile and non-combustible and are in accordance with the Contract and which have been brought on the site in connection therewith and are adequately stored and/or protected against damage by weather or other causes but which have not at time of advance been incorporated in the works. When materials on account of which an advance has been made under this Sub Clause are incorporated in the work, the amount of such advance shall be recovered/deducted from the next payment made under any of the Clause or Clauses of this Contract. Such secured advance shall also be payable on other items of perishable nature, fragile and combustible with the approval of the Engineer in Charge provided the contractor provides a comprehensive insurance cover for the full cost of such materials. The decision of the Engineer in Charge shall be final and binding on the Contractor in this matter. No secured advance, shall however, be paid on high risk materials such as ordinary glass, sand, petrol, diesel. The secured advance shall also be payable against items brought at site for use in electrical and mechanical systems. Such secured advance shall be paid on submission of Collateral Bank Guarantee submitted by the vendor against the payment in case equipment/system fails to perform on testing and commissioning. Normally secured advance is paid up to 75% of the assessed value of items but in any case it shall not exceed 80% of cost of items indicated for supply of equipment.
(II)	Mobilization Advance	Mobilization advance not exceeding 10% of the tendered value may be given, if requested by the contractor in writing within six months of the order to commence the work. Such advance shall be released in two or more installments to be determined by the Engineer in Charge at his sole discretion. The first installment of such advance shall be released by the Engineer in charge to the contractor on a request made by the contractor to the Engineer in charge in this behalf. The second and subsequent installments shall be released by the Engineer in charge only after the contractor furnishes a proof of the satisfactory utilization of the earlier installment(s) to the satisfaction of the Engineer in Charge. Before any installment of advance is released, the contractor shall execute Bank Guarantee Bonds not more than 6 (Six) in number from commercial Bank for the amount equal to 110% of the amount of advance and valid for the period till recovery of advance. This (Bank Guarantee from commercial

		Bank on prescribed format for the amount equal to 110% of the balance amount of advance) shall be kept renewed from time to time to cover the balance amount and likely period of complete recovery.
	Interest on Mobilization advance	The mobilization advance bear simple interest at the rate as mentioned in Schedule F per annum and shall be calculated from the date of payment to the date of recovery, both days inclusive, on the outstanding amount of advance.
	Recovery of Mobilization advance	Recovery of such sums advanced shall be made by the deduction from the contractor's bills commencing after first ten percent of the gross value of the work is executed and paid, on pro rate percentage basis to the gross value of the work billed beyond 10% in such a way that the entire advance is recovered by the time eighty percent of the gross value of the contract is executed and paid, together with interest due on the entire outstanding amount up to date of recovery of the installment. If the circumstances are considered reasonable by the Engineer in charge, the period mentioned for request by the contractor in writing for grant of mobilization advance may be extended at the discretion of the Engineer in charge.

CLAUSE 10 C

Payment on Account of Increase in Prices/Wages due to Statutory Order(s)	If after submission of the tender, the price of any material incorporated in the works and/or wages of labour increases as a direct result of the coming into force of any fresh, law or statutory rule or order (but not due to any variation of rate in GST applicable on such material(s) being considered under this Clause) beyond the prices/wages prevailing at the time of the last stipulated date of receipt of tenders including extensions, if any, for the work during Contract period including the justified period extended under the provisions of Clause 5 of the contract without any action under Clause 2, then the amount of the Contract shall accordingly be varied. If after submission of the tender, the price of any material incorporated in the works and/or wages of labour as prevailing at the time of last stipulated date of receipt of tender including extensions, if any, is decreased as a direct result of the coming into force of any fresh law or statutory rules or order (but not due to any variation of rate in GST applicable on such material(s) being considered under this clause), Authority shall in respect of materials incorporated in the works and/or labour engaged on the execution of the work after the date of coming into force of such law, statutory rule or order be entitled to deduct from the dues of the Contractor, such amount as shall be equivalent to the difference between the prices of the materials and/or wages as prevailed at the time of the last stipulated date for receipt of tenders including extensions if any, for the work and the prices of materials and/or wages of labour on the coming into force of such law, statutory rule or order. This will be applicable for the Contract period including the justified period extended under the provisions of Clause 5 of the Contract without any action under Clause 2. Engineer in Charge shall call books of account and other relevant documents from the Contractor to satisfy himself about reasonability of increase in prices of materials and wages. The Contractor shall, within a reasonable time of his becoming aware of any alteration in the price of any such materials and/or wages of labour, give notice thereof to the Engineer in Charge stating that the same is given pursuant to this condition together with all information relating thereto which he may be in position to supply. For this purpose, the labour component of 85% of the value of the work executed during period under consideration shall not exceed the percentage as specified in Schedule F, and the increase / decrease in labour shall be considered on the minimum daily wages in rupees of any unskilled mazdoor, fixed under any law, statutory rule or order. The Cost of Work for which escalation applicable is same as cost of work done shall be worked out as below (a) Gross value of work done up to this quarter: (A) (b) Gross value of work done up to the last quarter: (B) (c) Gross value of work done since previous quarter (C) = (A - B) (d) Full assessed value of Secured Advance fresh paid in this quarter: (D) (e) Full assessed value of Secured Advance recovered in this quarter: (E) (f) Full assessed value of Secured Advance for which escalation payable in
--	---



		this quarter, (F)–(D–E) (g) Advance payment made during this quarter: (G) (h) Advance payment recovered during this quarter: (H) (i) Advance payment for which escalation is payable in this Quarter (I) = (G–H) (j) Amount paid based on prevailing market rates due to deviation/variaions as per Clause 12 during this quarter: (J) Then, $M = C + F + I + J$ $N = 0.85 M$ (k) Less cost of services rendered at fixed charges as per clause 34 and recovered during the quarter (L) (l) Less cost of Engineering Consultant Services rendered at fixed charges as per BOQ and paid during the quarter (X). Cost of work for which escalation is applicable $W = N (L + X)$ Provided always that: (a) Where provision of clause 10C are applicable, provisions of clause 10 CC will not be applicable and; (b) Where provisions of clause 10 CC are applicable, provisions of clause 10C will not be applicable.
--	--	---

CLAUSE 10 CA

	Payment due to variation in prices of materials after receipt of tender	If after submission of the tender, the price of materials specified in Schedule F increases/decreases beyond the base price(s) as indicated in Schedule F for the work, then the amount of the Contract shall accordingly be varied and provided further that any such variations shall be effected for stipulated period of Contract
--	--	---

		including the justified period extended under the provisions of Clause 5 of the Contract without any action under Clause 2. However for work done during the justified period extended as above, it will be limited to indices prevailing at the time of updated stipulated date of completion considering the effect of extra work (Extra time to be calculated on pro-rata basis only as cost of extra work X stipulated period/ tendered cost). The increase/decrease in prices of cement, steel reinforcement, structural steel, Bitumen and POL shall be determined by the Price Indices issued by the Director General, CPWD. For other items provided in the Schedule 'F', this shall be determined by the All India Wholesale Price Indices of materials as published by Economic Advisor to Government of India, Ministry of Commerce and Industry. Base price for cement, steel reinforcement, structural steel and POL shall be as issued under authority of Director General, CPWD applicable for Delhi including Noida, Gurgaon, Faridabad and Ghaziabad and for other places as issued under the authority of Zonal Chief Engineer, CPWD and base price of other materials issued by concerned Zonal Chief Engineer and as indicated in Schedule 'F'. In case, price index of a particular material is not issued by Ministry of Commerce and Industry then the price index of nearest similar material as indicated in Schedule F shall be followed. The amount of the Contract shall accordingly be varied for all such materials worked out as per the formula given below for individual material: Adjustment for component of individual material- $V = P \times Q \times \frac{CI - CI_0}{CI_0}$ where, V = Variation in material cost i.e. increase or decrease in the amount in rupees to be paid or recovered P = Base price of material as issued under authority of DG, CPWD or concerned Zonal Chief Engineer CPWD and as indicated in Schedule 'F'. For Projects and original works Q = Quantity of material brought at site for bonafide use in the works since previous bill excluding any such quantity consumed in the deviated quantity of items beyond deviation limit and extra/substituted item, paid/to be paid at rates derived on the basis of market rates under Clause 12.2 For maintenance works Q = Quantity of material brought at site for bonafide use in the works since previous bill including any such quantity consumed in the deviated quantity of items beyond deviation limit paid at agreement rates and extra/substituted item being Scheduled items, but excluding nonscheduled extra/substituted item paid/to be paid at market rates under Clause 12.2 CI₀ = Price index for cement, steel reinforcement bars, structural steel and POL as issued by the DG, CPWD and corresponding to the time of base price of respective material indicated in Schedule 'F'. For other items, if any
--	--	---

		provided in Schedule 'F', All India Wholesale Price Index for the material as published by the Economic Advisor to Government of India, Ministry of Industry and Commerce and corresponding to the time of base price of respective material indicated in Schedule 'F'. CI = Price index for cement, steel reinforcement bars, structural steel and POL as issued under the authority of DG, CPWD for period under consideration. For other items, if any, provided in Schedule 'F', All India Wholesale Price Index for the material for the period under consideration as published by Economic Advisor to Government of India, Ministry of Industry and Commerce.
		Note: i. In respect of justified period extended under the provisions of Clause 5 of the Contract without any action under Clause 2, the index prevailing at the time of updated stipulated date of completion considering the effect of extra work (extra time to be calculated on prorata basis only as cost of extra work X stipulated period/ tendered cost) shall be considered. Provided always that provisions of the preceding Clause 10 C shall not be applicable in respect of materials covered in this Clause. ii. If during progress of work or at the time of completion of work, it is noticed that any material brought at site is in excess of requirement, then amount of escalation if paid earlier on such excess quantity of material shall be recovered on the basis of cost indices as applied at time of payment of escalation or as prevailing at the time of effecting recovery, whichever is higher. iii. Cement mentioned wherever in this Clause includes cement component used in RMC brought at site from outside approved RMC plants, if any. iv. The date wise record of ready mix concrete shall be kept in a register and cement consumption for the same shall be calculated accordingly. v. If built up steel items are brought at site from workshop, then the variation shall be paid for structural steel up to the period when the built up item/finished product is brought at site.

Clause 10CC

	Price-adjustment for works.	If the prices of materials and/or wages of labour required for execution of the work increase, the Contractor shall be compensated for such increase as per provisions detailed below and the amount of the contract shall accordingly be varied, subject to the condition that such compensation for escalation in prices and wages shall be available only for the work done during the stipulated period of the contract including the justified period extended under the provisions of Clause 5 of the Contract without any action under Clause 2. Such compensation for escalation in the prices of materials and labour, when due, shall be worked out based on the following provisions: i. The base date for working out such escalation shall be the last stipulated date of receipt of tenders including extension, if any. ii. The cost of work on which escalation will be payable shall be reckoned as below: a. Gross value of work done up to this quarter (A) b. Gross value of work done up to the last quarter (B) c. Gross value of work done since previous quarter (C) = (A - B) d. Full assessed value of secured advance fresh paid in this quarter (D) e. Full assessed value of secured advance recovered in this quarter (E) f. Full assessed value of secured advance for which escalation payable in this quarter (F) = (D - E) g. Advance payment made during this quarter (G) h. Advance payment recovered during this quarter (H) i. Advance payment for which escalation is payable in this quarter (I) = (G - H) j. Amount paid based on prevailing market rates due to deviations/variations as per Clause 12 during this quarter : (J) Then, $M = C + F + I - J$ $N = 0.85 M$ k. Less cost of services rendered at fixed charges as per Clause 34 and recovered during the quarter (L) l. Less cost of Engineering consultancy services rendered at fixed charges as per BOQ and paid during the quarter (X) Cost of work for which escalation is applicable- $W = N - (K + L)$ *Cost of Design & Detailing shall be treated as Civil work for EPC contract.
--	---	--



	Materials	Components for materials, labour, etc. shall be pre-determined for every work and incorporated in the Conditions of Contract attached to the tender documents included in Schedule F. The decision of the Engineer in Charge in working out such percentage shall be binding on the Contractors. iii. The following principles shall be followed while working out the payment/recovery on account of variation of prices of materials and / or wages of labour. a) The compensation for escalation shall be worked out at quarterly intervals and shall be with respect to the cost of work done as per bills paid during the three calendar months of the said quarter. The date of submission of bill finally by the contractor to the department shall be the guiding factor to decide the bills relevant to the quarterly interval. The first such payment shall be made at the end of three months after the month (excluding the month in which the work order issued) and thereafter at three months interval. At the time of completion of the work, the last period for payment might become less than 3 months, depending on the actual date of completion. b) The indices as defined below (excluding L1) relevant to any quarter / period for which such compensation is to be paid shall be the arithmetical average of the indices relevant to the three calendar months. If the period up to the date of completion after the quarter covered by the last such installment of payment, is less than three months, the indices shall be the average of the indices for the months falling within that period. c) The minimum wage of an unskilled mazdoor shall be the higher of the wage notified by Government of India, Ministry of Labour and that notified by the local administration both relevant to the place of work and the period of reckoning. d) The escalation for labour also shall be paid at the same quarterly intervals when escalation due to increase in cost of materials is paid under this clause. If such revision of minimum wages takes place during any such quarterly intervals, the escalation compensation shall be payable at revised rates only for work done in subsequent quarters; e) Irrespective of variations in minimum wages of any category of labour, for the purpose of this clause, the variation in the rate for an unskilled mazdoor alone shall form the basis for working out the escalation compensation payable on the labour component. iv. In the event the price of materials and / or wages of labour required for execution of the work decreases, there shall be a downward adjustment of the cost of work so that such price of materials and / or wages of labour shall be deductible from the cost of work under this contract and in this regard the formula herein stated below under this clause 10CC shall mutatis mutandis apply. v. The contract price shall be adjusted for increase or decrease in rates and prices of labour, cement, steel reinforcement bar, fuel and lubricants and other input materials as per percentage of materials / labour specified in schedule F and in accordance with the principles, procedures and formulae specified below:
--	------------------	--



	POL	a) Price adjustment for change in cost shall be paid in accordance with the following formula: i) For Construction:- $V_w = W * (1/100) * [C_p * (C_i - C_o) / C_o + L_p * (L_i - L_o) / L_o + CM_p * (CM_i - CM_o) / CM_o + EM_p * (EM_i - EM_o) / EM_o + F_p * (F_i - F_o) / F_o + S_p * (S_i - S_o) / S_o + B_p * (B_i - B_o) / B_o]$ ii) For Maintenance: $V_W = W * (1/100) * [L_p * (L_i - L_o) / L_o + CM_p * (CM_i - CM_o) / CM_o + EM_p * (EM_i - EM_o) / EM_o + B_p * (B_i - B_o) / B_o]$ Where, W=cost of work done as per para (ii) above. V_w (variation of cost of work) = Increase or decrease in the cost of works during the period under consideration due to change in the rates for relevant components. Percentage components of materials & labour as specified in the schedule F are defined as under :- C_p—Cement component, L_p—labour component, CM_p—Civil component of other construction materials, EM_p—E&M i/c IT and AS component of construction materials- F_p—POL (Diesel)-component S_p—Reinforcement steel bars / TMT bars / structural steel (including stands and cables) component. B_p—Bitumen component Indices for various components of materials & labour to be used for the purpose of this clause are defined as under: C_o—Wholesale price index for pozzolana cement published by office of the Economic adviser, Ministry of Industry & Commerce valid for the month of last date of receipt of tender including extension, if any. C_i—Wholesale price index for Pozzolans cement published by office of the Economic adviser, Ministry of Industry & Commerce for the period under consideration. L_o—Minimum daily wage in rupees of an unskilled adult mazdoor, fixed under any law, statutory rule or order as on the last date of receipt of tender including extension, if any. L_i—Minimum wage in rupees of an unskilled adult mazdoor, fixed under any law, statutory rule or order as applicable on the last date of the quarter
--	-------------------	---



	Labour	previous to the one under consideration. CM₀ = Price index for civil components of other construction materials valid for the month of the last date of receipt of tender including extension, if any, as published by AAI. CM₁ = Price index for Civil components of other construction materials for the period under consideration, as published by AAI. EM₀ = Price index for E&M components of construction materials valid for the month of the last date of receipt of tender including extension, if any, as published by AAI. EM₁ = Price index for E&M components of construction materials for the period under consideration, as published by AAI. F₀ = Wholesale Price Index of HSD (High Speed Diesel) published by office of the Economic Adviser, Ministry of Industry & Commerce valid for the month of the last date of receipt of tender including extension, if any. F₁ = Wholesale Price Index of HSD (High Speed Diesel) published by office of the Economic Adviser, Ministry of Industry & Commerce for the period under consideration. S₀ = Wholesale Price Index of Mild Steel long products published by office of the Economic Adviser, Ministry of Industry & Commerce valid for the month of the last date of receipt of tender including extension, if any. S₁ = Wholesale Price Index of Mild Steel long products published by office of the Economic Adviser, Ministry of Industry & Commerce for the period under consideration. B₀ = Wholesale Price Index of Bitumen published by office of the Economic Adviser, Ministry of Industry & Commerce valid for the month of the last date of receipt of tender including extension, if any. B₁ = Wholesale Price Index of Bitumen published by office of the Economic Adviser, Ministry of Industry & Commerce for the period under consideration.
--	---------------	---

CLAUSE 10 D

	Dismantled Material AAI Property	The Contractor shall treat all materials obtained during dismantling of a structure, excavation of the site for a work etc., as property of AAI and such materials shall be disposed off to the best advantage of Authority according to the instructions in writing issued by the Engineer-in-Charge.
--	---	--

CLAUSE 11

	Work to be executed in accordance with Specifications, Drawings, Orders etc.	The Contractor shall execute the whole and every part of the work in the most substantial and workmanlike manner both as regards materials and otherwise in every respect in strict accordance with the specifications. The Contractor shall also conform exactly, fully and faithfully to the design, drawings and instructions in writing in respect to the work signed by the Engineer-in-Charge and the Contractor shall be furnished free of charge one copy of the Contract documents together with specifications, designs, drawings and instructions as are not included in the standard specifications of Central Public Works Department specified in Schedule F or in any Bureau of Indian Standard or any other Published Standard or Code or Schedule of Rates or any other printed publication referred to elsewhere in the Contract. The Contractor shall comply with the provisions of the Contract and with the care and diligence execute and maintain the works and provide all labour and materials, tools and plants including for measurements and supervision of all works, structural plans and other things of temporary or permanent nature required for such execution and maintenance in so far as the necessity for providing these, is specified or is reasonably inferred from the Contract. The Contractor shall take full responsibility for adequacy suitability and safety of all the works and methods of construction.
--	---	---

CLAUSE 12

	Deviations / variations extent and pricing	The Engineer-in-Charge shall have power (i) to make alteration in, omissions from, additions to, or substitutions for the original specifications, drawings, designs and instructions that may appear to him to be necessary or advisable during the progress of the work, and (ii) to omit a part of the works in case of non-availability of a portion of the site or for any other reasons and the Contractor shall be bound to carry out the works in accordance with any instructions given to him in writing signed by the Engineer-in-Charge and such alterations, omissions, additions or substitutions shall form part of the Contract as if originally provided therein and any altered, additional or substituted work which the Contractor may be directed to do in the manner specified above as part of the works, shall be carried out by the Contractor on the same conditions in all respects including price on which he agreed to do the main work except as hereafter provided.
12.1		The time for completion of the works shall, in the event of any deviations resulting in additional cost over the tendered value being ordered, be extended, if requested by the Contractor, as follows: i. In the proportion which the additional cost of the altered, additional or substituted work, bears to the original tendered value plus ii. 25% of the time calculated in (i) above or such further additional time as may be considered reasonable by the Engineer-in-Charge.
12.2	Deviation, Extra Items and Pricing	In the case of extra item(s) (items that are completely new, and in addition to the items contained in the Contract) the Contractor may within fifteen days of receipt of order or occurrence of the item(s) claim rates, supported by proper analysis, for the work and the Engineer-in-Charge shall within Six weeks of the receipt of the claims supported by analysis, after giving consideration to the analysis of the rates submitted by the Contractor, determine the rates on the basis of the market rates and the Contractor shall be paid in accordance with the rates so determined.

	Deviation, Substituted Items Pricing	In the case of substituted items (items that are taken up with partial substitution or in lieu of items of work in the Contract), the rate for the agreement item (to be substituted) and substituted item shall also be determined in the manner as mentioned in the following Para. (i) If the market rate for the substituted item so determined is more than the market rate of the agreement item (to be substituted), the rate payable to the Contractor for the substituted item shall be the rate for the agreement item (to be substituted) so increased to the extent of the difference between the market rates of substituted item and the agreement item (to be substituted). (ii) If the market rate for the substituted item so determined is less than the market rate of the agreement item (to be substituted), the rate payable to the Contractor for the substituted item shall be the rate for the agreement item (to be substituted) so decreased to the extent of the difference between the market rates of substituted item and the agreement item (to be substituted).
	Deviation, Deviated Quantities, Pricing	In the case of Contract items, substituted items, Contract cum substituted items, which exceed the limits laid down in Schedule F, the Contractor may within fifteen days of receipt of order or occurrence of the excess, claim revision of the rates, supported by proper analysis for the work in excess of the above mentioned limits, provided that if the rates so claimed are in excess of the rates specified in the Schedule of Quantities, the Engineer-in-Charge shall within prescribed time limit of receipt of the claims supported by analysis, after giving consideration to the analysis of the rates submitted by the Contractor, determine the rates on the basis of the market rates and the Contractor shall be paid in accordance with the rates so determined.
12.3		The provisions of the preceding paragraph shall also apply to the decrease in the rates of items for the work in excess of the limits laid down in Schedule F, and the Engineer-in-Charge shall after giving notice to the Contractor within one month of occurrence of the excess and after taking into consideration any reply received from him within fifteen days of the receipt of the notice, revise the rates for the work in question within one month of the expiry of the said period of fifteen days having regard to the market rates.
12.4		The Contractor shall send to the Engineer-in-Charge once every three months, an up-to date account giving complete details of all claims for additional payments to which the Contractor may consider himself entitled and of all additional work ordered by the Engineer-in-Charge, which he has executed during the preceding quarter failing which the Contractor shall be deemed to have waived his right. However, the Executive Director Engineering may authorise consideration of such claims on merits.
12.5		For the purpose of operation of Schedule F, the following works shall be treated as works relating to foundation unless & otherwise defined in the Contract: - For Buildings: All works up-to 1.2 Metre above ground level or up to floor 1 level whichever is lower. - For abutments, piers and well staining: All works up to 1.2 m above the bed level. - For retaining walls, wing walls, compound walls, chimneys, overhead reservoirs/tanks and other elevated structures: All works up to 1.2 m above the ground level.

		iv. For roads, apron, runway & taxi-track all items of excavation, filling GSBC and including treatment of sub-base. v. For reservoirs/tanks (other than overhead reservoirs/tanks): All works up to 1.2 Metre above the ground level. vi. For basement: All works up to 1.2 m above ground level or up to floor 1 level whichever is lower.
12.6		Any operation incidental to or necessarily has to be in contemplation of tenderer while filing, tender, or necessary for proper execution of the item included in the Schedule of Quantities or in the Schedule of Rates mentioned above, whether or not, specifically indicated in the description of the item and the relevant specifications, shall be deemed to be included in the rates quoted by the tenderer or the rate given in the said Schedule of Rates, as the case may be. Nothing extra shall be admissible for such operations.

CLAUSE 13

	Foreclosure of Contract due to Abandonment or Reduction in Scope of Work	If at any time after acceptance of the tender or during the progress of work the purpose or object for which the work is being done changes due to any supervening cause and as a result of which the work has to be abandoned or reduced in scope the Engineer-in-Charge shall give notice in writing to that effect to the Contractor and the Contractor stating the decision as well as the cause for such decision and the Contractor shall act accordingly in the matter. The Contractor shall have no claim to any payment of compensation or otherwise whatsoever, on account of any profit or advantage which he might have derived from the execution of the works in full but which he did not derive in consequence of the foreclosure of the whole or part of the works. The Contractor shall be paid at Contract rates, full amount for works executed at site and, in addition, a reasonable amount as certified by the Engineer-in-Charge for the items hereunder mentioned which could not be utilized on the work to the full extent in view of the foreclosure; i. Any expenditure incurred on preliminary site work, e.g. temporary access roads, temporary labour huts, staff quarters and site office, storage accommodation and water storage tanks. ii. AAI shall have the option to take over Contractor's materials or any part thereof either brought to site or of which the Contractor is legally bound to accept delivery from suppliers (for incorporation in or incidental to the work) provided, however AAI shall be bound to take over the materials or such portions thereof as the Contractor does not desire to retain. For materials taken over or to be taken over by AAI, cost of such materials as detailed by Engineer-in-Charge shall be paid. The cost shall, however, take into account purchase price, cost of transportation and deterioration or damage which may have been caused to materials whilst in the custody of the Contractor. iii. If any materials supplied by AAI are rendered surplus, the same except normal wastage shall be returned by the Contractor to AAI at rates not exceeding those at which these were originally issued, less allowance for any deterioration or damage which may have been caused whilst the materials were in the custody of the Contractor. In addition, cost of transporting such materials from site to AAI stores, if so required by AAI, shall be paid.
--	--	--

		iv. Reasonable compensation for transfer of T & P from site to Contractor's permanent stores or to his other works, whichever is less. If T & P are not transported to either of the said places, no cost of transportation shall be payable. v. Reasonable compensation for repatriation of Contractor's site staff and imported labour to the extent necessary. The Contractor shall, if required by the Engineer-in-Charge, furnish to him, books of account, wage books, time sheets and other relevant documents and evidence as may be necessary to enable him to certify the reasonable amount payable under this condition. The reasonable amount of items on (i), (iv) and (v) above shall not be in excess of 2% of the cost of the work remaining incomplete on the date of closure, i.e. total stipulated cost of the work as per accepted tender less the cost of work actually executed under the Contract and less the cost of Contractor's materials at site taken over by the AAI as per item (ii) above. Provided always that against any payments due to the Contractor on this account or otherwise, the Engineer-in-Charge shall be entitled to recover or be credited with any outstanding balances due from the Contractor for advance paid in respect of any tool, plants and materials and any other sums which at the date of termination were recoverable by the AAI from the Contractor under the terms of the Contract. In the event of action being taken under Clause 13 to reduce the scope of work, the Contractor may furnish fresh Performance Guarantee on the same conditions, in the same manner and at the same rate for the balance tendered amount and initially valid up-to the extended date the completion or stipulated date of completion if no extension has been granted plus 180 days beyond that. Wherever, such a fresh Performance Guarantee is furnished by the Contractor, the Engineer-in-Charge may return the previous Performance Guarantee.
--	--	---

CLAUSE 14

	Carrying out part Work at risk & cost of Contractor	a) If Contractor: - At any time makes default during currency of work or does not execute any part of the work with due diligence and continues to do so even after a notice in writing of 7 days in this respect from the Engineer-in-Charge; or - Commits default in complying with any of the terms and conditions of the Contract and does not remedy it or takes effective steps to remedy it within 7 days even after a notice in writing is given in that behalf by the Engineer-in-Charge; or - Fails to complete the work(s) or items of work with individual dates of completion, on or before the date(s) so determined, and does not complete them within the period specified in the notice given in writing in that behalf by the Engineer-in-Charge; b) The Engineer-in-Charge without invoking action under Clause 3 may, without prejudice to any other right or remedy against the Contractor which have either accrued or accrue thereafter to AAI, by a notice in writing to take the part work/part incomplete work of any item(s) out of his hands and shall have power to: - Take possession of the site and any materials, constructional plant, implements, stores etc., thereon; and/or - Carry out the part work/part incomplete work of any item(s) by any means at the risk and cost of the Contractor.
--	---	---

		c. The Engineer-in-Charge shall determine the amount, if any, is recoverable from the Contractor for completion of the part work/part incomplete work of any item(s) taken out of his hands and executed at the risk and cost of the Contractor, the liability of Contractor on account of loss or damage suffered by AAI because of action under this Clause shall not exceed 10% of the tendered value of the work. d. In determining the amount, credit shall be given to the Contractor with the value of work done in all respect in the same manner and at the same rate as if it had been carried out by the original Contractor under the terms of his Contract, the value of Contractor's materials taken over and incorporated in the work and use of plant and machinery belonging to the Contractor. The certificate of the Engineer-in-Charge as to the value of work done shall be final and conclusive against the Contractor provided always that action under this Clause shall only be taken after giving notice in writing to the Contractor. Provided also that if the expenses incurred by the department are less than the amount payable to the Contractor at his agreement rates, the difference shall not be payable to the Contractor. e. Any excess expenditure incurred or to be incurred by AAI in completing the part work/part incomplete work of any item(s) or the excess loss of damages suffered or may be suffered by AAI as aforesaid after allowing such credit shall without prejudice to any other right or remedy available to AAI in law or per as agreement be recovered from any money due to the Contractor on any account, and if such money is insufficient, the Contractor shall be called upon in writing and shall be liable to pay the same within 30 days. f. If the Contractor fails to pay the required sum within the aforesaid period of 30 days, the Engineer-in-Charge shall have the right to sell any or all of the Contractor's unused materials, constructional plant, implements, temporary building at site etc. and adjust the proceeds of sale thereof towards the dues recoverable from the Contractor under the Contract and if thereafter there remains any balance outstanding, it shall be recovered in accordance with the provisions of the Contract/provisions of law. In the event of above course being adopted by the Engineer-in-Charge, the Contractor shall have no claim to compensation for any loss sustained by him by reason of his having purchased or procured any materials or entered into any engagements or made any advance on any account or with a view to the execution of the work or the performance of the Contract.
--	--	---

CLAUSE 15

	Suspension of Work	i. The Contractor shall, on receipt of the order in writing of the Engineer-in-Charge, (whose decision shall be final and binding on the Contractor) suspend the progress of the works or any part thereof for such time and in such manner as the Engineer-in-Charge may consider necessary so as not to cause any damage or injury to the work already done or endanger the safety thereof for any of the following reasons: - on account of any default on the part of the Contractor; - for proper execution of the works or part thereof for reasons other than the default of the Contractor; or - for safety of the works or part thereof. The Contractor shall, during such suspension, properly protect and secure the works to the extent necessary and carry out the instructions given in that behalf by the Engineer-in-Charge.
--	---------------------------	--

		ii. If the suspension is ordered for reasons (b) and (c) in sub-para (i) above (but not attributed to Contractor): - the Contractor shall be entitled to an extension of time equal to the period of every such suspension PLUS 25% for completion of the item or group of items of work for which a separate period of completion is specified in the Contract and of which the suspended work forms a part, and; - If the total period of all such suspensions in respect of an item or group of items or work for which a separate period of completion is specified in the Contract exceeds thirty days, the Contractor shall, in addition, be entitled to such compensation as the Engineer-in-Charge may consider reasonable in respect of salaries and/or wages paid by the Contractor to his employees and labour at site, remaining idle during the period of suspension, adding thereto 2% to cover indirect expenses of the Contractor provided the Contractor submits his claim supported by details to the Engineer-in-Charge within fifteen days of the expiry of the period of 30 days. - If the works or part thereof is suspended on the orders of the Engineer-in-Charge for more than three months at a time, except when suspension is ordered for reasons (a) in sub-para (i) above, the Contractor may after receipt of such order serve a written notice on the Engineer-in-Charge requiring permission within fifteen days from receipt by the Engineer-in-Charge of the said notice, to proceed with the work or part thereof in regard to which progress has been suspended and if such permission is not granted within that time, the Contractor, if he intends to treat the suspension, where it affects only a part of the works as an omission of such part by AAI or where it affects whole of the works, as an abandonment of the works by AAI, shall within ten days of expiry of such period of 15 days give notice in writing of his intention to the Engineer-in-Charge. In the event of the Contractor treating the suspension as an abandonment of the Contract by AAI, he shall have no claim to payment of any compensations on account of any profit or advantage which he might have derived from the execution of the work in full but which he could not derive in consequence of the abandonment. He shall, however, be entitled to such compensation, as the Engineer-in-Charge may consider reasonable, in respect of salaries and/or wages paid by him to his employees and labour at site, remaining idle in consequence adding to the total thereof 2% to cover indirect expenses of the Contractor provided the Contractor submits his claim supported by details to the Engineer-in-Charge within 30 days of the expiry of the period of 3 months.
--	--	--

CLAUSE 15 A

Compensation in case of delay due to late supply of stipulated material by AAI.	The Contractor shall not be entitled to claim any compensation from AAI for the losses suffered by him on account of delay by AAI in the supply of materials in Schedule 'B' where such delay is covered by the difficulties relating to supply of wagons, force majeure or any reasonable cause beyond the control of AAI. This Clause 15 A will not be applicable for works where no material is stipulated for issue by AAI.
--	---

CLAUSE 16

	Action in case Work not done as per Specifications	All works under or in course of execution or executed in pursuance of the Contract, shall at all times be open and accessible to the inspection and supervision of the Engineer-in-Charge, his authorized subordinates in charge of the work and all the superior officers, officer of the Quality Assurance Unit of the AAI or any organization engaged by the Department of Quality Assurance and of the Chief Technical Examiner's Office, and the Contractor shall, at all times, during the usual working hours and at all other times at which reasonable notice of the visit of such Officers has been given to the Contractor, either himself be present to receive orders and instructions or have a responsible agent duly accredited in writing, present for that purpose. Orders given to the Contractor's agent shall be considered to have the same force as if they had been given to the Contractor himself. If it shall appear to the Engineer-in-Charge or his authorized subordinates in charge of the work or to the Executive Director-In-charge of Quality Assurance or his subordinate officers or the officers of the organization engaged by the AAI for Quality Assurance or to the Chief Technical Examiner or his subordinate officers, that any work has been executed with unsound, imperfect, or unskillful workmanship, or with materials or articles provided by him for the execution of the work which are unsound or of a quality inferior to that Contracted or otherwise not in accordance with the Contract, the Contractor shall, on demand in writing which shall be made within twelve months (six months in the case of work costing Rs.10 lac and below except road work) of the completion of the work from the Engineer-in-Charge specifying the work, materials or articles complained of notwithstanding that the same may have been passed, certified and paid for forthwith rectify, or remove and reconstruct the work so specified in whole or in part, as the case may require or as the case may be, remove the materials or articles so specified and provide other proper and suitable materials or articles at his own charge and cost. In the event of the failing to do so within a period specified by the Engineer-in-Charge in his demand aforesaid, then the Contractor shall be liable to pay compensation at the same rate as under Clause 2 of the Contract (for non-completion of the work in time) for this default. In such case the Engineer-in-Charge may not accept the item of work at the rates applicable under the Contract but may accept such items at reduced rates as the authority specified in Schedule 'F' may considered reasonable during the preparation of on account bills or final bill if the item is so acceptable without detriment to the safety and utility of the item and the structure or he may reject the work outright without any payment and/or get it and other connected and incidental items rectified, or removed and re-executed at the risk and cost of the Contractor. Decision of the Engineer-in-Charge to be conveyed in writing in respect of the same will be final and binding on the Contractor.
--	---	--

CLAUSE 17

	Contractor Liable for Damages, defects during maintenance period	If the Contractor or his working people or servants shall break, deface, injure or destroy any part of building in which they may be working, or any building, road, road kerb fence, enclosure, water pipe, cables, drains, electric or telephone post or wires, trees, grass or grassland, or cultivated ground contiguous to the premises on which the work or any part is being executed, or if any damage shall happen to the work while in progress, from any cause whatever or if any defect, shrinkage or other faults appear in the work within twelve months (six months in the case of work costing Rs. Ten lacs and below except road work) after a certificate final or otherwise of its completion shall have been given by
--	---	--



	the Engineer-in-Charge as aforesaid arising out of defect or improper materials or workmanship the Contractor shall upon receipt of a notice in writing on that behalf make the same good at his own expense or in default, the Engineer-in-Charge cause the same to be made good by other workmen and deduct the expense from any sums that may be due or at any time thereafter may become due to the Contractor, or from his security deposit or the proceeds of sale thereof or of a sufficient portion thereof. The security deposit of the Contractor shall not be refunded before the expiry of twenty four months (six months in the case of work costing Rs.Ten lacs and below except road work) after the issue of the certificate final or otherwise, of completion of work, or till the final bill has been prepared and passed whichever is later. Provided that in the case of road work, if in the opinion of the Engineer-in-Charge, half of the security deposit is sufficient, to meet all liabilities of the Contractor under this Contract, half of the security deposit will be refundable after six months and the remaining half after twelve months of the issue of the said certificate of completion or till the final bill has been prepared and passed whichever is later. In case of Maintenance and Operation works of E&M services, the security deposit deducted from Contractors shall be refunded within Six Month from the date of final payment or within Six Month from the date of completion of the maintenance Contract whichever is earlier after completion of DLP.
--	---

CLAUSE 18

Contractor to Supply Tools & Plants etc.	The Contractor shall provide at his own cost all materials (except such special materials, if any, as may in accordance with the Contract be supplied from the Engineer-in-Charge's stores) machinery, tools & plants as specified in Schedule F. In addition to this, appliances, implements, other plants, ladders, cordage, tackle, scaffolding and temporary works required for the proper execution of the work, whether original, altered or substituted and whether included in the specifications or other documents forming part of the Contract or referred to in these conditions or not, or which may be necessary for the purpose of satisfying or complying with the requirements of the Engineer-in-Charge as to any matter as to which under these conditions he is entitled to be satisfied, or which he is entitled to require together with carriage therefor to and from the work. The Contractor shall also supply without charge the requisite number of persons with the means and materials, necessary for the purpose of setting out works, and counting, weighing and assisting the measurement for examination at any time and from time to time of the work or materials. Failing his so doing, the same may be provided by the Engineer-in-Charge at the expense of the Contractor and the expenses may be deducted, from any money due to the Contractor, under this Contract or otherwise and/or from his security deposit or the proceeds of sale thereof, or of a sufficient portions thereof.
---	--

CLAUSE 18 A

Recovery of Compensation paid to Workmen	In every case in which by virtue of the provisions Sub-Section (i) of Section 12, of the Workmen's Compensation Act, 1923, AAI is obliged to pay compensation to a workman employed by the Contractor, in execution of the works, AAI will recover from the Contractor, the amount of the compensation so paid, and, without prejudice to the rights of the AAI under Sub-Section (2) of Section 12, of the said act, AAI shall be at liberty to recover such amount or any part thereof by deducting it from the security deposit or from any sum due by AAI to the Contractor whether under this Contract or otherwise. AAI shall not be bound to
---	--

		contest any claim made against it under Sub-Section (1) of Section 12, of the said Act, except on the written request of the Contractor and upon his giving to AAI full security for all costs for which AAI might become liable in consequence of contesting such claim.
--	--	---

CLAUSE 18 B

	Ensuring Payment and Amenities to Workers if Contractor fails	In every case in which by virtue of the provisions of the Contract Labour (Regulation and Abolition) Act 1970, and the Contract Labour (Regulation and Abolition) Central Rules, 1971, AAI is obliged to pay any amounts of wages to a workman employed by the Contractor in execution of the works, or to incur any expenditure in providing welfare and health amenities required to be provided under the above said Act and the Rules under Clause 19H or under the AAI Contractor's Labour Regulations or under the Rules framed by AAI from time to time for the protection of health and sanitary arrangements for workers employed by AAI Contractors, AAI will recover from the Contractor the amount of wages so paid or the amount of expenditure so incurred and without prejudice to the rights of the AAI under Sub Section (2) of Section 20, Sub Section (4) of Section 21, of the Contract Labour (Regulation and Abolition) Act, 1970, AAI shall be at liberty to recover such amount or any part thereof by deducting it from the security deposit or from any sum due by AAI to the Contractor whether under this Contract or otherwise AAI shall not be bound to contest any claim made against it under Sub Section (1) of Section 20, Sub Section (4) of Section 21, of the said Act, except on the written request of the Contractor and upon his giving to the AAI full security for all costs for which AAI might become liable in contesting such claim.
--	--	---

CLAUSE 19

	Labour Laws to be complied by the Contractor	The Contractor shall obtain a valid License under the Contract Labour (R&A) Act, 1970 and the Contract Labour (Regulation and Abolition) Central Rules, 1971, before the commencement of the work, and continue to have a valid License until the completion of the work. The Contractor shall also abide by the provisions of the Child Labour (Prohibition and Regulation) Act, 1986. The Contractor shall also comply with the provisions of the Building and Other Construction Workers (Regulation of Employment & Conditions of Service) Act, 1996 and the Building and Other Construction Workers Welfare Cess Act, 1996. Any failure to fulfill these requirements shall attract the penal provisions of this Contract arising out of the resultant non execution of the work.
--	---	---

CLAUSE 19 A

		No Labour below the age of fourteen years shall be employed on the work.
--	--	--

CLAUSE 19 B

	Payment of Wages	Payment of Wages: i The Contractor shall pay to labour employed by him either directly or through Sub-Contractors, wages not less than Fair Wages as defined in the AAI Contractor's Labour Regulation or as per the provisions of the Contract Labour (Regulation and Abolition) Act, 1970 and the Contract labour (Regulation and Abolition) Central Rules, 1971 wherever applicable. ii The Contractor shall, notwithstanding the provisions of any Contract to the contrary, cause to be paid fair wage to labour indirectly engaged on the work,
--	-------------------------	--

		including any labour engaged by his Sub Contractors in connection with the said work, as if the labour had been immediately employed by him. iii. In respect of all labour directly or indirectly employed in the works for performance of the Contractor's part of this Contract, the Contractor shall comply with or cause to be complied with the Airports Authority of India Contractor's Labour Regulations made by AAI from time to time in regard to payment of wages, wage period, deductions from wages, recovery of wages not paid and deductions unauthorisedly made, maintenance of wage books or wage slips, publication of scale of wages and other terms of employment, inspection and submission of periodical returns and all other matters of the like nature or as per the provisions of the Contract Labour (Regulation and Abolition) Act, 1970 and the Contract Labour (Regulation and Abolition) Central Rules, 1971, wherever applicable. iv. The following deductions shall be permissible to be made by the Engineer in Charge. a. The Engineer in Charge concerned shall have the right to deduct from the moneys due to the Contractor or any sum required or estimated to be required for making good the loss suffered by a worker or workers by reason of non-fulfillment of the conditions of the Contract for the benefit of the workers, nonpayment of wages or of deductions made from his or their wages which are not justified by their terms of the Contract or non-observance of the Regulations. b. Under the provision of Minimum Wages (Central) Rule 1950 the Contractor is bound to allow to the labours directly or indirectly employed in the works one day rest for 6 days continuous work and pay wages at the same rate as for duty. In the event of default, the Engineer in Charge shall have the right to deduct the sum or sums not paid on account of wages for weekly holidays to any labours and pay the same to the persons entitled thereto from any money due to the Contractor by the Engineer in Charge concerned. In the case of Union Territory of Delhi, however, as the all inclusive minimum daily wages fixed under Notification of the Delhi Administration No.F.12(162)MWO/DAB/43884-91, dated 31.12.1979 as amended from time to time are inclusive of wages for the weekly day of rest, the question of extra payment for weekly holiday would not arise. v. The Contractor shall comply with the provisions of the Payment of Wages Act, 1936, Minimum Wages Act, 1948, Employees Liability Act, 1938, Workmen's Compensation Act, 1923, Industrial Disputes Act, 1947, Maternity Benefits Act, 1961, and the Contractor's Labour (Regulation and Abolition) Act 1970, or the modifications thereof or any other laws relating thereto and the rule made thereunder from time to time. vi. The Contractor shall indemnify and keep indemnified Authority against payments to be made under and for the observance of the laws aforesaid and the AAI Contractor's Labour Regulations without prejudice to his right to claim indemnity from his Sub Contractors. vii. The laws aforesaid shall be deemed to be a part of this Contract and any breach thereof shall be deemed to be a breach of this Contract. viii. Whatever is the Minimum Wage for the time being, or if the wage payable is higher than such wage, such wage shall be paid by the Contractor to the workmen directly without the intervention of Jamadar and that Jamadar shall not be entitled to deduct or recover any amount from the Minimum Wage payable to the workmen as and by way of commission or otherwise.
--	--	--

		ix. The Contractor shall ensure that no amount by way of commission or otherwise is deducted or recovered by the Jamadar from the wage workmen.
--	--	---

CLAUSE 19 C

		In respect of all labour directly or indirectly employed in the work for the performance of the Contractor's part of this Contract, the Contractor shall at his own expense arrange for the safety provisions as per AAI Safety Code framed from time to time and shall at his own expense provide for all facilities in connection therewith. In case the Contractor fails to make arrangement and provide necessary facilities as aforesaid, he shall be liable to pay a penalty of Rs. 200/- for each default and in addition, the Engineer-in-Charge shall be at liberty to make arrangement and provide facilities as aforesaid and recover the costs incurred in that behalf from the Contractor.
--	--	---

CLAUSE 19 D

		The Contractor shall submit by the 4th and 19th of every month, to the Engineer-in-Charge a true statement showing in respect of the second half of the preceding month and the first half of the current month respectively: - the number of labourers employed by him on the work, - their working hours, - the wages paid to him, - the accidents that occurred during the said fortnight showing the circumstances under which they happened and the extent of damage and injury caused by them, and - the number of female workers who have been allowed maternity benefit according to Clause 19F and the amount paid to them. Failing which the Contractor shall be liable to pay to AAI, a sum not exceeding Rs. 200/- for each default or materially incorrect statement. The decision of the Engineer-in-Charge shall be final in deducting from any bill due to the Contractor; the amount levied as fine and shall be binding on the Contractor.
--	--	--

CLAUSE 19 E

		In respect of all labour directly or indirectly employed in the works for the performance of the Contractor's part of this Contract, the Contractor shall comply with or cause to be complied with all the rules framed by AAI from time to time for the protection of health and sanitary arrangements for workers employed by the AAI and its Contractor.
--	--	---

		Leave and pay during leave shall be regulated as follows: 1. Leave: i. In the case of delivery — maternity leave not exceeding 8 weeks, 4 weeks up to and including the day of delivery and 4 weeks following that day. ii. In the case of miscarriage — up to 3 weeks from the date of miscarriage. 2. Pay: i. In the case of delivery — leave pay during maternity leave will be at the rate of women's average daily earnings, calculated on total wages earned on the days when full time work was done during a period of three months immediately preceding the date on which she gives notice that she expects to be confined or at the rate of Rupee one only a day whichever is greater. ii. In the case of miscarriage — leave pay at the rate of average daily earning
		calculated on the total wages earned on the days when full time work was done during a period of three months immediately preceding the date of such miscarriage. 3. Conditions for the grant of Maternity Leave: No maternity leave benefit shall be admissible to a woman unless she has been employed for a total period of not less than six months immediately preceding the date on which she proceeds on leave. 4. The Contractor shall maintain a register of Maternity (Benefit) in the Prescribed Form as shown in Appendix — III and IV, and the same shall be kept at the place of work.



		In the event of the Contractor(s) committing a default or breach of any of the provisions of the Airports Authority of India Contractor's Labour Regulations and Model Rules for the protection of health and sanitary arrangements for the workers as amended from time to time or furnishing any information or submitting or filling any statement under the provisions of the above Regulations and Rules which is materially incorrect, he/they shall, without prejudice to any other liability, pay to the AAI a sum not exceeding Rs.200/- for every default, breach or furnishing, making, submitting, filing such materially incorrect statements and in the event of the Contractor(s) defaulting continuously in this respect, the penalty may be enhanced to Rs.200/- per day for each day of default subject to a maximum of 5 per cent of the estimated cost of the work put to tender. The decision of the Engineer in Charge shall be final and binding on the parties. Should it appear to the Engineer in Charge that the Contractor(s) is/are not properly observing and complying with the provision of the AAI Contractor's Labour Regulations and Model Rules and the provisions of the Contract Labour (Regulation and Abolition) Act 1970, and the Contract Labour (R&A) Central Rules 1971, for the protection of health and sanitary arrangements for work-people employed by the Contractor(s) (hereinafter referred as "the said Rules") the Engineer in Charge shall have power to give notice in writing to the Contractor(s) requiring that the said Rules be complied with and the amenities prescribed therein be provided to the work people within a reasonable time to be specified in the notice. If the Contractor(s) shall fail within the period specified in the notice to comply with and/observe the said Rules and to provide the amenities to the work people as aforesaid, the Engineer in Charge shall have the power to provide the amenities hereinbefore mentioned at the cost of the Contractor(s). The Contractor(s) shall erect, make and maintain at his/their own expense and to approved standards all necessary huts and sanitary arrangements required for his/their work people on the site in connection with the execution of the works, and if the same shall not have been erected or constructed, according to approved standards, the Engineer in Charge shall have power to give notice in writing to the Contractor(s) requiring that the said huts and sanitary arrangements be remodeled and/or reconstructed according to approved standards, and if the Contractor(s) shall fail to remodel or reconstruct such huts and sanitary arrangements according to approved standards within the period specified in the notice, the Engineer in Charge shall have the power to remodel or reconstruct such huts and sanitary arrangements according to approved standards at the cost of the Contractor(s).
--	--	---

CLAUSE 19 H

		The Contractor(s) shall at his/their own cost provided his/their labour with a sufficient number of huts (hereinafter referred to as the camp) on the following specifications on a suitable plot of land to be approved the Engineer in Charge. i. Facility to be provided a. The minimum height of each hut at the eaves level shall be 2.10m (7ft.) and the floor area to be provided will be at the rate of 2.7 sq.m. (30 sq.ft.) for each member of the worker's family staying with the labourer. b. The Contractor shall in addition construct suitable cooking places having a minimum area of 1.80m x 1.50m (6' x 5') adjacent to the hut for each family.
		c. The Contractor(s) shall also construct temporary latrines and urinals for the use of the labourers each on the scale of not less than four per each one hundred of the total strength, separate latrines and urinals being provided for women. d. The Contractor (s) shall construct sufficient number of bathing and washing places one unit for every 25 persons residing in the camp. These bathing and washing places shall be suitably screened. ii. Specifications a. All the huts shall have walls of sun-dried or burnt bricks laid in mud mortar or other suitable local materials as may be approved by the Engineer in Charge in case of sun-dried bricks, the walls should be plastered with mud gobri on both sides. The floor may be kutcha but plastered with mud gobri and shall be at least 15 cm (6") above the surrounding ground. The roofs shall be laid with the thatch or any other materials as may be approved by the Engineer in Charge and the Contractor shall ensure that throughout the period of their occupation, the roofs remain water-tight. b. The Contractor (s) shall provide each hut with proper ventilation. c. All doors, windows and ventilators shall be provided with suitable leaves for security purposes. d. There shall be kept an open space of at least 7.2 m (8 yards) between the rows of huts which may be reduced to 6m (20 ft.) according to the availability of site with the approval of the Engineer in Charge. Back to back construction will be allowed. iii. Water Supply The Contractor(s) shall provide adequate supply of water for the use of labourers. The provisions shall not be less than two gallons of pure and wholesome water per head per day for drinking purposes and three gallons of clean water per head per day for bathing and washing purposes. Where piped water supply is available supply shall be at stand posts and where the supply is from wells or river, tanks which may be of metal or masonry, shall be provide. The Contractor(s) shall also at his/their own cost make arrangements for laying pipe lines for water supply to his/their labour camp from the existing mains wherever available and shall pay all fees and charges therefor. iv. The site selected for the camp shall be high ground, removed from jungle. v. Disposal of Excreta: The Contractor(s) shall make necessary arrangement for the disposal of excreta from the latrines by trenching or incineration which shall be according to the requirements laid down by the Local Health Authorities. If trenching or incineration is not allowed, the Contractor(s) shall make arrangements for the removal of the excreta through the Municipal Committee/authority and inform it about the number of labourers employed so that arrangements may be made by such Committee/authority for the removal of excreta. All charges on this account shall be borne by the Contractor and paid direct by him to the

		Municipality/authority. The Contractor shall provide one sweeper for every eight seats in case of dry system. vi. Drainage The Contractor (s) shall provide efficient arrangements for draining away sullage water so as to keep the camp neat and tidy. vii. The Contractor (s) shall make necessary arrangements for keeping the camp area sufficiently lighted to avoid accidents to the workers. viii. Sanitation The Contractor(s) shall make arrangements for conservancy and sanitation in the labour camps according to the rules of the Local Public Health and Medical Authorities.
--	--	---

CLAUSE 19 I

		The Engineer-in-Charge may require the Contractor to dismiss or remove from the site of the work any person or persons in the Contractors' employ upon the work who may be incompetent or misconduct himself and the Contractor shall forthwith comply with such requirements. In respect of maintenance/repair or renovation works etc. where the labour have an easy access to the individual work premises, the Contractor shall issue identity cards to the labourers, whether temporary or permanent and he shall be responsible for any untoward action on the part of such labour. Assistant Manager/Junior Executive will display a list of Contractors working in the colony/Blocks on the notice board in the colony and also at the service centre, to apprise the residents about the same.
--	--	--

CLAUSE 19 J

		It shall be the responsibility of the Contractor to see that the building under construction is not occupied by anybody unauthorized during execution of work construction, and is handed over to the Engineer in Charge with vacant possession of site complete building. If such building though completed is occupied illegally, then the Engineer in Charge shall have the option to refuse to accept the said building/buildings in that position. Any delay in acceptance on this account will be treated as the delay in completion and for such delay, a levy up to 5% of tendered value of work may be imposed by the General Manager Engg. Whose decision shall be final both with regard to the justification and quantum and be binding on the Contractor. However, the Executive Director Engg., through a notice may require the Contractor to remove the illegal occupation any time on or before construction and delivery.
--	--	--

CLAUSE 19 K

	Employment of skilled / semiskilled workers	The Contractor shall at all stages of work deploy skilled/semi-skilled tradesmen who are qualified and possess certificate in particular trade from CPWD Training Institute/Industrial Training Institute/National Institution of Construction Management and research (NICMAR) National Academy of Construction, CIDC or any similar reputed and recognized Institute managed/certified by State/Central Government. The number of such qualified tradesmen shall not be less than 20% of total skilled/semi-skilled workers required in each trade at any stage of work. The Contractor shall submit number of man days required in respect of each trade, its scheduling and the list of qualified tradesmen along with requisite certificate from recognized Institute to Engineer in charge for approval. Notwithstanding such approval, if the tradesmen are found to have inadequate skill to execute the work of
--	---	---

		respective trade, the Contractor shall substitute such tradesmen within two days of written notice from Engineer in Charge. Failure on the part of Contractor to obtain approval of Engineer in Charge or failure to deploy qualified tradesmen will attract a compensation to be paid by Contractor at the rate of Rs.100 per such tradesman per day. Decision of Engineer in Charge as to whether particular tradesman possesses requisite skill and amount of compensation in case of default shall be final and binding. Provided always, that the provision of this Clause, shall not be applicable for works with estimated cost put to tender being less than Rs.5 Crores.
--	--	---

CLAUSE 19 L

	Contribution of EPFO and ESIC	The ESI and EPF contribution on the part of employer in respect of this contract shall be paid by the contractor. These contributions on the part of the employer paid by the contractor shall be reimbursed by the Engineer In Charge to the contractor on actual basis. The verification of deployment of labour will be done through biometric attendance system or any other suitable method by the Engineer in charge. The applicable and eligible amount of EPF & ESI shall be reimbursed preferably within 7 days but not later than 30 days of submission of documentary proof of payment provided same are in order.
--	--------------------------------------	--

CLAUSE 19 M

	Compliance of NGT Guidelines	The Contractor is required to follow latest NGT Guidelines at the construction site and any violation of such Guidelines will be in his account.
--	-------------------------------------	---

CLAUSE 20

	Minimum Wages Act to be Complied with	The Contractor shall comply with all the provision of the Minimum Wages Act, 1948, and Contract Labour (Regulation and Abolition) Act, 1970 amended from time to time and rules framed thereunder and other labour laws affecting Contract labour that may be brought into force from time to time.
--	--	--

CLAUSE 20(A)

	Employees Provident Fund & Miscellaneous Provisions Act 1952/Jammu & Kashmir Employees Provident Funds (and Miscellaneous Provisions) Act, 1961 and State Insurance (ESI) Act, 1948.	The Contractor shall comply with all the provisions of the Employees Provident Fund & Misc. Provisions Act, 1952/Jammu & Kashmir Employees Provident Funds (and Miscellaneous Provisions) Act, 1961 and ESI Act, 1948, amended from time to time and rules framed thereunder. Some of the provisions are given below: - The Contractor shall intimate his PF Account Code No. allotted by Regional PF Commissioner and ESI Registration No. allotted by ESI Corporation after award of work and shall continue to have valid PF Account Code No. and ESI Registration No. till actual completion of the Contract. - The Contractor shall provide a list of Contract Workers engaged for Contract work along with their PF Account No. & ESI Registration No. - The Contractor by 20th of every month shall provide a monthly statement showing recoveries of contribution and proof of remittance of provident fund contribution to RPFC and ESI contributions to ESI Corporation in respect of Workers engaged in Contract work. - The Contractor shall provide copies of PF & ESI challans of monthly contributions in respect of Contract workers engaged for Contract work on month to month basis. AAI reserves the right to withhold minimum amount as detailed under, from the
--	---	--

		running account payments, if PF/ESI contributions are not paid by the Contractor and proof to that effect have not been produced regularly on due dates. To withhold 3% for building work & 1.5% for road/pavement work of the total amount of work done during the period considered.
		ESI & EPF amount paid to the statutory authorities by the Contractor shall be reimbursed on actual basis on submission of documentary evidence.

CLAUASE 21

	Work not to be sublet. Action in case of insolvency	The Contract shall not be assigned or sublet without the written approval of Engineer-in-Charge. And if the Contractor shall assign or sublet his contract, or attempt to do so, or become insolvent or commence any insolvency proceedings or make any composition with his creditors or attempt to do so, or if any bribe, gratuity, gift, loan, perquisite, reward or advantage pecuniary or otherwise, shall either directly or indirectly, be given, promised or offered by the Contractor, or any of his servants or agent to any public officer or person in the employ of AAI in any way relating to his office or employment, or if any such officer or person shall become in any way directly or indirectly interested in the Contract, the Engineers in Charge on behalf of the AAI shall have power to adopt the courses specified in Clause 3 hereof in the interest of AAI and in the event of such course being adopted, the consequences specified in the said Clause 3 shall ensue.
--	--	---

CLAUASE 22

		All sums payable by way of compensation under any of these conditions shall be considered as reasonable compensation to be applied to the use of AAI without reference to the actual loss or damage sustained and whether or not any damages shall have been sustained.
--	--	---

CLAUSE 23

	Changes in firm's Constitution to be intimated	Where the Contractor is a partnership firm, the previous approval in writing of the Engineer-in-Charge shall be obtained before any change is made in the constitution of the firm. Where the Contractor is an individual or a Hindu undivided family business concern such approval as aforesaid shall likewise be obtained before the Contractor enters into any partnership agreement where under the partnership firm would have the right to carry out the works hereby undertaken by the Contractor. If previous approval as aforesaid is not obtained, the Contract shall be deemed to have been assigned in contravention of Clause 21 hereof and the same action may be taken and the same consequences shall ensue as provided in the said Clause 21.
--	---	---

CLAUSE 24

		All works to be executed under the Contract shall be executed under the direction and subject to the approval in all respects of the Engineer-in-Charge who shall be entitled to direct at what point or points and in what manner they are to be commenced, and from time to time carried on.
--	--	--

CLAUSE 25

Dispute Resolution Mechanism and Arbitration	Dispute Resolution Clause All disputes or differences which may arise out of or in connection with or incidental to the Agreement(s) including any dispute or difference regarding the interpretation of terms and conditions of any clause(s) thereof shall be dealt with as provided hereinafter: i. Through Mediation: All dispute(s), at the first instance, shall be referred to the Mediation Committee of Independent Experts (MCIE) or individual mediator for mediation as per AAI Mediation Policy and applicable laws. All cost of mediation, shall be borne equally by the parties. In case either party withdraws from the Mediation or the dispute(s) is not resolved within 120 days of reference to the Mediation, then the aggrieved party may invoke arbitration through sub para (ii) within 30 days from the date of receipt of Partial Settlement Agreement or Failure Report. ii. Adjudication through Arbitration: In case no final settlement has been arrived at between the parties after mediation or partially settled as per sub Para (i) above, the unresolved dispute(s), on invocation by the aggrieved party shall be referred for adjudication by arbitration. Arbitration is restricted to disputes with a value of less than Rs. 10 Crores. The dispute shall be referred to a sole Arbitrator to be appointed by Chairman/Member, AAI, after obtaining consent of the other party, as per format annexed at Annexure-A. Unless the contract has already been repudiated or terminated, the parties shall, in every case, continue to proceed to perform their respective obligations under the agreement. Arbitration proceedings shall be conducted in accordance with the provisions of the Arbitration and Conciliation Act, 1996, as amended from time to time. Fee payable to the Arbitrator(s) shall be as per Schedule-IV of the Arbitration & Conciliation Act, 1996 and shall be borne by both the parties equally. No dispute shall be referred for resolution under this clause through arbitration in matters for which eviction & recovery procedure is provided under Chapter -VA of the Airports Authority of India Act, 1994. AAI empanelled Arbitrators and Mediators list is available on AAI website Homepage under 'Important links Section'. Link for receiving Requests for Mediation is also available under the same section on AAI website. In the event of any dispute or difference relating to the interpretation and application of the provisions of commercial contract(s) between Central Public Sector Enterprises (CPSEs) /Port Authorities inter-se and also between CPSEs and Government Departments /Organizations (excluding disputes relating (to Railways, Income Tax, Customs & Excise Departments), such dispute or difference shall be taken up by either party for its resolution through AMRCD as mentioned in DPE OM No. DPE-02/0001/2023- AMRCD-FTS-13578 dated 8th December 2025 and the decision of AMRCD on the said dispute will be binding on both the parties.
--	--

Annexure-A

Format Consent Letter
(Dispute Resolution Clause- 25)

To,
The Chairman/Member/Regional Executive Director,
Airports Authority of India

SUB: Request for appointment of arbitrator under Clause ----- of the -----agreement dated ----- for-----

Sir/Madam,

1. We state that _____ (contractor/agency) was awarded work/concession of _____ Airport/ _____ (other location) of Airports Authority of India through Award Letter dated _____.
2. Dispute related to _____ arose between us (contractor/agency) and AAI.
3. On ____ (date), dispute was referred to Mediation as per AAI Mediation Policy and any settlement on the following claims/disputes was not reached between the parties:
 - (i)
 - (ii)
 - (iii)
4. A concise statement along with claim in respect of each of such disputes is attached herewith.
5. In view of the above, we invoke arbitration under clause 25 of the agreement between us and AAI and as per proviso to Section-12(5) of the Arbitration & Conciliation Act, 1996, we hereby agree and request the Chairman/Member/Regional Executive Director AAI to appoint arbitrator from AAI 's panel of arbitrators.
6. I / We also give my / our consent for appointing any of an arbitrator from AAI approved panel of arbitrators, as per paragraph-5 above.

Thanking you,

Authorized Signatory

Encl: As above

CLAUSE 26

	Contractor to indemnify AAI against Patent Rights	The Contractor shall fully indemnify and keep indemnified the Chairman AAI against any action, claim or proceeding relating to infringement or use of any patent or design or any alleged patent or design rights and shall pay and royalties which may be payable in respect of any article or part thereof included in the Contract. In the event of any claims made under or action brought against AAI in respect of any such matters as aforesaid, the Contractor shall be immediately notified thereof and the Contractor shall be at liberty, at his own expense, to settle any dispute or to conduct any litigation that may arise there from, provided that the Contractor shall not be liable to indemnify the AAI if the infringement of the patent or design or any alleged patent or design right is the direct result of an order passed by the Engineer-in-Charge in this behalf.
--	--	--

CLAUSE 27

	Lump sum Provisions in Tender	When the estimate on which a tender is made, includes lump sum in respect of parts of the work, the Contractor shall be entitled to payment in respect of the items of work involved or the part of the work in question at the same rates as are payable under this Contract for such items, or if the part of work in question is not, in the opinion of the Engineer in Charge payable of measurement, the Engineer in Charge may at his discretion pay the lump sum amount entered in the estimate, and the certificate in writing of the Engineer in Charge shall be final and conclusive against the Contractor with regard to any sum or sums payable to him under the provision of the Clause.
--	--------------------------------------	---

CLAUSE 28

	Action where no specifications are specified	In the case of any class of work for which there is no such specifications as referred to in Clause 11, such work shall be carried out in accordance with the Bureau of Indian Standards Specifications. In case there are no such specifications in Bureau of Indian Standards, the work shall be carried out as per manufacturers' specifications. In case there are no such specifications as required above, the work shall be carried out in all respects in accordance with the instructions and requirements of the Engineer-in-Charge.
--	---	---

CLAUSE 29

	With-holding and lien in respect of sums due from Contractor	i. Whenever any claims for payment of a sum of money arises out of or under the Contract or against the Contractor, the Engineer-in-Charge or the AAI shall be entitled to withhold and also have a lien to retain such sum or sums in whole or in part from the security, if any deposited by the Contractor and for the purpose aforesaid, the Engineer-in-Charge or the AAI shall be entitled to withhold the security deposit if any, furnished as the case may be and also have a lien over the same pending finalization or adjudication of any such claim. In the event of the security being insufficient to cover the claimed amount or amounts or if no security has been taken from the Contractor, the Engineer-in-Charge or the AAI shall be entitled to withhold and have lien to retain to the extent of such claimed amount or amounts referred to above from any sum or sums found payable or which may at any time thereafter become payable to the Contractor under the same Contract or any other Contract with the Engineer-in Charge of the AAI or any Contracting person through the Engineer-in-Charge pending finalization of adjudication of any such claim. It is an agreed term of the Contract that the sum of money or moneys so withheld or retained under the lien referred to above by the Engineer-in-Charge or AAI will be kept withheld or retained as such by the Engineer-in-Charge or AAI till the claim arising out of or under the Contract is determined by the arbitrator (if the Contract is governed by the arbitration Clause) or by the competent court, as the case may be and that the Contractor will have no claim for interest or damages whatsoever on any account in respect of such withholding or retention under the lien referred to above and duly notified as such to the Contractor. For the purpose of this Clause, where the Contractor is a partnership firm or a limited company, the Engineer-in-Charge or the AAI shall be entitled to withhold and also have a lien to retain towards such claimed amount or amounts in whole or in part from any sum found payable to any partner/limited company as the case may be, whether in his individual capacity or otherwise. ii. AAI shall have the right to cause an audit and technical examination of the works and the final bills of the Contractor including all supporting vouchers, abstract, etc., to be made after payment of the final bill and if as a result of such audit and technical examination any sum is found to have been overpaid in respect of any work done by Contractor under the Contract or any work claimed to have been done by the him under the Contract and found not to have been executed, the Contractor shall be liable to refund the amount of over payment and it shall be lawful for AAI to recover the same from him in the manner prescribed in Sub-Clause (i) of this Clause or in any other manner legally permissible; and if it is found that the Contractor was paid less than what was due to him under the Contract in respect of any work executed by him under it, the amount of such under payment shall be duly paid by AAI to the Contractor, without any interest thereon whatsoever. Provided that the AAI shall not be entitled to recover any sum overpaid, nor the Contractor shall be entitled to payment of any sum paid short where such payment has been agreed upon between the Executive Director Engineering/General Manager Engineering on the one hand and the Contractor on the other under any term of the Contract permitting payment for work after assessment by the Executive Director Engineering/General Manager Engineering.
--	--	---

CLAUSE 29 A

	Lien in respect of claims in other Contracts	i. Any sum of money due and payable to the Contractor (including the security deposit refundable to him) under the Contract may be withheld or retained by way of lien by the Engineer-in-Charge or the AAI or any other Contracting person or persons through Engineer-in-Charge against any claim of the Engineer-in-Charge or AAI or such other person or persons in respect of payment of a sum of money arising out of or under any other Contract made by the Contractor with the Engineer-in-Charge or the AAI or with such other person or persons. ii. It is an agreed term of the Contract that the sum of money so withheld or retained under this Clause by the Engineer-in-Charge or the AAI will be kept withheld or retained as such by the Engineer-in-Charge or the AAI or till his claim arising out of the same Contract or any other Contract is either mutually settled or determined by the arbitration Clause or by the competent court, as the case may be and that the Contractor shall have no claim for interest or damages whatsoever on this account or on any other ground in respect of any sum of money withheld or retained under this Clause and duly notified as such to the Contractor.
--	---	---

CLAUSE 30

	Employment of coal mining or controlled area labour not permissible	i. The Contractor shall not employ coal mining or controlled area labour falling under any category whatsoever or in connection with the work or recruit labour from area within a radius of 32 km (20 miles) of the controlled area. Subject as above the Contractor shall employ imported labour only i.e., deposit imported labour or labour imported by Contractors from area, from which import is permitted. ii. Where ceiling price for imported labour has been fixed by State or Regional Labour Committees not more than that ceiling price shall be paid to the labour by the Contractor. iii. The Contractor shall immediately remove any labourer whom may be pointed out by the Engineer in Charge as being a coal mining or controlled area labourer. Failure to do so shall render the Contractor liable to pay to AAI a sum calculated at the rate of Rs.10/- per day per labourer. The certificate of the Engineer in Charge about the number of coal mining or controlled area labourer and the number of days for which they worked shall be final and binding upon all parties to this Contract. iv. It is declared and agreed between the parties that the aforesaid stipulation in this Clause is one in which the public are interested within the meaning of the exception in Section 74 of Indian Contract Act, 1872. Explanation :- Controlled area mean the following areas: Districts of Dhanbad, Hazaribagh, Jamtara Sub-Division under Santhal Pargana Commissionery, District of Bankura, Birbhum, Burdwan, District of Bilaspur. Any other area which may be declared a Controlled Area by or with the approval of the Central Government.
--	--	--

CLAUSE 31

	Unfiltered water supply	The Contractor(s) shall make his/their own arrangements for water required for the work and nothing extra will be paid for the same. This will be subject to the following conditions: i. That the water used by the Contractor(s) shall be fit for construction purposes to the satisfaction of the Engineer in Charge. ii. The Engineer in Charge shall make alternative arrangements for supply of water at the risk and cost of Contractor(s) if the arrangements made by the Contractor(s) for procurement of water are in the opinion of the Engineer in Charge, unsatisfactory.
--	--------------------------------	---

CLAUSE 31A

	Departmental water supply, if available	Water if available may be supplied to the Contractor by the department subject to the following conditions:- i. The water charges @1% shall be recovered on gross amount of the work done. ii. The Contractor(s) shall make his/their own arrangement of water connection and laying of pipelines from existing main of source of supply. iii. The Department do not guarantee to maintain uninterrupted supply of water and it will be incumbent on the Contractor (s) to make alternative arrangements for water at his/their own cost in the event of any temporary break down in the AAI's water main so that the progress of his/their work is not held up for want of water. No claim of damage or refund of water charges will be entertained on account of such break down.
--	--	--

CLAUSE 32

	Alternate water arrangements	i. Where there is no piped water supply arrangement and the water is taken by the Contractor from the wells or hand pump constructed by the AAI, no charge shall be recovered from the Contractor or that account. The Contractor shall, however, draw water at such hours of the day that it does not interfere with the normal use for which the hand pumps and well are intended. He will also be responsible for all damage and abnormal repairs arising out of his use, the cost of which shall be recoverable from him. The Engineer-in-Charge shall be the final authority to determine the cost recoverable from the Contractor on this account and his decision shall be binding on the Contractor.
--	-------------------------------------	--

		ii. The Contractor shall be allowed to construct temporary wells in AAI land for taking water for construction purposes only after he has got permission of the Engineer-in-Charge in writing. No charges shall be recovered from the Contractor on this account but the Contractor shall be required to provide necessary safety arrangements to avoid any accidents or damage to adjacent buildings, roads and service lines. He shall be responsible for any accidents or damage caused due to construction and subsequent maintenance of the wells and shall restore the ground to its original condition after the wells are dismantled on completion of the work.
--	--	--

CLAUSE 33

	Return of Surplus materials	Notwithstanding anything contained to the contrary in this Contract, where any materials for the execution of the Contract are procured with the assistance of AAI either by issue from AAI stocks or purchase made under orders or permits or licenses issued by AAI, the Contractor shall hold the said materials economically and solely for the purpose of the Contract and not dispose of them without the written permission of the AAI and return, if required by the Engineer-in-Charge, all surplus or unserviceable materials that may be left with him after the completion of the Contract or at its termination for any reason whatsoever on being paid or credited such prices as the Engineer-in-Charge shall determine having due regard to the condition of the materials. The price allowed to the Contractor however shall not exceed the amount charged to him excluding the element of storage charges. The decision of the Engineer-in-Charge shall be final and conclusive. In the event of breach of the aforesaid condition, the Contractor shall in addition to throwing himself open to action for contravention of the terms of the license or permit and/or for criminal breach of trust, be liable to AAI for all moneys, advantages or profits resulting or which in the usual course would have resulted to him by reason of such breach.
--	------------------------------------	--

CLAUSE 34

	Hire of plant & Machinery	i. The Contractor shall arrange at his own expense all tools, plant, machinery and equipment (hereinafter referred to as T&P) required for execution of the work except for the Plant & Machinery listed in Schedule 'C' and stipulated for issue to the Contractor. If the Contractor requires any item of T&P on hire from the T&P available with the AAI over and above the T&P stipulated for issue, the AAI will, if such item is available, hire it to the Contractor at rates to be agreed upon between him and the Engineer-in-charge. In such a case, all the conditions hereunder for issue of T & P shall also be applicable to such T&P as is agreed to be issued. ii. Plant & Machinery when supplied on hire charges shown in Schedule 'C' shall be made over and taken back at the departmental equipment yard / shed shown in Schedule 'C' and the Contractor shall bear the cost of carriage from the place of issue to the site of work and back. The Contractor shall be responsible to return the plant and machinery with condition in which it was handed over to him, and he shall be responsible for all damage caused to the said plant and machinery at the site of work or elsewhere in operation and otherwise during transit including damage to or loss of plant and for all losses due to his failure to return the same soon after the completion of the work for which it was issued. The Engineer-in-Charge shall be the sole judge to determine the liability of the Contractor and its extent in this regard and his decision shall be final and binding on the Contractor.
--	--------------------------------------	---

		iii. The plant and machinery as stipulated above will be issued as and when available and if required by the Contractor. The Contractor shall arrange his Programme of work according to the availability of the plant and machinery and no claim, whatsoever, will be entertained from him for any delay in supply by the department. iv. The hire charges shall be recovered at the prescribed rates from and inclusive of the date the plant and machinery made over up-to and inclusive of the date of the return in good order even though the same may not have been working for any cause except major breakdown due to no fault of the Contractor or faulty use requiring more than three working days continuously (excluding intervening holidays and Sundays) for bringing the plant in order. The Contractor shall immediately intimate in writing to the Engineer-in-Charge when any plant or machinery gets out of order requiring major repairs as aforesaid. The Engineer-in-Charge shall record the date and time of receipt of such intimation in the log sheet of the plant or machinery. Based on this if the breakdown before lunch period or major breakdown will be computed considering half a day's breakdown on the day of complaint. If the breakdown occurs in the post lunch period of major breakdown will be computed starting from the next working day. In case of any dispute under this Clause, the decision of the Executive Director (Engg)/General Manager (Engg) shall be final and binding on the Contractor. v. The hire charges shown above are for each day of 8 hours (inclusive of the one hour lunch break) or part thereof. vi. Hire charges will include service of operating staff as required and also supply of lubricating oil and stores for cleaning purposes. Power fuel of approved type, firewood, kerosene oil etc. for running the plant and machinery and also the full time chowkidar for guarding the plant and machinery against any loss or damage shall be arranged by the Contractor who shall be fully responsible for the safeguard and security of plant and machinery. The Contractor shall on or before the supply of plant and machinery sign an agreement indemnifying the Department against any loss or damage caused to the plant and machinery either during transit or at site of work. vii. Ordinarily, no plant and machinery shall work for more than 8 hours a day inclusive of one hour lunch break. In case of an urgent work however, the Engineer-in-Charge may, at his discretion, allow the plant and machinery to be worked for more than normal period of 8 hours a day. In that case, the hourly hire charges for overtime to be borne by the Contractor shall be 50% more than the normal proportionate hourly charges (1/8th of the daily charges) subject to a minimum of half day's normal charges on any particular day. For working out hire charges for over time, a period of half an hour and above will be charged as one hour and a period of less than half an hour will be ignored. viii. The Contractor shall release the plant and machinery every seventh day for periodical servicing and/or wash out which may take about three to four hours or more. Hire charges for full day shall be recovered from the Contractor for the day of servicing/wash out irrespective of the period employed in servicing. ix. The plant and machinery once issued to the Contractor shall not be returned by him on account of lack of arrangements of labour and materials, etc. on his part, the same will be returned only when they are required for major repairs or when in the opinion of the Engineer-in-charge, the work or a portion of work for which the same was issued is completed. x. Log Book for recording the hours of daily work for each of the plant and machinery supplied to the Contractor will be maintained by the Department and will be countersigned by the Contractor or his authorised agent daily.
--	--	--

		In case the Contractor contests the correctness of the entries and / or fails to sign the Log Book, the decision of the Engineer-in-Charge shall be final and binding on him. Hire charges will be calculated according to the entries in the Log Book and will be binding on the Contractor. Recovery on account of hire charges for road rollers shall be made for the minimum number of days worked out on the assumption that a roller can consolidate per day and maximum quantity of materials or area surfacing as noted against each in the Annexed Statement (see attached Annexure). xi. In the case of concrete mixers, the Contractors shall arrange to get the hopper cleaned and the drum washed at the close of the work each day or each occasion. (a) In case rollers for consolidation are employed by the Contractor himself, log book for such rollers shall be maintained in the same manner as is done in case of departmental rollers, maximum quantity of any items to be consolidated for each roller-day shall also be same as in Annexure to Clause 34(x). For less use of rollers, recovery for the less roller days shall be made at the stipulated issuerate. xii. The Contractor shall be responsible to return the plant and machinery in the condition in which it was handed over to him and he shall be responsible for all damage caused to the said plant and machinery at the site of work or elsewhere in operation or otherwise or during transit including damage to or loss of parts, and for all losses due to his failure to return the same soon after the completion of the work for which it was issued. The Engineer-in-Charge shall be the sole judge to determine the liability of the Contractor and its extent in this regard and his decision shall be final and binding on the Contractor. xiii. The Contractor will be exempted from levy of any hire charges for the number of days he is called upon in writing by the Engineer-in-Charge to suspend execution of the work, provided AAI's plant and machinery in question have, in fact, remained idle with the Contractor because of the suspension. xiv. In the event of the Contractor not requiring any item of plant and machinery issued by AAI though not stipulated for issue in Schedule 'C' any time after taking delivery at the place of issue, he may return it after two days written notice or at any time without notice if he agrees to pay hire charges for two additional days without, in any way, affecting the right of the Engineer-in-charge to use the said plant and machinery during the said period of two days as he likes including hiring out to a third party.
--	--	---

CLAUSE 35

	Condition relating to use of asphaltic materials	i. The Contractor undertakes to make arrangement for the supervision of the work by the firm supplying the tar or bitumen used. ii. The Contractor shall collect the total quantity of tar or bitumen required for the work as per standard formula, before the process of painting is started and shall hypothecate it to the Engineer in Charge. If any bitumen or tar remains unused on completion of the work on account of lesser use of materials in actual execution of for reasons other than authorised changes of specifications and abandonment of portion of work, a corresponding deduction equivalent to the cost of unused materials as determined by the Engineer in Charge shall be made and the material return to the Contractors. Although the materials are hypothecated to AAI, the Contractor undertakes the responsibility for their proper watch, safe custody and protection against all risks. The materials shall not be removed from site of work without the consent of the Engineer in Charge in writing.
--	--	--

		iii. The Contractor shall be responsible for rectifying defects noticed within a year from the date of completion of the work and the portion of the security deposit relating asphaltic work shall be refunded after the expiry of this period.
--	--	--

CLAUSE 36

Employment of Technical Staff and employees	Contractors Superintendence, Supervision, Technical staff & Employees i. The Contractor shall provide all necessary superintendence during execution of the work and all along thereafter as may be necessary for proper fulfilling of the obligations under the Contract. The Contractor shall immediately after receiving letter of acceptance of the tender and before commencement of the work, intimate in writing to the Engineer-in-Charge, the name(s), qualifications experience, age, address(s) and other particulars along with certificates, of the principal technical representative to be charge of the work and other technical representative(s) who will be supervising the work. Minimum requirement of such technical representative(s) and their qualifications and experience shall not be lower than specified in Schedule 'F'. The Engineer-in-Charge shall within 3 days of receipt of such communication intimate in writing his approval or otherwise of such a representative(s) to the Contractor. Any such approval may at any time be withdrawn and in case of such withdrawal, the Contractor shall appoint another such representative(s) according to the provisions of this Clause. Decision of the tender accepting authority shall be final and binding on the Contractor in this respect. Such a principal technical representative and other technical representative(s) shall be appointed by the Contractor soon after receipt of the approval from Engineer-in-Charge and shall be available at site before start of work. All the provisions applicable to the principal technical representative under the Clause will also be applicable to other technical representative(s). The principal technical representative and other technical representative(s) shall be present at the site of work for supervision at all times when any construction activity is in progress and also present himself/themselves, as required to the Engineer-in-Charge and/or his designated representative to take instructions. Instructions given to the principal technical representative or other technical representative(s) shall be deemed to have the same force as if these have been given to the Contractor. The Principal Technical Representative and other technical representatives shall be actually available at site fully during all stages of execution work, during recording/checking/test checking of measurements of works whenever so required by the Engineer-in-Charge and shall also note down instructions conveyed by the Engineer-in-Charge or his designated representative(s) in the site order book and shall affix his/their signature in token of noting down the instructions and in token of acceptance of measurements/checked measurements/test checked measurements. The representative(s) shall not look after any other work. Substitutes, duly approved by Engineer-in-Charge of the work in similar manner as aforesaid shall be provided in event of absence of any of the representative(s) by more than two days. If the Engineer-in-Charge, whose decision in this respect is final and binding on the Contractor, is convinced that no such technical representative(s) is/are effectively appointed or is/are effectively attending or fulfilling the provision of this Clause, a recovery (non-refundable) shall be effected from the Contractor as
---	---



		specified in Schedule 'F' and the decision of the Engineer-in-Charge as recorded in the site order book and measurement recorded checked/test checked in Measurement Books shall be final and binding on the Contractor. Further if the Contractor fails to appoint suitable technical Principal technical representative and/or other technical representative(s) and if such appointed persons are not effectively present or are absent by more than two days without duly approved substitute or do not discharge their responsibility satisfactorily, the Engineer-in-Charge shall have full powers to suspend the execution of the work until such date as suitable other technical representative (s) is/are appointed and the Contractor shall be held responsible for the delay so caused to the work. The Contractor shall submit a certificate of employment of the technical representative(s) (in the form of copy of Form-16 or CPF deduction issued to the Engineer employed by him) alongwith every running account bill/final bill and shall produce evidence if at any times so required by the Engineer-in-Charge. ii. The Contractor shall provide and employ on the site only such technical assistants as are skilled, and experienced in their respective fields and such foremen and supervisory staff as are competent to give proper supervision to the work. The Contractor shall provide and employ skilled, semi-skilled and unskilled labour as is necessary for proper and timely execution of the work. The Engineer-in-Charge shall be at liberty to object to and require the Contractor to remove from the works any person who in his opinion misconducts himself, or is incompetent or negligent in the performance of his duties or whose employment is otherwise considered by the Engineer-in-Charge to be undesirable. Such person shall not be employed again at works site without the written permission of the Engineer-in-Charge and the persons so removed shall be replaced as soon as possible by competent substitutes. iii. The Contractor shall not change his Engineer/Supervisory Staff after approval of the Engineer-In-Charge. If Contractor wants to replace any of his staff due to unavoidable circumstances, he will seek permission of Engineer-in-Charge indicating reasons for such change, qualification and experience of the alternative employee suggested by him. The qualification and experience of the alternative staff shall not be inferior to the person employed earlier.
--	--	---

CLAUSE 37

Levy/Taxes/ Royalty/Land Licence fee payable by Contractor	1. Taxes: a. Rates to be quoted by the parties should be inclusive of all Taxes, Duties, CESS, Fee, Royalty Charges etc., levied under any Statute but Exclusive of GST for all the Items. b. However GST, as applicable, shall be paid to the Contractor, for any taxable Supply / Services / Construction rendered by the agency to AAI, against a valid GST Invoice as per Terms and Conditions of the Contract. c. In case Supplies /Services / Works involve imports, the same should be identified separately. Basic Custom Duty & IGST will be paid directly by AAI by utilizing EPCG License / Duty Credit Scrip under Service Export from India Scheme (SEIS) of Govt. of India.
---	--

		d. In case of change in rate of Tax or any provision relating to levy of Tax resulting in increase in burden of Tax on the Contractor, the Contractor shall be entitled to receive any compensation for such increase in quantum of Tax payable by the Contractor. Similarly recovery shall be made from the Contractor on account of decrease of rate of Tax or any provision relating to levy of Tax. 2. Royalty: a. The Contractor shall at his own expense, provide all materials required for the works other than those which are to be supplied by AAI. The Contractor shall deposit royalty and obtain necessary permit for collection of stone, sand, red bajri, kankar etc., from the local authority in the matter and will abide by the Notification issued by Central Government/State Government/Local State Authorities as applicable from time to time in this regard. The Contractor is also bound to allow deduction from his bills any difference in Statutory Taxes/Royalty and Penalty proposed by Local State Authorities to AAI till finalization of settlement of all demands in this regard by Central/State Govt. b. This will also be applicable to forest produce. c. If pursuant to or under any Law, Notification or Order any Royalty, Cess or the like becomes payable by the AAI and does not any time become payable by the Contractor to the State Government. Local authorities in respect of any material used by the Contractor in the works then in such a case, it shall be lawful to the AAI and it will have the right and be entitled to recover the amount paid in the circumstances as aforesaid from dues of the Contractor. 3. License fee for land a. Land / space (Paved/ Unpaved/ Covered AC or Non AC), to the extent allotted to contractors during execution of work for the purpose of installation of plants, labour camps, cement godown, site office, stacking of materials shall be provided at free of cost upto defect liability period/ maintenance period. b. A security deposit at the rate of Rs 500/ per sqm in the form of DD/BG shall be deposited by the contractor. In case contractor do not deposit security deposit same shall be deducted from 1st Running Account Bill. c. Such security deposit shall be released only after allotted land has been fully vacated by the contractor to entire satisfaction of Engineer in Charge. If contractor fails to vacate the allotted land/ space (Paved/ Unpaved/ Covered AC/ Non AC) after Defect Liability Period/ Maintenance Period of the work shall be charged as per prevailing license fee of the airport plus 25% penalty over that.
--	--	---

CLAUSE 38

Conditions for reimbursement of levy/taxes if levied after receipt of tenders	1. Rates to be quoted by the Parties should be inclusive of all Taxes, Duties, CESS, Fee, Royalty Charges etc., levied under any Statute applicable on last stipulated date of receipt of tender including extension if any but Exclusive of GST. No adjustment i.e. increase or decrease shall be made for any variation in the rate of GST, Building and Other Construction Workers Welfare CESS or any tax, levy or CESS applicable on inputs. However, effect of variation, as per Govt. Order after the last date of receipt of tender including extension if any, in rates of GST or Building and Other Construction Workers Welfare CESS or imposition or repeal of any other Tax, Levy or CESS applicable on output of the Works Contract shall be adjusted on either side, increase or decrease. Provided further that for Building and Other Construction Workers Welfare CESS or any tax (other than GST), Levy or CESS varied or imposed after the last date of receipt of tender including extension if any, any increase shall be reimbursed to the contractor only if the contractor necessarily and properly pays such increased amount of Taxes / Levies / CESS.
---	---

		Provided further that such increase in Tax / Levy / CESS including GST shall not reimbursed if made in the extended period of contract for which the Contractor alone is responsible for Delay as determined by authority for extension of time under Clause 5 in Schedule F. 2. The Contractor shall keep necessary books of accounts and other documents for the purpose of this condition as may be necessary and shall allow inspection of the same by a duly authorized Representative of AAI or the Engineer-in-Charge and further shall furnish such other Information / Document as the Engineer-in-Charge may require from time to time. 3. The Contractor shall, within a period of 30 days of the imposition of any such further tax or levy or CESS, give a written Notice thereof to the Engineer-in-Charge that the same is given pursuant to the condition, together with all necessary Information / Documents relating thereto.
--	--	---

CLAUSE 39

	Termination of Contract on death of Contractor	Without prejudice to any of the rights or remedies under this Contract, if the Contractor dies, the Engineer-in-Charge on behalf of the AAI shall have the option of terminating the Contract without compensation to the Contractor.
--	---	---

CLAUSE 40

	If relative working in AAI then the Contractor not allowed to tender.	The Contractor shall not be permitted to tender for works in AAI wherein his near relative is posted as an Officer responsible for award and execution of work. He shall also intimate the names of persons who are working with him in any capacity or / are subsequently employed by him and who are near relatives to any officer of AAI. Any breach of this condition by the Contractor would render him, the Contract liable to be rejected at any stage. <u>NOTE:</u> By the term “near relatives” is meant wife, husband, parents and grandparents, children and grandchildren, brothers and sisters, uncles, aunts and cousins and their corresponding in-laws.
--	--	---

CLAUSE 41

	No any officer in Department of Engineering to work as Contractor within one year of retirement	Engineer or any officer employed in engineering or administrative duties in an engineering department of AAI shall not work as a Contractor or employee of Contractor for a period of one year after his retirement from AAI service without the prior permission of AAI in writing. This Contract is liable to be cancelled if either the Contractor or any of his employees is found at any time to be such a person who had not obtained the permission of AAI as aforesaid, before submission of the tender or engagement in the Contractor's service, as the case may be.
--	--	--

CLAUSE 41(a)

Integrity Pact and Independent External Monitor.	Signing of Integrity Pact (As per Appendix XVI) is mandatory for every bidder/Contractor if provided so in Schedule F. All tenderers shall have to submit an undertaking as per Appendix XVI along with tender documents. AAI shall appoint Independent External Monitor(s) to oversee effective implementation of Integrity Pact for such works/supplies. For this purpose, a panel of Independent External Monitors shall be constituted by the Authority in concurrence with Central Vigilance Commission (CVC). i. The Contractor/Supplier shall have to act in accordance with the conditions laid down in the integrity pact. - Signing of Integrity Pact is mandatory for every Bidder/Contractor in this procurement/bid process the signed original pact to be send to the office of Bid Manager and should reach before the due date mentioned in NIT. - The Bidder/Contractor shall commit itself to ensure taking all measures necessary to prevent corrupt practices, unfair means and illegal activities during any stage of its bid or during any pre Contract or post Contract stage as specified in Section 3 of the integrity pact. - Any breach of the aforesaid provisions by the Bidder or any one employed by it or acting on its behalf (whether with or without the knowledge of the Bidder) shall entitle the authority to take all or any one of the action as specified in Section 6 of the Integrity Pact. ii. In case any violation of above conduct is established, AAI reserves right to take following actions: - If Contractor commits a violation of its commitments and obligations under the Integrity Pact Program during bidding process, he shall be liable for disqualification from tender process and forfeiture of his Earnest Money Deposit/Bid Security. - In case of violation of the Integrity Pact after award of the Contract, Authority is entitled to terminate the Contract and shall be entitled to demand and recover from the Contractor damages equivalent to 5% of the Contract value or the amount equivalent to Security Deposit or Performance Bank Guarantee, whichever is higher. - Authority may initiate appropriate proceedings against the Contractor. - Contractor will be liable to pay damages as determined by the Authority. - Contractor against whom an action for violation of its commitments and obligations has been taken earlier, again commits a violation, the Authority is entitled to debar such Contractor for future tender/Contract processes for a period as deemed fit. - A violation is considered to have occurred if the Authority is fully satisfied with the available documents and evidence submitted along with Independent External Monitor's recommendations/suggestion that no reasonable doubt exist in the matter. iii. Person signing IP shall not approach the Courts while representing the matters to IEMs and he / she will await their decision in the matter.
--	---

CLAUSE 41 (b)

	Code of Integrity	Code of Integrity No official of AAI or bidder shall act in contravention of the codes which includes (i) Prohibition of a) Making offer, solicitation or acceptance of bribe, reward or gift or any material benefit, either directly or indirectly, in exchange for an unfair advantage in the procurement process or to otherwise influence the procurement process. b) Any omission, or misrepresentation that may mislead or attempt to mislead so that financial or other benefit may be obtained or an obligation avoided. c) Any collusion, bid rigging or anticompetitive behavior that may impair the transparency, fairness and the progress of the procurement process. d) Improper use of information provided by the procuring entity to the bidder with an intent to gain unfair advantage in the procurement process or for personal gain. e) Any financial or business transactions between the bidder and any official of the procuring entity related to tender or execution process of contract; which can affect the decision of the procuring entity directly or indirectly. f) Any coercion or any threat to impair or harm, directly or indirectly, any party or its property to influence the procurement process. g) Obstruction of any investigation or auditing of a procurement process. h) Making false declaration or providing false information for participation in a tender process or to secure a contract; (ii) Disclosure of conflict of interest. (iii) Disclosure by the bidder of any previous transgressions made in respect of the provision of sub clause (i) with any entity in any country during the last three years or of being debarred by any other procuring entity.
--	--------------------------	---

CLAUSE 42

Return of material and recovery for excess material issued.	i. After completion of the work and also at any intermediate stage in the event of non-reconciliation of materials issued, consumed and in balance – (see Clause 10), theoretical quantity of materials issued by the AAI for use in the work shall be calculated on the basis and method given hereunder; a. Quantity of cement & bitumen shall be calculated on the basis of quantity of cement & bitumen required for different items of work as shown in the Schedule of Rates mentioned in Schedule 'F'. In case any item is executed for which standard co-efficients for the consumption of cement or bitumen are not available in the above mentioned Schedule/statement or cannot be derived from, the same shall be calculated on the basis of standard formula to be laid down by the Engineer-in-Charge. b. Theoretical quantity of steel reinforcement or structural steel sections shall be taken as the quantity required as per design or as authorised by Engineer-in-Charge, including authorised lappings, chairs etc., plus 3% wastage due to cutting into pieces, such theoretical quantity being determined and compared with the actual issues each diameter-wise, section wise and category wise separately. c. Theoretical quantity of G.I. & C.I. or other pipes, conduits, wires and cables, pig lead and G.I./M.S. sheets shall be taken as quantity actually required and measures plus 5% for wastage due to cutting into pieces (except in the case of G.I./M.S. sheets it shall be 10%), such determination & comparison being made diameter-wise & category-wise. d. For any other material as per actual requirements. ii. Over the theoretical quantities of materials so computed a variation shall be allowed as specified in Schedule 'F'. The difference in the net quantities of material actually issued to the Contractor and the theoretical quantities including such authorised variation, if not returned by the Contractor or if not fully reconciled to the satisfaction of the Engineer-in-Charge within fifteen days of the issue of written notice by the Engineer-in-Charge to this effect shall be recovered at the rates specified in Schedule 'F', without prejudice to the provision of the relevant conditions regarding return of materials governing the Contract. Decision of Engineer-in-Charge in regard to theoretical quantities of materials, which should have been actually used as per the Annexure of the standard Schedule of rates and recovery at rates specified in Schedule 'F' shall be final and binding on the Contractor. For non-scheduled items, the decision of the Engineer-in-Charge regarding theoretical quantities of materials which should have been actually used, shall be final and binding on the Contractor. g. The said action under this Clause is without prejudice to the right of the AAI to take action against the Contractor under any other conditions of Contract for not doing the work according to the prescribed specifications. h. For materials brought by the Contractor for use in item of work at site, similar theoretical consumption shall be prepared and submitted to the Engineer-in-Charge for verification. If it is found that material consumed in the work is less than the theoretical consumption after taking into account permissible minus variation, the recovery for corresponding material shall be effected as per rates specified in Schedule 'F' under Clause 42.
---	--

CLAUSE 43

	Compensation during warlike situations / act of terrorism	The work (whether fully constructed or not) and all materials, machines, tools and plants, scaffolding, temporary buildings and other things connected therewith shall be at the risk of the Contractor until the work has been delivered to the Engineer-in-Charge and a certificate from him to that effect obtained. In the event of the work or any materials properly brought to the site for incorporation in the work being damaged or destroyed in consequence of hostilities or warlike operation or act of terrorism, the Contractor shall when ordered (in writing) by the Engineer-in-Charge to remove any debris from the site, collect and properly stack or remove in store all serviceable materials salvaged from the damaged work and shall be paid at the Contract rates in accordance with the provision of this agreement for the work of clearing the site of debris, stacking or removal of serviceable material and for reconstruction of all works ordered by the Engineer-in-Charge, such payments being in addition to compensation up-to the value of the work original executed before being damaged or destroyed and not paid for. In case of works damaged or destroyed but not already measured and paid for, the compensation shall be assessed by the Engineer-in charge up-to Rs.5,000/- and by the Executive Director Engg. concerned for a higher amount. The Contractor shall be paid for the damages/destruction suffered and for restoring the material at the rate based on analysis of rates tendered for in accordance with the provision of the Contract. The certificate of the Engineer-in-Charge regarding the quality and quantity of materials and the purpose for which they were collected shall be final and binding on all parties to this Contract. Provided always that no compensation shall be payable for any loss in consequence of hostilities or warlike operation (a) unless the Contractor had taken all such precautions against air raid as are deemed necessary by the A.R.P. Officers or the Engineer-in-Charge (b) for any material etc., not on the site of the work or for any tools plant, machinery, scaffolding, temporary building and other things not intended for the work. In the event of the Contractor having to carry out reconstruction as aforesaid, he shall be allowed such extension of time for its completion as is considered reasonable by the Engineer-in-Charge.
--	--	--

CLAUSE 44

	Apprentices Act provisions to be complied with	The Contractor shall comply with the provisions of the Apprentices Act, 1961 and the rules and orders issued thereunder from time to time. If he fails to do so, his failure will be a breach of the Contract and the Executive Director Engg./General Manager (Engg.) may, in his discretion, cancel the Contract. The Contractor shall also be liable for any pecuniary liability arising on account of any violation by him of the provisions of the said Act.
--	---	--

CLAUSE 45

	Release of security deposit	The Security Deposit of the work shall not be refunded if no labour complaint has been received from the labour officer till the due date of its payment. If a labour complaint is received during this period, the Engineer-in-charge shall, after issue of notice in this regard to the contractor, withhold the amount required to settle the complaint from his security deposit and refund the balance amount.
--	------------------------------------	--

CLAUSE 46

Contractor's Liability and Insurance of Works	i. From commencement to completion of the Works, the Contractor shall take full responsibility for the case thereof and for taking precautions to prevent loss or damage and to minimize loss or damage to the greatest extent possible and shall be liable for any damage or loss that may happen to the Works or any part thereof and all AAI's T & P from any cause whatsoever (save and except the Excepted Risks) and shall at his own cost repair and make good the same so that at completion, the Works and all AAI's T & P shall be in good order and condition and in conformity in every respect with the requirements of the Contract and instructions of the Engineer-in-Charge. ii. In the event of any loss or damage to the Works or any Part thereof or to any T & P, to any material or articles at the Site from any of the Excepted Risks the following provisions shall have effect: a. The Contractor shall, as may be directed in writing by the Engineer-in-Charge, remove from the Site any debris and so much of the works as shall have been damaged, taking to AAI's store such AAI's T & P, articles and/or materials as may be directed; b. The Contractor shall, as may be directed in writing by the Engineer-in-Charge, proceed with the erection and completion of the Works under and in accordance with the provisions and Conditions of the Contract; and iii. Provided always that the Contractor shall not be entitled to payment under the above provisions in respect of so much loss or damage as has been occasioned by any failure on his part to perform his obligation under the Contract or not taking precautions to prevent loss or damage or minimize the amount of such loss or damage. iv. Without limiting its obligations and responsibilities under other Clauses of General Conditions of Contracts, the Contractor at his own cost shall insure in the joint name of AAI and the Contractor, against all losses or damages from whatever cause, arising (other than the accepted risks) for which he is responsible under the terms of the Contract and in such manner that the AAI and the Contractor are covered during the period of construction of works and any loss or damage occasioned by the Contractor in the course of any operation carried out by them for the purpose of complying with its obligations of defects liability Clause hereof; a. All works including temporary works to their full value executed from time to time. b. The construction materials and equipments to their full value brought on to the site by the Contractor. v. The Contractor shall indemnify and keep indemnified AAI against all losses and claims for injuries or damage to any persons or any property whatsoever which may arise out of or in consequence of the construction and maintenance of Works and against all claims, demands proceedings, damage costs, charges and expenses whatsoever in respect of or in relation thereto. vi. Before commencing execution of the work, the Contractor shall, without in any way limiting his obligations and responsibilities under this condition, insure at his own cost against any damage, loss or injury which may occur to any AAI property, or to any person for at least the minimum amount of Rs. 1.00 lakh with unlimited number of occurrences (including any employee of AAI) by or arising out of carrying out of the Contract. vii. The Contractor shall at all times indemnify AAI against all claims, damages or compensation under the provisions of Payment or Wages Act, 1936,
--	--

		Minimum Wages Act, 1948, Employer's Liability Act, 1938, the Workmen's Compensation Act, 1923, Industrial Disputes Act, 1947 and the Maternity Benefit Act, 1961 or any modifications thereof or any other law relating thereto and rules made there under from time to time or as a consequence of any accident or injury to any workman or other persons in or about the Works, whether in the employment of the Contractor or not, his agents or servants, and also against all costs, charges and expenses of any suit, action or proceedings arising out of such accident or injury and against all sum or sums which may with the consent of the Contractor be paid to compromise or compound any claim. Without limiting his obligations and liabilities as above provided, the Contractor shall insure against all claims, damages or compensation payable under the Workmen's Compensation Act, 1923 or any modification thereof or any other law relating thereto. viii. All insurance mentioned above shall be effected with any subsidiary of the General Insurance Company of India or by a company approved by the Insurance Regulatory Authority of India. ix. The aforesaid insurance policy / policies shall provide that they shall not be cancelled till the Engineer-in-Charge has agreed to their cancellation in writing. x. The Contractor shall prove to the Engineer-in-Charge from time to time that he has taken out all the insurance policies referred to above and has paid the necessary premiums for keeping the policies alive till expiry of the Defects Liability Period. A self-certified copy of such policies are required to be submitted to the Engineer-in-Charge. xi. The Contractor shall ensure that similar insurance policies are taken out by his subcontractors (if any) and shall be responsible for any claims or losses to AAI resulting from their failure to obtain adequate insurance protection in connection thereof. The Contractor shall produce or cause to be produced by his subcontractor (if any) as the case may be, the relevant policy or policies and premiums receipts as and when required by the Engineer-in-Charge. A self-certified copy of such policies are required to be submitted to the Engineer-in-Charge. xii. If the Contractor and / or his subcontractor (if any) shall fail to effect and keep in force the insurance referred to above or any other insurance which he/they may be required to effect under the terms of the Contract then and in any such case AAI may, without being bound to, effect and keep in force any such insurance and pay such premium or premiums as may be necessary for that purpose and from time to time deduct the amount equivalent to 150% of premium or premiums as may be by AAI from any moneys due or which may become due to the Contractor or recover the same as a debt due from the Contractor only after issuing notice to contractor in this regard. Engineer-In-Charge shall ensure that all applicable insurances shall be in force without any break as per contract requirement to avoid any losses to AAI on account of non-availability of insurance policies and/or break in insurances policies. xiii. In case Contractor takes Contractor All Risk (CAR) Policy in joint name of AAI and Contractor for full tendered value alongwith third party liability (max of 10% of tendered value or as applicable as per Insurance Regulatory Authority of India) then there is no requirement for taking separate insurance by subcontractors. However, workmen compensation policy is required to be taken separately by main Contractor and subcontractor for workers employed by them.
--	--	---



	Composite Contract and responsibilities of main Agency	i. The tenders have been called for composite work consisting of civil construction and other associated specialized works. The pre-qualification criteria shall be applicable for each subhead of work independently. The Agency meeting PQ Criteria for the main work shall be considered for execution of composite work. However the Agency shall be allowed to execute only those specialized subheads of works for which bidder meets PQ criteria individually.
		ii. The main Contractor shall be permitted to execute only those works (covered under one or more subhead) for which he meets all requirements of pre-qualification including financial, technical and technological requirement specified in the PQ criteria. iii. Main Contractor will associate expert agencies for the execution of specialized works under various subheads for which he himself has failed to meet PQ criteria. In such case he will appoint his associate for the execution of each specialized work with the approval of the NIT approving authority. The main Contractor shall intimate the names of only those agencies who fully meet the PQ criteria for each specialized work for the acceptance of the department. iv. Main Contractor shall not be permitted to change their associate agencies in the course of execution of work. If change of Agency is inevitable then a request shall be submitted to the Engineer in Charge in writing giving full justification for change of Agency. The proposal should include name of the alternate Agency along with his financial, technical capabilities and work experience in the appropriate field. Such change shall be allowed only after receiving approval from the competent authority.
	Composite Contract-Tripartite agreement	This Clause is applicable for the Works for which the estimated cost put to tender is more than Rs.500.00 Crores. i. The main Contractor shall finalise his rates, terms and conditions and mode of execution of work with specialised agencies for all works covered in various subhead of works on receipt of work order but specifications, preferred makes of materials and performance of system shall remain as specified in tender document. ii. The main Contractor shall arrange an agreement between department, main Contractor and associated agencies for all subheads on receipt of work order from the Engineer in Charge. Main Contractor and expert Agency shall be jointly responsible for quality of work and performance of the system. iii. Main Contractor shall submit list of associated Agency for each specialized work within 1/12th of stipulated completion period or within one month from issue of work order whichever is later along with documentary evidence for financial soundness, technical capabilities and their experience for executing similar specialized works along with his application seeking acceptance for the name of associated Agency. Approval / rejection for the name of associated Agency shall be accorded thereafter by NIT approving authority within a period of 15 days each subheadwise. iv. The main Contractor shall submit duly signed tripartite agreement on the format provided by AAI within 2/12th of stipulated completion period or 60 days whichever is later for acceptance and signature of department. The extension of time for signing of this agreement shall not be generally permitted. The signing time shall only be extended if handing over of site is delayed due to reasons beyond control of the Contractor.



	Conditions of composite Contract	i. Main Contractor shall be responsible for submission of earnest money. ii. The mobilization advance shall be paid to main Contractor as per terms and conditions of Contract and indicated under Clause 10 B. The first instalment of mobilization advance shall be corresponding to the value of work which shall be executed by the main Contractor. The subsequent mobilization advances corresponding to value of work covered in each subhead shall be released on signing of each Tripartite Agreement with expert Agency for the same. iii. The security deposit shall be deducted from the running bills of main Contractor after adjustment of full earnest money.
		iv. Main Contractor shall be responsible for completion of work as per time Schedule indicated in the NIT. The compensation for the delay shall be levied on the main Contractor only. v. The coordination meetings called by AAI or its representative shall be attended by associated expert agencies as and when required. Expert Agency shall be responsible for technical soundness, quality of work and adherence to tender specifications. The main Contractor as well as associated Agency shall be responsible for rectification of deficiencies noticed in specialized work.
	Payment Conditions for Composite Contract	i. It will be the responsibility of main Contractor to finalize expert agencies for the execution of works covered under all subheads of NIT and get the tripartite agreements signed as per NIT requirement at an early date. The main Contractor shall not be paid for value of work covered under second running bill & subsequent bills till all Tripartite Agreements are signed by all agencies concerned. ii. The main Contractor must fill the ratio of work which shall govern the ratio of direct payment to the expert Agency and to the main Contractor for each subhead of work in Schedule F. This ratio may also be indicated in tripartite agreement. Thus direct payment to each expert Agency shall be released in the same ratio from the net payment (after all deductions). iii. The running bill for specialized work shall be processed as per terms and conditions of the Contract. All deductions like security deposit, income tax and part rate for incomplete work or due to any other reason shall be made as per Contract Conditions from each running bill. In case the ratio as desired under (ii) is not filled by the Main Contractor, AAI will make payment of 75% of the net payable amount to the expert Agency directly and balance 25% shall be paid to the main Contractor.

Clause 48

	Escrow Account	i. All payments for the works estimated cost more than Rs.500 Cr shall be made only through Escrow Account opened by the Contractor. However for works costing less than Rs.500 Cr., it shall be at the discretion of Technical Sanctioning Authority to opt for Escrow account or not. The bank charges for Escrow Account shall be borne by Contractor. The detailed conditions of Escrow Account shall be drawn in consultation with associated bank. ii. Mobilization advance for mobilization of resources and purchase of plant & machinery shall be credited directly to the escrow account opened for this Contract through bank transfer as per terms and condition of Contract. The Agency shall be able to utilise 25% (or as decided by TS authority) of each instalment of mobilisation advance to meet minor expenses like construction of site office, purchase of office equipment and other minor works, while release of balance 75% fund shall be regulated by the department. The Contractor shall seek prior concurrence of Engineer in Charge for release of payment to the supplier etc., through Escrow Account by the Bank. Funds against cheque issued by Contractor shall be released by Bank on receipt of written consent from Engineer in Charge. iii. Payment received and credited against each RA Bill, can be utilised 25% directly by the Contractor for minor expenses like salary, stationary, office expenses etc.. AAI shall exercise control for release of payment by Contractor for balance 75%. iv. The Contractor shall submit his proposal to the Engineer in Charge/Authority for utilisation of funds made available by AAI (75% against each RA bill)
		a. Name of Agency for whom payment is proposed to be released. b. Details of work executed/material supplied by Agency to whom he intends to release payment. c. Nature of advance payment if any, has to be released to the supplier for supply of material for the project only. d. Documentary evidence in support of his claim. v. Engineer in Charge will examine and approve full/part of such payments as per Agency's request within maximum of three working days. The terms and condition of Escrow Account shall be finalised with bank according to terms and conditions of Contract. Bank shall release payment against such cheques only after written consent of authorised officer of AAI is received. vi. Contractor shall be permitted to close Escrow Account on receipt of final payment for the work/project or on receipt of letter for foreclosure of work by the AAI. All balances and liabilities against this Escrow Account shall be left at the disposal of the Contractor.

AIRPORTS AUTHORITY OF INDIA

SAFETY CODE

1. Suitable Scaffolds should be provided for workmen for all works that cannot safely be done from the ground, or from solid construction except such short period work as can be done safely from ladders. When a ladder is used, an extra mazdoor shall be engaged for holding the ladder and if the ladder is used for carrying materials as well suitable footholds and hand-hold shall be provided on the ladder and the ladder shall be given an inclination not steeper than $\frac{1}{4}$ to 1 ($\frac{1}{4}$ horizontal and 1 vertical).
2. Scaffolding of staging more than 3.6m (12ft.) above the ground or floor, swung or suspended from an overhead support or erected with stationary support shall have a guard rail properly attached or bolted, braced and otherwise secured at least 90 cm. (3ft.) high above the floor or platform of such scaffolding on staging and extending along the entire length of the outside and ends thereof with only such opening as may be necessary for the delivery of materials. Such scaffolding or staging shall be so fastened as to prevent it from swaying from the building or structure.
3. Working platforms, gangways and stairways should be so constructed that they should not sag unduly or unequally, and if the height of the platform or the gangway or the stairway is more than 3.6 m (12ft.) above ground level or floor level, they should be closely boarded, should have adequate width and should be suitably fastened as described in (2) above.
4. Every opening in the floor of a building or in a working platform shall be provided with suitable means to prevent the fall of person or materials by providing suitable fencing or railing whose minimum height shall be 90cm.(3ft.)
5. Safe means of access shall be provided to all working platforms and other working places. Every ladder shall be securely fixed. No portable single ladder shall be over 9m. (30ft.) in length while the width between side rails in rung ladder shall in no case be less than 29 cm. (11 $\frac{1}{2}$ ”) for ladder up-to and including 3m. (10ft.) in length. For long ladders, this width should be increased at least $\frac{1}{4}$ ” for each additional 30cm. (1 foot) of length. Uniform step spacing of not more than 30cm shall be kept. Adequate precautions shall be taken to prevent danger from electrical equipment. No materials on any of the site or work shall be so stacked or placed as to cause danger or inconvenience to any person or the public. The Contractor shall provide all necessary fencing and lights to protect the public from accident and shall be bound to bear the expenses of defence of every suit, action or other proceedings at law that may be brought by any person for injury sustained owing to neglect of the above precautions and to pay any damages and cost which may be awarded in any such suit, action or proceedings to any such person on which may, with the consent of the Contractor, be paid to compensate any claim by any such person.
6. a. **Excavation and Trenching** – All trenches 1.2 m. (4ft.) or more in depth, shall at all times be supplied with at least one ladder for each 30m. (100ft.) in length or fraction thereof, Ladder shall extend from bottom of the Trench to at least 90cm (3fts) above the surface of the ground. The side of the trenches which are 1.5 m. (5 ft.) or more in depth shall be stepped back to give suitable slope or securely held by timber bracing, so as to avoid the danger of sides collapsing. The excavated material shall not be placed within 1.5 m. (5 ft.) of the edges of the trench or half of the depth of the trench whichever is more. Cutting shall be done from top to bottom. Under no circumstances, undermining or undercutting shall be done.



b. Safety Measures for Digging Bore Holes :-

- i. If the bore well is successful, it should be safely capped to avoid caving and collapse of the bore well. The failed and the abandoned ones should be completely refilled to avoid caving and collapse;
 - ii. During drilling, Sign boards should be erected near the site with the address of the drilling Contractor and the Engineer-in-Charge of the work;
 - iii. Suitable fencing should be erected around the well during the drilling and after the installation of the rig on the point of drilling, flags shall be put 50 Mtr all around the point of drilling to avoid entry of people/animals;
 - iv. After drilling the bore well, a cement platform (0.50 Mtr x 0.50 Mtr x 1.20 Mtr) 0.60 Mtr above ground level and 0.60 Mtr below ground level should be constructed around the well casing;
 - v. After the completion of the borewell, the Contractor should ~~keep~~ cap the borewell properly by ~~id~~ welding steel plate, cover the borewell with the drilled wet soil and fix thorny shrubs over the soil. This should be done even while repairing the pump;
 - vi. After the borewell is drilled the entire site should be brought to the ground level;
7. Demolition – Before any demolition work is commenced and also during the progress of the work,
- i) All roads and open areas adjacent to the work site shall either be closed or suitably protected.
 - ii) No electric cable or apparatus which is liable to be a source of danger or a cable or apparatus used by the operator shall remain electrically charged.
 - iii) All practical steps shall be taken to prevent danger to persons employed from risk of fire or explosion or flooding. No floor, roof or other part of the building shall be so overloaded with debris or materials as to render it unsafe.
8. All necessary personal safety equipment as considered adequate by the Engineer-in-Charge should be kept available for the use of the person employed on the site and maintained in a condition suitable for immediate use and the Contractor should take adequate steps to ensure proper use of equipment by those concerned. The following safety equipment shall invariably be provided.
- i) Workers employed on mixing asphaltic materials, cement and lime mortars shall be provided with protective footwear and protective goggles.
 - ii) Those engaged in white washing and mixing or stacking of cement bags or any material which is injurious to the eyes, shall be provided with protective goggles.
 - iii) Those engaged in welding works shall be provided with welder's protective eye-shields.
 - iv) Stone breaker shall be provided with protective goggles and protective clothing and seated at sufficiently safe intervals.
 - v) When workers are employed in sewers and manholes, which are in active use, the Contractors shall ensure that the manhole covers are opened and ventilated at least for an hour before the workers are allowed to get into the manholes, and the manholes so opened shall be cordoned off with suitable railing and provided with warning signals or boards to prevent accident to the public. In addition, the Contractor shall ensure that the following safety measures are adhered to:-
 - a) Entry for workers into the line shall not be allowed except under supervision of the Sr. Superintendent (Engg.) or any other higher officer.
 - b) At least 5 to 6 manholes upstream and downstream should be kept open for at least 2 to 3 hours before any man is allowed to enter into the manhole for working inside.
 - c) Before entry, presence of toxic gases should be tested by inserting wet lead acetate paper which changes colour in the presence of such gases and gives indication of their presence.



- d) Presence of Oxygen should be verified by lowering a detector lamp into the manhole. In case, no Oxygen is found inside the sewer line, workers should be sent only with oxygen kit.
 - e) Safety belt with rope should be provided to the workers. While working inside the manholes, such rope should be handled by two men standing outside to enable him to be pulled out during emergency.
 - f) The area should be barricaded or cordoned off by suitable means to avoid mishaps of any kind. Proper warning signs should be displayed for the safety of the public whenever cleaning works are undertaken during night or day.
 - g) No smoking or open flames shall be allowed near the blocked manhole being cleaned.
 - h) The malba obtained on account of cleaning of blocked manholes and sewer lines should be immediately removed to avoid accidents on account of slippery nature of the malba.
 - i) Workers should not be allowed to work inside the manhole continuously. He should be given rest intermittently. The Engineer-in-Charge may decide the time up-to which a worker may be allowed to work continuously inside the manhole.
 - j) Gas masks with Oxygen Cylinder should be kept at site for use in emergency.
 - k) Air-blowers should be used for flow of fresh air through the manholes. Whenever called for, portable air blowers are recommended for ventilating the manholes. The Motors for these shall be vapour proof and of totally enclosed type. Non sparking gas engines also could be used but they should be placed at least 2 metres away from the opening and on the leeward side protected from wind so that they will not be a source of friction on any inflammable gas that might be present.
 - l) The workers engaged for cleaning the manholes/sewers should be properly trained before allowing to work in the manhole.
 - m) The workers shall be provided with Gumboots or non-sparking shoes bump helmets and gloves non sparking tools safety lights and gas masks and portable air blowers (when necessary). They must be supplied with barrier cream for anointing the limbs before working inside the sewer lines.
 - n) Workmen descending a manhole shall try each ladder step or rung carefully before putting his full weight on it to guard against insecure fastening due to corrosion of the rung fixed to manhole well.
 - o) If a man has received a physical injury, he should be brought out of the sewer immediately and adequate medical aid should be provided to him.
 - p) The extent to which these precautions are to be taken depend on individual situation but the decision of the Engineer-in-Charge regarding the steps to be taken in this regard in an individual case will be final.
 - (vi) The Contractor shall not employ men and women below the age of 18 years on the work of painting with products containing lead in any form. Wherever men above the age of 18 are employed on the work of lead painting, the following precaution should be taken:-
 - a) No paint containing lead or lead products shall be used except in the form of paste or readymade paint.
 - b) Suitable face masks should be supplied for use by the workers when paint is applied in the form of spray or a surface having lead paint is dry rubbed and scrapped.
 - c) Overall shall be supplied by the Contractors to the workmen and adequate facilities shall be provided to enable the working painters to wash during and on the cessation of work.
9. An additional Clause (viii)(i) of AAI Safety Code (iv) The Contractor shall not employ women and men below the age of 18 on the work of painting with product containing lead in any form, wherever men above the age of 18 are employed on the work of lead painting, the following principles must be observed for such use:
- i) White lead, sulphate of lead or product containing these pigment, shall not be used in painting operation except in the form of pastes or paint ready for use.
 - ii) Measures shall be taken, wherever required in order to prevent danger arising from the application of a paint in the form of spray.



- iii) Measures shall be taken, wherever practicable, to prevent danger arising out of/from dust caused by dry rubbing down and scraping.
 - iv) Adequate facilities shall be provided to enable working painters to wash during and on cessation of work.
 - v) Overall shall be worn by working painters during the whole of working period.
 - vi) Suitable arrangement shall be made to prevent clothing put off during working hours being spoiled by painting materials.
 - vii) Cases of lead poisoning and suspected lead poisoning shall be notified and shall be subsequently verified by medical man appointed by competent authority of AAI.
 - viii) AAI may require, when necessary medical examination of workers.
 - ix) Instructions with regard to special hygienic precautions to be taken in the painting trade shall be distributed to working painters.
10. When the work is done near any place where there is risk of drowning, all necessary equipments should be provided and kept ready for use and all necessary steps taken for prompt rescue of any person in danger and adequate provision, should be made for prompt first aid treatment of all injuries likely to be obtained during the course of the work.
11. Use of hoisting machines and tackle including their attachments, anchorage and supports shall conform to the following standards or conditions:
- i) (a) These shall be of good mechanical construction, sound materials and adequate strength and free from patent defects and shall be kept repaired and in good working order.
 - ii) (b) Every rope used in hoisting or lowering materials or as a means of suspension shall be of durable quality and adequate strength, and free from patent defects.
 - iii) Every crane driver or hoisting appliance operator, shall be properly qualified and no person under the age of 21 years should be in charge of any hoisting machine including any scaffolding winch or give signals to operator.
 - iv) In case of every hoisting machine and of every chain ring hook, shackle swivel and pulley block used in hoisting or as means of suspension, the safe working load shall be ascertained by adequate means. Every hoisting machine and all gear referred to above shall be plainly marked with the safe working load. In case of a hoisting machine having a variable safe working load each safe working load and the condition under which it is applicable shall be clearly indicated. No part of any machine or any gear referred to above in this paragraph shall be loaded beyond the safe working load except for the purpose of testing.
 - v) In case of departmental machines, the safe working load shall be notified by the Electrical Engineer-in-Charge. As regards Contractor's machines the Contractors shall notify the safe working load of the machine to the Engineer-in-Charge whenever he brings any machinery to site of work and get it verified by the Electrical Engineer concerned.
12. Motors, gearing, transmission, electric wiring and other dangerous parts of hoisting appliances should be provided with efficient safeguards. Hoisting appliances should be provided with such means as will reduce to the minimum the risk of accidental descent of the load. Adequate precautions should be taken to reduce to the minimum the risk of any part of a suspended load becoming accidentally displaced. When workers are employed on electrical installations which are already energized, insulating mats, wearing apparel, such as gloves, sleeves and boots as may be necessary should be provided. The worker should not wear any rings, watches and carry keys or other materials which are good conductors of electricity.
13. All scaffolds, ladders and other safety devices mentioned or described herein shall be maintained in safe condition and no scaffold, ladder or equipment shall be altered or removed while it is in use. Adequate washing facilities should be provided at or near places of work.



14. These safety provisions should be brought to the notice of all concerned by display on a notice board at a prominent place at work spot. The person responsible for compliance of the safety code shall be named therein by the Contractor.
15. To ensure effective enforcement of the rules and regulations relating to safety precautions the arrangements made by the Contractor shall be open to inspection by the Labour Officer or Engineer-in-Charge of the department or their representatives.
16. Notwithstanding the above Clauses from (1) to (15), there is nothing in these to exempt the Contractor from the operations of any other Act or Rules in force in the Republic of India.



MODEL RULES FOR THE PROTECTION OF HEALTH AND SANITARY ARRANGEMENTS FOR WORKERS EMPLOYED BY AAI OR ITS CONTRACTORS

1. APPLICATION

These rules shall apply to all buildings and construction works in charge of AAI in which twenty or more workers are ordinarily employed or are proposed to be employed in any day during the period during which the Contract work is in progress.

2. DEFINITION

Work place means a place where twenty or more workers are ordinarily employed in connection with construction work on any day during the period during which the Contract work is in progress.

3. FIRST-AID FACILITIES

- (i) At every work place, there shall be provided and maintained, so as to be easily accessible during working hours, first-aid boxes at the rate of not less than one box for 150 Contract labour or part thereof ordinarily employed.
- (ii) The first-aid box shall be distinctly marked with a red cross on white background and shall contain the following equipment.
 - (a) For work places in which the number of Contract labour employed does not exceed 50. Each first-aid box shall contain the following equipments:
 1. 6 small sterilised dressings
 2. 3 medium size sterilised dressings
 3. 3 large size sterilised dressings
 4. 3 large sterilised burn dressings
 5. 1 (30 ml) bottle containing a two per cent alcoholic solution of iodine.
 6. 1 (30 ml) bottle containing sal volatile having the dose and mode of administration indicated on the label.
 7. 1 snake bite lancet.
 8. 1 (30 gms) bottle of potassium permanganate crystals.
 9. 1 pair scissors.
 10. 1 copy of the first-aid leaflet issued by the Director General, Factory Advice Service and Labour Institute, Government of India.
 11. 1 bottle containing 100 tablets (each of 5 gms) of aspirin.
 12. Ointment for burns.
 13. A bottle of suitable surgical antiseptic solution.
 - (b) For work places in which the number of Contract labour exceed 50. Each first-aid box shall contain the following equipments.
 1. 12 small sterilised dressings.
 2. 6 medium size sterilised dressings.
 3. 6 large size sterilised dressings
 4. 6 large size sterilised burn dressings.
 5. 6 (15 gms) packets sterilised cotton wool.
 6. 1 (60 ml) Bottle containing two per cent alcoholic solution of iodine.
 7. 1 (60 ml) bottle containing sal volatile having the dose and mode of administration indicated on the label.
 8. 1 roll of adhesive plaster.
 9. 1 snake bite lancet.
 10. 1 (30 gms) bottle of potassium permanganate crystals.
 11. 1 pair scissors.
 12. 1 copy of the first-aid leaflet issued by the Director General Factory Advice Service and Labour Institute, Government of India.
 13. A bottle containing 100 tablets (each of 5 gms) of aspirin.



14. Ointment for burns.
15. A bottle of suitable surgical antiseptic solution.
- (iii) Adequate arrangements shall be made for immediate recoupment of the equipment when necessary.
- (iv) Nothing except the prescribed contents shall be kept in the First-aid box.
- (v) The first-aid box shall be kept in charge of a responsible person who shall always be readily available during the working hours of the workplace.
- (vi) A person in charge of the First-aid box shall be a person trained in First-aid treatment in the work places where the number of Contract labour employed is 150 or more.
- (vii) In work places where the number of Contract labour employed is 500 or more and hospital facilities are not available within easy distance from the works, First-aid posts shall be established and run by a trained compounder. The compounder shall be on duty and shall be available at all hours when the workers are at work.
- (viii) Where work places are situated in places which are not towns or cities, a suitable motor transport shall be kept readily available to carry injured person or person suddenly taken ill to the nearest hospital.

4. DRINKING WATER

- i) In every work place, there shall be provided and maintained at suitable places, easily accessible to labour, a sufficient supply of cold water fit for drinking.
- ii) Where drinking water is obtained from an intermittent public water supply, each work place shall be provided with storage where such drinking water shall be stored.
- iii) Every water supply or storage shall be at a distance of not less than 50 feet from any latrine drain or other source of pollution. Where water has to be drawn from an existing well which is within such proximity of latrine, drain or any other source of pollution, the well shall be properly chlorinated before water is drawn from it for drinking. All such wells shall be entirely closed in and be provided with a trap door which shall be dust and waterproof.
- iv) A reliable pump shall be fitted to each covered well, the trap door shall be kept locked and opened only for cleaning or inspection which shall be done at least once a month.

5. WASHING FACILITIES

- i) In every work place adequate and suitable facilities for washing shall be provided and maintained for the use of Contract labour employed therein.
- ii) Separate and adequate cleaning facilities shall be provided for the use of male and female workers.
- iii) Such facilities shall be conveniently accessible and shall be kept in clean and hygienic condition.

6. LATRINES AND URINALS

- i) Latrines shall be provided in every work place on the following scale namely:
 - a) Where female are employed, there shall be at least one latrine for every 25 females.
 - b) Where males are employed, there shall be at least one latrine for every 25 males.
- ii) Provided that, where the number of males or females exceeds 100, it shall be sufficient if there is one latrine for 25 males or females as the case may be up to the first 100, and one for every 50 thereafter.
- iii) Every latrine shall be under cover and so partitioned off as to secure privacy, and shall have a proper door and fastenings.
- iv) Construction of latrines: The inside walls shall be constructed of masonry or some suitable heat-resisting nonabsorbent materials and shall be cement washed inside and outside at least once a year. Latrines shall not be of a standard lower than borehole system.

- v) (a) Where workers of both sexes are employed, there shall be displayed outside each block of latrine and urinal, a notice in the language understood by the majority of the workers "For Men only" or "For Women Only" as the case maybe.
(b) The notice shall also bear the figure of a man or of a woman, as the case may be.
- vi) There shall be at least one urinal for male workers up-to 50 and one for female workers up-to fifty employed at a time, provided that where the number of male or female workmen, as the case may be exceeds 500, it shall be sufficient if there is one urinal for every 50 males or females up-to the first 500 and one for every 100 or partthereafter.
- vii) (a) The latrines and urinals shall be adequately lighted and shall be maintained in a cleanand sanitary condition at alltimes.
(b) Latrines and urinals other than those connected with a flush sewage system shall comply with the requirements of the Public Health Authorities.
- viii) Water shall be provided by means of tap or otherwise so as to be conveniently accessible in or near the latrines andurinals.
- ix) Disposal of Excreta: Unless otherwise arranged for by the local sanitary authority, arrangements for proper disposal of excreta by incineration at the work place shall be made by means of a suitable incinerator. Alternately excreta may be disposed of by putting a layer of night soil at the bottom of a pucca tank prepared for the purpose and covering it with a 15 cm. Layer of waste or refuse and then covering it with a layer of earth for a fortnight (when it will turn tomanure).
- x) The Contractor shall at his own expense, carry out all instructions issued to him by the Engineer-in-Charge to effect proper disposal of night soil and other conservancy work in respect of the Contractor's workmen or employees on the site. The Contractor shall be responsible for payment of any charges which may be levied by Municipal or Cantonment Authority for execution of such on hisbehalf.

7. PROVISION OF SHELTER DURINGREST

At every place there shall be provided, free of cost, four suitable sheds, two for meals and the other two for rest separately for the use of men and women labour. The height of each shelter shall not be less than 3 metres (10 ft) from the floor level to the lowest part of the roof. These shall be kept clean and the space provided shall be on the basis of 0.6 sq.m. (6 sft) per head. Provided that the Engineer-in-Charge may permit subject to his satisfaction, a portion of the building under construction or other alternative accommodation to be used for the purpose.

8. CRECHES

- i) At every work place, at which 20 or more women workers are ordinarily employed, there shall be provided two rooms of reasonable dimensions for the use of their children under the age of six years. One room shall be used as a play room for the children and the other as their bedroom. TheroomsshallbeconstructedwithspecificationsasperClause19H(ii) a,b&c.
- ii) The rooms shall be provided with suitable and sufficient openings for light and ventilation. There shall be adequate provision of sweepers to keep the placesclean.
- iii) The Contractor shall supply adequate number of toys and games in the play room and sufficient number of cots and beddings in the bedroom.
- iv) The Contractor shall provide one ayaa to look after the children in the crèche when the number of women workers does not exceed 50 and two when the number of women workers exceed50.
- v) The use of the rooms earmarked as crèches shall be restricted to children, their attendants and mothers of thechildren.

9. CANTEENS

- i) In every work place where the work regarding the employment of Contractor labour is likely to continue for six months and where in Contract labour numbering one hundred or more are ordinarily employed, an adequate canteen shall be provided by the Contractor for the use of such Contract labour.
- ii) The canteen shall be maintained by the Contractor in an efficient manner.
- iii) The canteen shall consist of at least a dining hall, kitchen, storeroom, pantry and washing places separately for workers and utensils.
- iv) The canteen shall be sufficiently lighted at all times when any person has access to it.
- v) The floor shall be made of smooth and impervious materials and inside walls shall be limewashed or colour washed at least once in each year. Provided that the inside walls of the kitchen shall be lime washed every four months.
- vi) The premises of the canteen shall be maintained in a clean and sanitary condition.
- vii) Waste water shall be carried away in suitable covered drains and shall not be allowed to accumulate so as to cause an nuisance.
- viii) Suitable arrangements shall be made for the collection and disposal of garbage.
- ix) The dining hall shall accommodate at a time 30 per cent of the Contract labour working at a time.
- x) The floor area of the dining hall, excluding the area occupied by the service counter and any furniture except tables and chairs shall not be less than one square metre (10 sq ft) per diner to be accommodated as prescribed in Sub-Rule (ix).
- xi) (a) A portion of the dining hall and service counter shall be partitioned off and reserved for women workers in proportion to their number. (b) Washing places for women shall be separate and screened to secure privacy.
- xii) Sufficient tables, stools, chairs or benches shall be available for the number of diners to be accommodated as prescribed in Sub-Rule (ix).
- xiii) (a) 1. There shall be provided and maintained sufficient utensils, crockery, furniture and any other equipment necessary for the efficient running of the canteen.
 2. The furniture, utensils and other equipment shall be maintained in a clean and hygienic condition.
 (b) 1. Suitable clean clothes for the employees serving in the canteen shall be provided and maintained.
 2. A service counter, if provided, shall have top of smooth and impervious material.
 3. Suitable facilities including an adequate supply of hot water shall be provided for the cleaning of utensils and equipments.
- xiv) The food stuffs and other items to be served in the canteen shall be in conformity with the normal habits of the Contract labour.
- xv) The charges for food stuffs, beverages and any other items served in the canteen shall be based on 'No Profit, No loss' and shall be conspicuously displayed in the canteen.
- xvi) In arriving at the price of food stuffs, and other articles served in the canteen, the following items shall not be taken into consideration as expenditure namely:-
 - a) The rent of land and building.
 - b) The depreciation and maintenance charges for the building and equipments provided for the canteen.
 - c) The cost of purchase, repairs and replacement of equipments including furniture, crockery, cutlery and utensils.
 - d) The water charges and other charges incurred for lighting and ventilation.
 - e) The interest and amounts spent on the provision and maintenance of equipments provided for the canteen.
- xvii) The accounts pertaining to the canteen shall be audited once every 12 months by registered accountants and auditors.



10. ANTI-MALARIAL PRECAUTIONS

The Contractor shall at his own expense, conform to all anti-malarial instructions given to him by the Engineer-in-Charge including the filling up of any borrow pits which may have been dug by him.

- 11.** The above rules shall be incorporated in the Contracts and in notices inviting tenders and shall form an integral part of the Contracts.

12. AMENDMENTS

AAI may, from time to time, add to or amend these rules and issue directions - it may consider necessary for the purpose of removing any difficulty which may arise in the administration thereof.

AIRPORTS AUTHORITY OF INDIA

Contractor's Labour Regulations

1. SHORT TITLE

These regulations may be called the AAI Contractors Labour Regulations.

2. DEFINITIONS

(i) **Workman** means any person employed by AAI or its Contractor directly or indirectly through a subcontractor with or without the knowledge of the AAI to do any skilled, semiskilled or unskilled manual, supervisory, technical or clerical work for hire or reward, whether the terms of employment are expressed or implied but does not include any person:-

- a) Who is employed mainly in a managerial or administrative capacity:or
- b) Who, being employed in a supervisory capacity draws wages exceeding five hundred rupees per mensem or exercises either by the nature of the duties attached to the office or by reason of powers vested in him, functions mainly of managerial nature :or
- c) Who is an out worker, that is to say, person to whom any article or materials are given out by or on behalf of the principal employers to be made up cleaned, washed, altered, ornamental finished, repaired adopted or otherwise processed for sale for the purpose of the trade or business of the Principal Employers and the process is to be carried out either in the home of the out worker or in some other premises, not being premises under the control and management of the Principal Employer.

No person below the age of 14 years shall be employed to act as a workman.

(ii) **Fair Wages** means wages whether for time or piece work fixed and notified under the provisions of the Minimum Wages Act from time to time.

(iii) **Contractors** shall include every person who undertakes to produce a given result other than a mere supply of goods or articles of manufacture through Contract labour or who supplies Contract labour for any work and includes a subcontractor.

(iv) **Wages** shall have the same meaning as defined in the Payment of Wages Act.

3. i) Normally working hours of an adult employee should not exceed 9 hours a day. The working day shall be so arranged that inclusive of interval for rest, if any, it shall not spread over more than 12 hours on any day.
- ii) When an adult worker is made to work for more than 9 hours on any day or for more than 48 hours in any week, he shall be paid over time for the extra hours put in by him at double the ordinary rate of wages.
- iii) a) Every worker shall be given a weekly holiday normally on a Sunday, in accordance with the provisions of the Minimum Wages (Central) Rules 1960 as amended from time to time irrespective of whether such worker is governed by the Minimum Wages Act or not.
- b) Where the minimum wages prescribed by the Central/State Government under the Minimum Wages Act are not inclusive of the wages for the weekly day of rest, the worker shall be entitled to rest day wages at the rate applicable to the next preceding day, provided he has worked under the same Contractor for a continuous period of not less than 6 days.
- c) Where a Contractor is permitted by the Engineer-in-Charge to allow a worker to work on a normal weekly holiday, he shall grant a substituted holiday to him for the whole day on one of the five days immediately before or after the normal weekly holiday and pay wages to such worker for the work performed on the normal weekly holiday at overtime rate.

4. DISPLAY OF NOTICE REGARDING WAGES ETC.

The Contractor shall before he commences his work on Contract, display and correctly maintain and continue to display and correctly maintain in a clear and legible condition in conspicuous places on the work, notices in English and in the local Indian languages spoken by the majority of the workers giving the minimum rates of wages fixed under Minimum Wages Act, the actual wages being paid, the hours of work for which such wage are earned, wages periods, dates of payments of wages and other relevant information as per Appendix V.

5. PAYMENT OF WAGES

- (i) The Contractor shall fix wage periods in respect of which wages shall be payable.
- (ii) No wage period shall exceed one month.
- (iii) The wages of every person employed as Contract labour in an establishment or by a Contractor where less than one thousand such persons are employed shall be paid before the expiry of seventh day and in other cases before the expiry of tenth day after the last day of the wage period in respect of which the wages are payable.
- (iv) Where the employment of any worker is terminated by or on behalf of the Contractor the wages earned by him shall be paid before the expiry of the second working day from the date on which his employment is terminated.
- (v) All payment of wages shall be made on a working day at the work premises and during the working time and on a date notified in advance and in case the work is completed before the expiry of the wage period, final payment shall be made within 48 hours of the last working day.
- (vi) Wages due to every worker shall be paid to him direct or to other person authorised by him in this behalf.
- (vii) All wages shall be paid in current coin or currency or in both.
- (viii) Wages shall be paid without any deductions of any kind except those specified by the Central Government by general or special order in this behalf or permissible under the Payment of Wages Act 1956.
- (ix) A notice showing the wages period and the place and time of disbursement of wages shall be displayed at the place of work and a copy sent by the Contractor to the Engineer-in-Charge under acknowledgement.
- (x) It shall be the duty of the Contractor to ensure the disbursement of wages in the presence of the Senior Superintendent Engg or authorised representative of the Engineer-in-Charge who will be required to be present at the place and time of disbursement of wages by the Contractor to workmen.
- (xi) The Contractor shall obtain from Engineer-in-Charge or the authorised representative of the Engineer-in-Charge a certificate under his signature at the end of the entries in the "Register of Wages" or the "Wage-cum-Muster Roll" as the case may be in the following form: "Certified that the amount shown in column No. has been paid to the workman concerned in my presence on.....at....."

Note: In case of payment of wages paid through bank, the Contractor shall submit a copy of bank statement for relevant period duly signed by him.

6. FINES AND DEDUCTIONS WHICH MAY BE MADE FROM WAGES

- (i) The wages of a worker shall be paid to him without any deduction of any kind except the following:
 - a) Fines
 - b) Deductions for absence from duty i.e. from the place or the places where by the terms of his employment he is required to work. The amount of deduction shall be in proportion to the period for which he was absent.
 - c) Deduction for damage to or loss of goods expressly entrusted to the employed person for custody, or for loss of money or any other deduction which he is required to account, where such damage or loss is directly attributable to his neglect or default.
 - d) Deduction for recovery of advances or for adjustment of overpayment of wages, advances granted shall be entered in a register.
 - e) Any other deduction which the Central Government may from time to time allow.
- (ii) No fines should be imposed on any worker save in respect of such acts and omissions on his part as have been approved of by the Chief Labour Commissioner.

Note: An approved list of Acts and Omissions for which fines can be imposed is enclosed at Appendix-XIV.

- (iii) No fine shall be imposed on a worker and no deduction for damage or loss shall be made from his wages until the worker has been given an opportunity of showing cause against such fines or deductions.
- (iv) The total amount of fine which may be imposed in any one wage period on a worker shall not exceed an amount equal to three paise in a rupee of the total wages, payable to him in respect of that wage period.
- (v) No fine imposed on any worker shall be recovered from him by installment, or after the expiry of sixty days from the date on which it was imposed.
- (vi) Every fine shall be deemed to have been imposed on the day of the act or omission in respect of which it was imposed.

7. LABOUR RECORDS

- (i) ~~The Contractor shall maintain a Register of persons employed on work on Contract in Form A of the CL(R&A) Central Rules 1971 (Appendix VI)~~
- (ii) ~~The Contractor shall maintain a Muster Roll register in respect of all workmen employed by him on the work under Contract in Form D of the CL (R&A) Rules 1971 (Appendix VII).~~
- (iii) ~~The Contractor shall maintain a Wage and Over Time Register in respect of all workmen employed by him on the work under Contract in Form B of the CL (R&A) Rules 1971 (Appendix VIII)~~
- (iv) **Register of accident** - The Contractor shall maintain a register of accidents in such form as may be convenient at the work place but the same shall include the following particulars:
 - (a) Full particulars of the labourers who met with accident.
 - (b) Rate of Wages
 - (c) Sex
 - (d) Age
 - (e) Nature of accident and cause of accident
 - (f) Time and date of accident
 - (g) Date and time when admitted in Hospital
 - (h) Date of discharge from the Hospital
 - (i) Period of treatment and result of treatment
 - (j) Percentage of loss of earning capacity and disability as assessed by Medical officer
 - (k) Claim required to be paid under Workmen's Compensation Act.
 - (l) Date of payment of compensation
 - (m) Amount paid with details of the person to whom the same was paid
 - (n) Authority by whom the compensation was assessed.
 - (o) Remarks
- (v) ~~The Contractor shall maintain a Register of Loan/Recoveries in the Form C of the CL(R&A) Rules 1971 (Appendix IX).~~
~~The Contractor shall display in a good condition and in a conspicuous place of work the approved list of acts and omissions for which fines can be imposed (Appendix XIV)~~
- (vi) ~~The Contractor shall maintain a Register of deductions for damage or loss in Form XX of the CL (R&A) Rules 1971 (Appendix XIV)~~
- (vii) ~~The Contractor shall maintain a Register of Advances in Form XXII of the CL (R&A) Rules 1971 (Appendix XV)~~
- (viii) ~~The Contractor shall maintain a Register of Overtime in Form XXIII of the CL (R&A) Rules 1971 (Appendix XVI).~~

8. ATTENDANCE CARD-CUM-WAGESLIP

- (i) ~~The Contractor shall issue an Attendance card cum wage slip to each workman employed by him in the specimen form at (Appendix X and XI)~~
- (ii) ~~The card shall be valid for each wage period.~~
- (iii) ~~The Contractor shall mark the attendance of each workman on the card twice each day, once at the commencement of the day and again after the rest interval, before he actually starts work.~~
- (iv) ~~The card shall remain in possession of the worker during the wage period under reference.~~



- ~~(v) The Contractor shall complete the wage slip portion on the reverse of the card at least a day prior to the disbursement of wages in respect of the wage period under reference.~~
- ~~(vi) The Contractor shall obtain the signature or thumb impression of the worker on the wage slip at the time of disbursement of wages and retain the card with himself.~~

9. EMPLOYMENT CARD

The Contractor shall issue an **Employment Card** in Form XIV of the CL (R&A) Central Rules 1971 to each worker within three days of the employment of the worker (Appendix-XII).

10. SERVICE CERTIFICATE

On termination of employment for any reason whatsoever the Contractor shall issue to the workman whose services have been terminated, a **Service Certificate** in Form XV of the CL(R&A) Central Rules 1971. (Appendix-XIII)

11. PRESERVATION OF LABOUR RECORDS

All records required to be maintained under Regulations Nos. 6 & 7 shall be preserved in original for a period of three years from the date of last entries made in them and shall be made available for inspection by the Engineer-in-Charge or Labour Officer or any other officers authorised by the Ministry of Labour/Civil Aviation ~~Urban Development~~ in this behalf.

12. POWER OF LABOUR OFFICER TO MAKE INVESTIGATIONS OR ENQUIRY

The Labour Officer or any person authorised by Central Government on their behalf shall have power to make enquiries with a view to ascertaining and enforcing due and proper observance of Fair Wage Clauses and the Provisions of these Regulations. He shall investigate into any complaint regarding the default made by the Contractor or subcontractor in regard to such provision.

13. REPORT OF LABOUR OFFICER

The Labour Officer or other persons authorised as aforesaid shall submit a report of result of his investigation or enquiry to the Engineer-in-Charge concerned indicating the extent, if any, to which the default has been committed with a note that necessary deductions from the Contractor's bill be made and the wages and other dues be paid to the labourers concerned. In case an appeal is made by the Contractor under Clause 14 of these regulations, actual payment to labourers will be made by the Engineer-in-Charge after G.M. Engg. has given his decision on such appeal.

(i) Engineer-in-Charge shall arrange payments to the labour concerned within 45 days from the receipt of the report from the Labour Officer or the G.M. Engineer as the case maybe.

14. APPEAL AGAINST THE DECISION OF LABOUR OFFICER

Any person aggrieved by the decision and recommendations of the Labour Officer or other person so authorised may appeal against such decision to the Engineer-in-Charge concerned within 30 days from the date of decision, but subject to such appeal, the decision of the officer shall be final and binding upon the Contractor.

15. PROHIBITION REGARDING REPRESENTATION THROUGH LAWYER

- (i) A workman shall be entitled to be represented in any investigation or enquiry under these regulations by:
 - a) An officer of a registered trade union of which he is amember.
 - b) An officer of a federation of trade unions to which the trade union referred to in Clause (a) is affiliated.



- c) Where the employer is not a member of any registered trade union, by an officer of a registered trade union, connected with the industry in which the worker is employed or by any other workman employed in the industry in which the worker is employed.
- (ii) An employer shall be entitled to be represented in any investigation or enquiry under these regulations by:
 - a) An officer of an association of employers of which he is a member.
 - b) An officer of a federation of associations of employers to which association referred to in Clause(a) is affiliated.
 - c) Where the employer is not a member of any association of employers, by an officer of association of employer connected with the industry in which the employer is engaged or by any other employer, engaged in the industry in which the employer is engaged.
- (iii) No party shall be entitled to be represented by a legal practitioner in any investigation or enquiry under these regulations.

16. INSPECTION OF BOOKS AND SLIPS

The Contractor shall allow inspection of all the prescribed labour records to any of his workers or to his agent at a convenient time and place after due notice is received or to the Labour Officer or any other person, authorised by the Central Government on his behalf .

17. SUBMISSION OF RETURNS

The Contractor shall submit periodical returns as may be specified from time to time.

18. AMENDMENTS

The Central Government/AAI may from time to time add to or amend the regulations and on any question as to the application/interpretation or effect of those regulations the decision of the General Manager (Engg.) concerned shall be final.

APPENDIX-I A

FORM OF PERFORMANCE SECURITY (GUARANTEE)
Bank Guarantee Bond
(On Non-Judicial Stamp Paper of Rs. 100/-)

1. In consideration of the Chairman, AAI (hereinafter called "AAI") having offered to accept the terms and conditions of the proposed agreement between.....
..... [hereinafter called the said Contractor(s)] for the work (hereinafter "the said agreement") having agreed to production of an irrevocable Bank Guarantee for Rs..... (Rupeesonly) as a security / guarantee from the Contractor(s) for compliance of his obligations in accordance with the terms and conditions in the said agreement.
We (Indicate the name of the Bank) (hereinafter referred to as "the Bank") hereby undertake to pay to the Chairman, AAI an amount not exceeding Rs. (Rupees only) on demand by AAI.

2. We (Indicate the name of the Bank) do hereby undertake to pay the amounts due to payable under this Guarantee without any demure, merely on a demand from AAI stating that the amount claimed is required to meet the recoveries due or likely to be due from the said Contractor(s). Any such demand made on the Bank shall be conclusive as regards the amount due and payable by the Bank under this Guarantee. However, our liability under this guarantee shall be restricted to an amount not exceeding Rs. (Rupeesonly).

3. We, the said Bank, further undertake to pay the Chairman, AAI any money so demanded notwithstanding any dispute or disputes raised by the Contractor(s) in any suit or proceeding pending before any court or tribunal relating thereto, our liability under this present being absolute and unequivocal.

The payment so made by us under this bond shall be a valid discharge of our liability for payment there under and the Contractor(s) shall have no claim against us for making such payment.

4. We..... (Indicate the name of bank) further agree that the guarantee herein contained shall remain in full force and effect during the period that would be taken for the performance of the said agreement and that it shall continue to be enforceable till all the dues of AAI under or by virtue of the said agreement have been fully paid and its claims satisfied or discharged or till Engineer-in-Charge on behalf of AAI certified that the terms and conditions of the said agreement have been fully and properly carried out by the said Contractor(s) and accordingly discharges this guarantee.

5. We..... (indicate the name of the bank) further agree with AAI that AAI shall have the fullest liberty without our consent and without effecting in any manner our obligations hereunder to vary any of terms and conditions of the said agreement or to extend time of performance by the said Contractor(s) from time to time or to postpone for any time or from time to time any of the powers exercisable by AAI against in the said Contractor(s) and to forebear and enforce any of the terms and conditions relating to the said agreement and we shall not be relieved from our liability by reason of any such variation, or extensions being granted to the said Contractor(s) or for any forbearance, act of omission on the part of AAI or any indulgence by the AAI to the said Contractor(s) or by any such matter or thing whatsoever which under the law relating to securities would, but for this provision, have effect of so relieving us.



6. This guarantee will not be discharged due to the change in the constitution of the Bank or the Contractor(s).
7. We..... (Indicate the name of the bank) lastly undertake not to revoke this guarantee except with the previous consent of AAI in writing.
8. This guarantee shall be valid up-to unless extended on demand by AAI. Notwithstanding anything mentioned above, our liability against this guarantee is restricted to Rs. (Rupees only) and unless a claim in writing is lodged within six months of the date of expiry or the extended date of expiry of this guarantee all our liabilities under this guarantee shall stand discharged.

In presence of

Dated this _____ Day of _____

Witness

- 1.
- 2.

For and on behalf of (The Bank)
 Signature _____
 Name & Designation _____
 Authorisation No. _____
 Name & Place _____
 Bank's Seal _____

The above Guarantee is accepted by Airports Authority of India.

For and on behalf of Airports Authority of India

Signature _____
 Name _____
 Designation _____
 Dated _____

Note : * Date of validity should be Schedule date of completion + Defects Liability Period of 1 Year + Six months.



**FORM OF BANK GUARANTEE IN LIEU OF SECURITY DEPOSIT & AMOUNT
WITHHELD AGAINST COMPENSATION FOR DELAY IN INDIVIDUAL CONTRACT
(on Non-Judicial Stamp Paper of Rs.100/-)**

[Refer Clause1A and 2B]

**To
The Airports Authority of India**

.....
.....

1. In consideration of the Airport Authority of India having its head office at New Delhi [hereinafter called the “AAI” which expression shall unless repugnant to the subject or context include its administrator, successors and assigns) having agreed under the terms and condition of Contract Agreement No.dated.....made between.....and AAI in connection with the work of(hereinafter called the said Contract) to accept Deed of Guarantee as herein provided for Rs.....(Rupees.....only) from a Nationalized Bank in lieu of the Security deposit to be made by the Contractor or lieu of the amount withheld towards compensation for delay pending final extension of time to be made from the Contractors contained in the said Contractor. We, the.....bank (hereinafter referred to as “the said Bank” and having our registered office atdo hereby undertake and agree to identify and keep indemnified AAI from time to time to the extent of Rs.....(Rupees.....only) against any loss or damage, cost, charges and expenses caused to or suffered by or that may be caused to or suffered by AAI by reason of any breach or breaches by the said Contractor of any of the terms and condition contained in the said Contract and to unconditionally pay the amount claimed by AAI on demand and without demur to the extent aforesaid.
2. We Bank, further agree that AAI shall be the sole judge of and as to whether the said Contractor has committed any breach or breaches of any of the terms and conditions of the said Contract and the extent of loss, damage, costs, charges and expenses caused to or suffered by or that may be caused to or suffered by AAI on account thereof and the decision of AAI that the said Contractor has committed such breach and breaches and as to the amount or amounts of loss, damage, costs, charges and expenses caused to or suffered of that may be caused to or suffered by AAI from time to time shall be final and binding on us.
3. We, the said Bank, further agree that the Guarantee herein contained shall remain in full force and effect during the period that would be taken for the performance of the said Contracts and till all the dues of AAI under the said Contract or by virtue of any of the terms and conditions governing the said Contract including compensation for delay if any as decided by AAI, have been fully paid and its claims satisfied or discharged and till the Accepting Authority of the Contract certifies that the terms and condition and accordingly Contract have been fully and properly carried out by the said Contractor and accordingly discharges this guarantee subject, however that AAI shall have no claim under this Guarantee after 90(Ninety) days from the date of expiry of the defects Liabilities periods or Final /Extension of Time grated by AAI as provided available in agreements ClauseNo.....as provided in the said Contract, i.e.....(date) or from the date of cancellation of the said Contract, as the case may be, unless a notice of the claim under this Guarantee has been served on the Bank before the expiry of the period in which case the same shall be enforceable against the Bank notwithstanding the fact, that the same is enforced after the expiry of the said period.



4. AAI shall have the fullest liberty without affecting in any way the liability of the bank under this Guarantee or Indemnity from time to time to vary any of the terms and conditions of the said Contract or to extend time of performance by the said Contractor or to postpone for any time and from time to time any of the powers exercisable by it against the said Contractor and either to enforce or forbear from enforcing any of terms and conditions governing the said Contract or securities available to AAI and the said Bank shall not be released from its liability under these present by any exercise by AAI of any liberty with reference to the matters aforesaid or by reason of time being given to the said Contractor or any other forbearance, act or omission on the part by AAI or any indulgence by AAI to the said Contractor or any other matter or thing whatsoever which under the law relating to sureties would but for this provision have the effect of so releasing the Bank from its such liability.
5. It shall not be necessary for AAI to proceed against the Contractor before proceeding against the Bank and the Guarantee herein contained shall be enforceable against the Bank, notwithstanding any security which AAI may have obtained or obtain from the Contractor at the time when proceedings are taken against the Bank hereunder be outstanding or unrealized.
6. We, the said Bank, lastly undertake not to revoke this Guarantee during its currency except with the previous consent of AAI in writing and agree that any charge in the Constitution of the said Contract or the said Bank shall not discharge our liability hereunder.

In presence of

Dated this _____ Day of _____

WITNESS

1.

2.

For and on behalf of (The Bank)

Signature _____

Name & Designation _____

Authorisation No. _____

Name & Place _____

Bank's Seal .

The above Guarantee is accepted by Airports Authority of India.

For and on behalf of Airports Authority of India

Signature _____

Name _____

Designation _____

Dated _____

**APPENDIX-I****CFORM OF BANK GUARANTEE AGAINST EARNEST MONEY DEPOSIT**

WHEREAS, Contractor _____ (Name of Contractor) (hereinafter called "the Contractor") has submitted his tender dated _____ (date) for the construction of "____" (Name of Work) (hereinafter called "the TENDER").

KNOW ALL PEOPLE by these presents that we _____ (Name of Bank) having our registered office at _____ (hereinafter called "the bank") are bound unto Airports Authority of India through its "Bid Manager/Engineer-in-Charge/ AAI's Authorised representative" (Designation with Address) (hereinafter called the "Bid Manager/Engineer-in-Charge/ AAI's Authorised representative", as the case may be which expression shall unless repugnant to the subject or contract includes its administrators, successors and assigns) in the sum of Rs. _____ (Rs. In words _____) for which payment will truly to be made to the said "Bid Manager/Engineer-in-Charge/ AAI's Authorised representative" the bank binds itself, his successors and assigns by these presents.

SEALED with the Common Seal of the Bank this _____ day of _____ 20____
THE CONDITIONS of this obligation are:

(1) If after tender opening the Contractor withdraws, his tender during the period of validity of tender (including extended validity of tender) specified in the Form of Tender.

(2) If the Contractor having been notified of the acceptance of his tender by the "Bid Manager/Engineer-in-Charge/ AAI's Authorised representative".

a) Fails or refuses to execute the form of Agreement in accordance with the instructions to Contractor, if required—

OR

b) Fails or refuses to furnish the Performance Guarantee, in accordance with the provisions of tender document and instructions to Contractor,

OR

c) Fails or refuses to start the work, in accordance with the provisions of the Contract and instructions to Contractor,

OR

d) Fails or refuses to submit fresh Bank Guarantee of an equal amount of this Bank Guarantee against Security Deposit after award of Contract.

We undertake to pay to the "Bid Manager/Engineer-in-Charge/ AAI's Authorised representative" either up to the above amount or part thereof upon receipt of his first written demand, without the "Bid Manager/Engineer-in-Charge/ AAI's Authorised representative" having to substantiate his demand, provided that in his demand the "Bid Manager/Engineer-in-Charge/ AAI's Authorised representative" will note that the amount claimed by him is due to him owing to the concurrence of one or any of the above conditions, specifying the occurred condition or conditions.

This guarantee will remain in force up to and including the date* _____ after the deadline for submission of tender as such deadline is stated in the instructions to Contractor or as it may be extended by the "Bid Manager/Engineer-in-Charge/ AAI's Authorised representative", Notice of which extension(s) to the bank is hereby waived. Any demand in respect of this guarantee should reach the bank not later than the above date.

DATE

SIGNATURE OF THE BANK SEAL

WITNESS.....

(SIGNATURE NAME AND ADDRESS)

* Date to be worked out on the basis of validity period of 6 months from last date of receipt of tender.



APPENDIX-I D

Format for Letter of undertaking from the Depositor to Bank

(To be submitted along with Security Deposit / Earnest Money / Performance Guarantee to
Airports Authority of India)

(To be submitted in the Letter head of the firm)

The Branch Manager,
.....Bank,
.....

Sub: - My / Our Bank Guarantee bearing No.....dated for amount..... Issued in
favour of Airport Authority of India A/c.....

Sir,

The subject Bank Guarantee is obtained from your bank for the purpose of **Security Deposit / Earnest Money / Performance Guarantee** on account of Contract awarded / to be awarded by M/s Airports Authority of India to me/us.

I hereby authorized the Airport Authority of India in whose favour the deposit is made to close the subject Bank Guarantee before maturity/ on maturity toward adjustment of dues without any reference/consent/notice from me/our side and the bank is fully discharged by making the payment to Airport Authority of India.

Signature of the Depositor

Place:

Date:



APPENDIX-II

**PROFORMA FOR MANDATORY TESTS TO BE ATTACHED WITH RUNNING-
ACCOUNTBILLS**

Name of work:.....

Name of Contractor:.....

Contract — Agreement — No. — and — Date.....

R/A — Bill No.....

Sl. No.	Item	Quantities as per Agreement	Frequency as per Specification	No. of Tests Required	Up-to-date Quantity	No. of Tests Required	No. of Tests actually done	Remarks
1	2	3	4	5	6	7	8	9

Note: If the number of tests done are less than required, then reasons shall be recorded.

Signature of Supdt. (Engg)

Signature of Engineer in Charge. ————— Signature of Manager / AM (Engg)

~~REGISTER OF MATERNITY BENEFITS (Clause 19 F)~~

Contractor.....

work.....

Date on which maternity leave commenced and ended

Leave Pay paid to the Employee

GCC - 107



APPENDIX IV

**~~SPECIMEN FORM OF THE REGISTER, REGARDING MATERNITY BENEFIT
ADMISSION TO THE CONTRACTOR'S LABOUR IN
AIRPORTS AUTHORITY OF INDIA WORKS(CLAUSE 19F)~~**

~~Name and address of the Contractor~~_____

~~Name and location of the work~~_____

- ~~1) Name of the woman and her husband's name~~
- ~~2) Designation~~
- ~~3) Date of appointment~~
- ~~4) Date with months and years in which she is employed.~~
- ~~5) Date of discharge/dismissal, if any~~
- ~~6) Date of production of certificates in respect of pregnancy.~~
- ~~7) Date on which the woman informs about the expected delivery.~~
- ~~8) Date of delivery/miscarriage/death.~~
- ~~9) Date of production of certificate in respect of delivery/miscarriage.~~
- ~~10) Date with the amount of maternity/death benefit paid in advance of expected delivery~~
- ~~11) Date with amount of subsequent payment of maternity benefit~~
- ~~12) Name of the person nominated by the woman to receive the payment of the maternity benefit after the death.~~
- ~~13) If the woman dies, the date of her death, the name of the person to whom maternity benefit amount was paid, the month thereof and the date in the register.~~
- ~~14) Signature of the Contractor authenticating entries in the register.~~
- ~~15) Remarks column for the use of Inspection Officer.~~



APPENDIX V

Labour Board

Name of work

Name of Contractor

Address of Contractor

Name and address of A. A. I. Division

Name of A. A. I. Labour Officer

Address of A. A. I. Labour Officer

Name of A.A.I Labour Officer

Sl.No.	Category	Minimum wage fixed	Actual wage paid	Number present	Remark
--------	----------	-----------------------	---------------------	-------------------	--------

Weekly holiday

Wage period

Date of payment of wages

Working hours

Rest interval



Form A
 {See Rule 2(1)}
 {Part A: For all Establishments}
Register of Workmen Employed by Contractor

APPENDIX-VI

Name and address of Contractor.....

Name and address of establishment which Contractor is carried on.....

Name and location of work.....

Name and address of Principal Employer.....

Name of the Establishment _____ **Name of Owner** _____ **LIN** _____

Sl. No.	Employee-Code	Name	Surname	Gender	Father's/Spouse-Name	Date of Birth#	Nationality	Education-Level	Date of Joining	Designation
1	2	3	4	5	6	7	8	9	10	11

Category-Address *(HS/S/SS/US)	Type of Employment	Mobile	UAN	PAN	ESIC-IP	LWF	AADHAAR	Bank A/c Number	Bank	Branch (IFSC)	Present Address	Permanent
12	13	14	15	16	17	18	19	20	21	22	23	24

Service Book- No.	Date of Exit	Reason for Exit	Mark of Identification	Photo	Specimen Signature/Thumb- Impression	Remarks
25	26	27	28	29	30	31

*(Highly Skilled/Skilled/Semi Skilled/Un Skilled)#Note: In case the age is between 14 to 18 years, mention the nature of work, daily hours of work and Intervals of rest in the remarks Column.

**APPENDIX-VII****Form-D**

{See Rule 78 (1) (a) (i)}

FORMAT OF ATTENDANCE REGISTER

Name of Establishment.....

Name of Owner.....

LIN

For the Period From _____ To _____

Sl. No.	Name of Work Man	Set- Work	Date										Summary No. of Days	Remark/No. of Hrs	Sign of Register- Keeper
			1	2	3	4	5	:	:	3	3				
1	2	3	4										5	6	7



FORM B
[See Rule 78(1)(a) (i)]
FORMAT FOR WAGE REGISTER

APPENDIX VIII

Name and address of Contractor.....

Name and address of establishment which Contractor is carried on.....

Name and location of work.....

Name and address of Principal Employer.....For the month of fortnight.....

Rate of Minimum Wages and since the date.....				
	Highly Skilled	Skilled	Semi-Skilled	Un Skilled
Minimum Basic				
DA				
Overtime				

Name of the Establishment _____ Name of Owner _____ LIN _____

Wage period — From _ To _ (Monthly/Fortnightly/Weekly/Daily/Piece Rated)

Various Formats to be maintained (Appendix)



Sl. No. in Employee-register	Name	Rate of Wage	No. of Days-worked	Overtime hours-worked	Basic	Special Basic	DA	Payments-Overtime	HRA	Others	Total
1	2	3	4	5	6	7	8	9	10	11	12

Deduction								Net-Payment	Employer Share-PF Welfare Fund
PF	ESIC	Society	Income Tax	Insurance	Others	Recoveries	Total		
13	14	15	16	17	18	19	20	21	22

Receipt by Employee/Bank-Transaction ID	Date of Payment	Remarks
23	24	25



APPENDIX IX

FORM C
FORMAT OF REGISTER OF LOAN/ RECOVERIES

Name of Establishment _____ LIN _____

Sl. Number In Employee register	Name	Recovery Type (Damage/loss/fine/advance/loans)	Particulars	Date of damage/Loss*	Amount
1	2	3	4	5	6

Whether show cause issued*	Explanation heard in presence of*	Number of Instalments	First Month/Year	Last Month/Year	Date of Complete Recovery	Remarks
7	8	9	10	11	12	13

*Applicable only in case of damage/loss/fine



WAGE CARD

Wages Card No.....

Name and Address of Contractor.....Date of issue.....

Name and location of work.....Designation.....

Name of workman.....Month/Fortnight.....

Rate of Wages.....

	1	2	3	4	5	6	7	8	9	1	1	1	1	1	1	1	1	1	2	2	2	2	2	2	2	2	2	3	31	
										0	1	2	3	4	5	6	7	8	9	0	1	2	3	4	5	6	7	8	8	0

Morning

Rate

Evening

Amount

Initial

Received from.....the sum of Rs.....on account of my wages

Signature

The Wage Card is valid for one month from the date of issue



~~19/Form XIX~~
~~[See rule 78 (1) (b)]~~

APPENDIX XI

Wages Slip

Name and address of Contractor.....

Name and Father's/Husband name of workman.....

Name and location of work.....

For the week/Fortnight/Month ending.....

1. No. of days worked.....

2. No. of units worked in case of piece rateworkers.....

3. Rate of daily wages/piece rate.....

4. Amount of overtime wages.....

5. Gross wages payable.....

6. Deduction, if any.....

7. Net amount of wagespaid.....

Initials of the Contractor or his representative



APPENDIX XII

~~14/Form XIV~~
~~[See rule 76]~~
Employment Card

~~Name and address of Contractor.....~~

~~Name and address of establishment under which is carried.....~~

~~Name of work and location of work.....~~

~~Name and address of Principal Employee.....~~

~~1. Name of the workman.....~~

~~2. SI. No. in the register of workman employed.....~~

~~3. Nature of employment/designation.....~~

~~4. Wage rate (with particulars of unit in case of piecework).....~~

~~5. Wage period.....~~

~~6. Tenure of employment.....~~

~~7. Remark.....~~

Signature of Contractor

**APPENDIX XIII**

		Form XV (See Rule 77) Service Certificate			
Name and address of Contractor Nature and location of work Name and address of workman Age or date of birth Identification marks Father's/Husband's Name Name and address of establishment in/under which contract is carried on Name and address of Principal Employer					
Sl.No.	Total Period for which employed		Nature of work Done	Rate of Wages (with particulars of unit in case of piece work)	Remarks
	From	To			
1	2	3	4	5	6



APPENDIX-XIV

LIST OF ACTS AND OMISSIONS FOR WHICH FINES CAN BE IMPOSED

In accordance with Rule 7(v) of the AAI Contractor's Labour Regulations to be displayed prominently at the site of work both in English and local Language.

1. Willful insubordination or disobedience, whether alone or in combination with other.
2. Theft fraud or dishonesty in connection with the Contractors beside a business or property of AAI.
3. Taking or giving bribes or any illegal gratifications
4. Habitual late attendance.
5. Drunkenness lighting, riotous or disorderly or indifferent behavior
6. Habitual negligence.
7. Smoking near or around the area where combustible or other materials are locked
8. Habitual Indiscipline
9. Causing damage to work in the progress or to property of the AAI or of the Contractor.
10. Sleeping on duty.
11. Malingering or slowing down work.
12. Giving of false information regarding name, age, father's name, etc.
13. Habitual loss of wage cards supplied by the employer's
14. Unauthorized use of employer's property of manufacturing or making of unauthorized particles at the workplace
15. Bad workmanship in construction and maintenance by skilled workers which is not approved by the Department and for which the Contractors are compelled to undertake rectifications.
16. Making false complaints and/or misleading statements.
17. Engaging on trade within the premises of the establishments.
18. Any unauthorised divulgence of business affairs of the employees.
19. Collection or canvassing for the collection of any money within the premises of an establishment unless authorised by the employer.
20. Holding meeting inside the premises without previous sanction of the employers.
21. Threatening or intimidating any workman or employer during the working hours within the premises.



APPENDIX-XV

NOTICE FOR APPOINTMENT OF ARBITRATOR [Refer Clause 25]

To

.....
.....
.....

Dear Sir,

In terms of Clause 25 of the agreement, particular of which are given below, I/we hereby give notice to you to appoint an arbitrator for settlement of disputes mentioned below:

1. Name of applicant
2. Whether applicant is Individual/Prop. Firm /Partnership Firm/Ltd.Co.
3. Full address of the applicant.
4. Name of the work and Contract number in which arbitrator sought.
5. Name of the office which entered into Contract.
6. Contract amount in the work.
7. Date of Contract.
8. Date of initiation of work.
9. Stipulated date of completion of work.
10. Actual date of completion of work (if completed).
11. Total number of claim made.
12. Total amount claimed.
13. Date of intimation of final bill (if work is completed).
14. Date of payment of final bill (if work is completed).
15. Amount of final bill (if work is completed).
16. Date of request made to ED for decision.
17. Date of receipt of ED's decision.
18. Date of appeal.
19. Date of receipt of decision on appeal.

Specimen signature of the applicant
(Only the person/authority who
Signed the Contract should
sign)

I/We certify that the information given above is true to the best of my/our knowledge. I/We enclose following documents.

1. Statement of claims with amount of claims.
- 2.
- 3.
- 4.

Yours faithfully

(Signature)

Copy to:

1. The Engineer-in-Charge,
.....

**APPENDIX XVI****INTEGRITY PACT**

The Integrity Pact shall be signed by both the parties in the following Format:

~~“This Pact made thisday of between Airports Authority of India, a body corporate constituted by the Central Government under the Airports Authority of India Act, 1994 and having its Corporate Office at Rajiv Gandhi Bhawan, New Delhi, and offices atin India, hereinafter called the Authority (which term shall unless excluded by or is repugnant to the context, be deemed to include its Chairman, or Member, Executive Directors, Airport Directors, officers or any of them specified by the Chairman in this behalf, and shall also include its successors and assigns) of the one part~~

AND

~~.....represented by of the other part, hereinafter called the “Bidder/Contractor “(which term shall unless excluded by or is repugnant to the context be deemed to include its heirs, representatives, successors and assigns of the Bidder/Contractor)~~

~~WHEREAS the Authority intends to award, under laid down organizational procedures, tender/ Contract forThe Authority, while discharging its functions on business principles, values proper compliance with all relevant laws and regulations, and the principles of natural justice, ethics, equity, fairness and transparency in its relations with the Bidders/ Contractors.~~

~~WHEREAS the Authority is desirous to make its business mechanism more transparent, thus to ensure strict adherence of the aforesaid objectives/goals, the Authority hereby adopts the instrument developed by the renowned international non-governmental organization “Transparency International” (T I) headquartered in Berlin (Germany). The Authority will appoint an Independent External Monitor (IEM) who will monitor the tender process and the execution of the Contract for compliance with the principles mentioned above.~~

~~AND WHEREAS the Bidder is submitting a tender to the Authority for In response to the NIT (Notice Inviting Tender) dated Contractor is signing the Contract for execution ofNOW, therefore, To avoid all forms of corruption by following a system that is fair, transparent and free from any influence/prejudiced dealings prior to, during and subsequent to the currency of the Contract to be entered into with a view to Enabling the Authority to obtain the desired said stores/equipment/execution of works at a competitive price in conformity with the defined specifications by avoiding the high cost and the distortionary impact of corruption on public procurement, and Enabling Authority to abstain from bribing or indulging in any corrupt practice in order to secure the Contract by providing assurance to them that their competitors will also abstain from bribing and other corrupt practices and the Authority will commit to prevent corruption, in any form, by its officials by following transparent procedures. The parties hereto hereby agree to enter into this Integrity Pact and agree as follows:~~



1. ~~Commitments of the Authority;~~

- ~~1.1 The Authority undertakes that no official of the Authority, connected directly or indirectly with the Contract, will demand, take a promise for or accept, directly or through intermediaries, any bribe, consideration, gift, reward, favour or any material or immaterial benefit or any other advantage from the BIDDER, either for themselves or for any person, organization or third party related to the Contract in exchange for an advantage in the bidding process, bid evaluation, Contracting or implementation process related to the Contract.~~
- ~~1.2 The Authority will, during the pre-contract stage, treat all BIDDERS alike, and will provide to all BIDDERS the same information and will not provide any such information to any particular BIDDER which could afford an advantage to that particular BIDDER in comparison to other BIDDERS.~~
- ~~1.3 All the officials of the Authority will report to the appropriate authority office any attempted or completed breaches of the above commitments as well as any substantial suspicion of such breach.~~
- ~~1.4 In case any such preceding misconduct on the part of such official(s) is reported by the BIDDER to the Authority with full and verifiable facts and the same is prima facie found to be correct by the Authority, necessary disciplinary proceedings, or any other action as deemed fit, including criminal proceedings may be initiated by the Authority and such a person shall be debarred from further dealings related to the Contract process. In such a case while an enquiry is being conducted by the Authority the proceedings under the Contract would not be stalled.~~

2. ~~Commitments of Bidders/Contractor.~~

~~The Bidder/Contractor commits itself to take all measures necessary to prevent corrupt practice, unfair means and illegal activities during any stage of its bid or during any pre-Contract or post-Contract stage in order to secure the Contract or in furtherance to secure it and in particular commit itself to the following.~~

- ~~2.1 The Bidder/Contractor will not offer, directly or through intermediaries, any bribe, gift, consideration, reward, favour, any material or immaterial benefit or other advantage, commission, fees, brokerage or inducement to any official of the Authority, connected directly or indirectly with the bidding process, or to any person, organization or third party related to the Contract in exchange for any advantage in the bidding, evaluation, Contracting and implementation of the Contract.~~
- ~~2.2 The Bidder/Contractor further undertakes that it has not given, offered or promised to give, directly or indirectly any bribe, gift, consideration, reward, favour, any material or immaterial benefit or other advantage, commission, fees, brokerage or inducement to any official of the Authority or otherwise in procuring the Contract or forbearing to do or having done any act in relation to the _____ obtaining _____ or execution of the Contract or any other Contract with the Authority for showing or~~



~~for bearing to show favour or disfavour to any person in relation to the Contract or any other Contract with the Authority.~~

- ~~23 The Bidder / Contactor has not entered and will not enter with other bidders into any undisclosed agreement or understanding, whether formal or informal. This applies in particular to prices, specification, certifications, subsidiary Contracts, submission or non-submission of bids or any actions to restrict competitiveness or to introduce cartelization in the bidding process.~~
- ~~24 The Bidder/Contractor shall, when presenting his bid, disclose the name and address of agents and representatives and Indian BIDDERS shall disclose their foreign principals or associates.~~
- ~~25 The Bidder/Contractor shall when presenting his bid disclose any and all the payments he has made or, is committed to or intends to make to agents/brokers or any other intermediary, in connection with this bid/Contract.~~
- ~~26 The Bidder/Contractor further confirms and declares to the Authority that the BIDDER is the original manufacturer/integrator/authorized government sponsored export entity of the stores and has not engaged any individual or firm or company whether Indian or foreign to intercede, facilitate or in any way to recommend to the Authority or any of its functionaries, whether officially or unofficially to the award of the Contract to the BIDDER, nor has any amount been paid, promised or intended to be paid to any such individual, firm or company in respect of any such intercession, facilitation or recommendation.~~
- ~~27 The Bidder/Contractor, either while presenting the bid or during pre-Contract negotiations or before signing the Contract, shall disclose any payments he has made or has committed to or intends to make to officials of the Authority or their family members, agents, brokers or any other intermediaries in connection with the Contract and the details of services agreed upon for such payments.~~
- ~~28 The Bidder/Contractor will not collude with other parties interested in the Contract to impair the transparency, fairness and progress of the bidding process, bid evaluation, Contracting and implementation of the Contract.~~
- ~~29 The Bidder/Contractor will not accept any advantage in exchange for any corrupt practice, unfair means and illegal activities.~~
- ~~2.10 The Bidder / Contactor shall not use improperly, for purposes of competition or personal gain, or pass on to others, any information provided by the Authority as part of the business relationship, regarding plans, technical proposals and business details, including information contained in any electronic data carrier. The Bidder / Contactor also under takes to exercise due and adequate care lest any such information is divulged.~~
- ~~2.11 The Bidder/Contractor will inform to the Independent External Monitor:~~
 - ~~i) If he receives demand for an illegal/undue payment/benefit.~~



- ii) ~~If he comes to know of any unethical or illegal payment/benefit.~~
- iii) ~~If he makes any payment to any Authority's associate(s)~~
- 2.12 ~~The Bidder/Contractor commit to refrain from giving any complaint directly or through any other manner without supporting it with full and verifiable facts.~~
- 2.13 ~~The Bidder/Contractor shall not instigate or cause to instigate any third person to commit any of the actions mentioned above.~~
- 2.14 ~~If the Bidder/Contractor or any employee of the Bidder/Contractor or any person acting on behalf of the Bidder/Contractor, either directly or indirectly, is a relative of any of the officers of the Authority, or alternatively, if any relative of an officer of the Authority has financial interest/stake in the Bidder's/Contractor's firm, the same shall be disclosed by the Bidder/Contractor at the time filing of tender. The term 'relative' for this purpose would be as defined in Section 6 of the Companies Act 1956.~~
- 2.15 ~~The Bidder/Contractor shall not lend to or borrow any money from or enter into any monetary dealings or transactions, directly or indirectly, with any employee of the Authority.~~
- 2.16 ~~That if the Bidder/Contractor, during tender process or before the award of the Contract or during execution of the Contract/work has committed a transgression in violation of section 2 or in any other form such as to put his reliability or credibility as Bidder/Contractor into question, the Authority is entitled to disqualify him from the tender process or to terminate the Contract for such reason and to debar the BIDDER from participating in future bidding processes.~~

~~3. Previous Transgression~~

- 3.1 ~~The Bidder/Contractor declares that no previous transgression occurred in the last three years immediately before signing of this Integrity Pact, with any other company in any country in respect of any corrupt practices envisaged hereunder or with any Public Sector Enterprise in India or any Government Department in India that could justify Bidders's exclusion from the tender process.~~
- 3.2 ~~The Bidder/Contractor agrees that if it makes incorrect statement on this subject, he can be disqualified from the tender process or the Contract, if already awarded, can be terminated for such reason and he may be considered for debarment for future tender/Contract processes.~~
- 3.3 ~~That the Bidder/Contractor undertakes to get this Pact signed by the subcontractor(s) and associate(s) whose value of the work contribution exceeds Rs 0.5 Cr. (Rupees Zero Point Five Cr.) and to submit the same to the Authority along with the tender document/Contract before Contract signing.~~
- 3.4. ~~That sub-Contractor(s)/associate(s) engaged by the Contractor, with the approval of the Authority after signing of the Contract, and whose value of the work contribution exceeds Rs 0.5 Cr. (Rupees Zero Point Five Cr.) will be required to~~



~~sign this Pact by the Contractor, and the same will be submitted to the Authority before doing/performing any act/function by such subcontractor(s)/associate(s) in relation to the Contract/work.~~

~~3.5 That the Authority will disqualify from the tender process all Bidder(s) who don't sign this Pact or violate its provisions or fails to get this Pact signed in terms of policy of authority.~~

~~3.6 That if the Contractor(s) does/do not sign this Pact or violate its provisions or fails to get this Pact signed in terms of policy of Authority, Authority will terminate the Contract and initiate appropriate action against such Contractor(s).~~

~~4. Earnest Money, Security Deposit, Bank Guarantee, Draft, Pay Order or any other mode and its validity i/e Warranty Period, Performance Guarantee/Bond.~~

~~While submitting bid, the BIDDER shall deposit an EMD/SD/BG/DRAFT/PAY ORDER ETC I/C WARRANTY PERIOD, PG/BOND, VALIDITY etc. , which is as per terms and conditions and details given in NIT/Tender Documents sold to the Bidders.~~

~~5. Sanctions for Violations/Disqualification from tender process and exclusion from future Contacts.~~

~~5.1 Any breach of the aforesaid provisions by the BIDDER or any one employed by it or acting on its behalf (whether with or without the knowledge of the BIDDER) shall entitle the Authority to take all or any one of the following actions, wherever required:~~

~~i) To immediately call off the pre Contract negotiations without assigning any reason or giving any compensation to the BIDDER. However, the proceedings with the other BIDDER(s) would continue.~~

~~ii) To immediately cancel the Contract, if already signed, without giving any compensation to the BIDDER.~~

~~iii) If the Authority has disqualified / debarred the Bidder from the tender process prior to the award under Section 2 or 3 or 4, the Authority is entitled to forfeit the earnest money deposited/bid security.~~

~~iv) To recover all sums already paid by the Authority, and in case of an Indian BIDDER with interest thereon at 2% higher than the prevailing Prime Lending Rate of State Bank of India, while in case of a BIDDER from a country other than India with interest thereon at 2% higher than the LIBOR. If any outstanding payment is due to the BIDDER from the Authority in connection with any other Contract or any other stores, such outstanding payment could also be utilized to recover the aforesaid sum and interest.~~



- ~~v) To encash the advance bank guarantee and performance bond/warranty bond, if furnished by the BIDDER, in order to recover the payments, already made by the BUYER, along with interest.~~
- ~~vi) To cancel all or any other Contracts with the BIDDER. The BIDDER shall be liable to pay compensation for any loss or damage to the Authority resulting from such cancellation/rescission and the Authority shall be entitled to deduct the amount so payable from the money(s) due to the BIDDER.~~
- ~~vii) To debar the BIDDER from participating in future bidding processes for a for a period upto two years.~~
- ~~viii) To recover all sums paid in violation of this Pact by BIDDER(s) to any middleman or agent or broker with a view to securing the Contract.~~
- ~~ix) In case where irrevocable Letters of Credit have been received in respect of any contract signed by the Authority with the BIDDER, the same shall not be opened.~~
- ~~x) Forfeiture of Performance Bond in case of a decision by the BUYER to forfeit the same without assigning any reason for imposing sanction for violation of this Pact.~~
- ~~xi) That if the Authority have terminated the Contract under section 2 or 3 or 4 or if the Authority is entitled to terminate the Contract under section 2 or 3 or 4, the Authority shall be entitled to demand and recover from the Contractor damages equivalent to 5% of the Contract value or the amount equivalent to security deposit or performance bank guarantee, whichever is higher.~~
- ~~xii) That the Bidder / Contractor agrees and undertakes to pay the said amount without protest or demur subject only to condition that if the Bidder/Contractor can prove and establish to the satisfaction of the Authority that the disqualification / debarment of the bidder from the tender process or the termination of the Contract after award of the Contract has caused no damage to the Authority.~~

~~5.2 The Authority will be entitled to take all or any of the actions mentioned at Para 5.1 above [(i) to (xii)] of this Pact also on the Commission by the BIDDER or any one employed by it or acting on its behalf (whether with or without the knowledge of the BIDDER), of an offence as defined in Chapter IX of the Indian Penal code, 1860 or Prevention of Corruption Act, 1988 or any other statute enacted for prevention of corruption.~~



~~5.3 — That if the Bidder/Contractor applies to the Authority for premature revocation of the debarment and proves to the satisfaction of the Authority that he has installed a suitable and effective corruption prevention system and also restored/recouped the damage, if any, caused by him, the Authority may, if thinks fit, revoke the debarment prematurely considering the facts and circumstances of the case, and the documents/evidence adduced by the Bidder/Contractor for first time default.~~

~~5.4 — That a transgression is considered to have occurred if the Authority is fully satisfied with the available documents and evidence submitted along with Independent External Monitor's recommendations/suggestions that no reasonable doubt is possible in the matter.~~

~~5.5 — The decision of the Authority to the effect that a breach of the provisions of this Pact has been committed by the BIDDER shall be final and conclusive on the BIDDER. However, the BIDDER can approach the Independent External Monitor(s) appointed for the purpose of this Pact.~~

6. — Allegations against Bidders/Contractors/Sub-Contractors/Associates:

~~That if the Authority receives any information of conduct of a Bidder/Contractor or Sub-Contractor or of an employee or a representative or an associate of the Bidder, Contractor or Sub-Contractor which constitute corruption, or if the Authority has substantive suspicion in this regard, the Authority will inform the Vigilance Department for appropriate action.~~

7. — Independent External Monitor(s),

~~7.1. — That the Authority has appointed competent and credible Independent External Monitor(s) for this Pact.~~

~~7.2 — The task of the Monitor(s) is to review independently and objectively, whether and to what extent the parties comply with the obligations under this Pact. He will also enquire into any complaint alleging transgression of any provision of this Pact made by the Bidder, Contractor or Authority.~~

~~7.3. — That the Monitor(s) is not subject to any instructions by the representatives of the parties and would perform his functions neutrally and independently. He will report to the Chairperson of the Board of the Authority.~~

~~7.4 — That the Bidder/Contractor accepts that the Monitor(s) has the right to access without restriction to all project documentation of the Authority including that provided by the Bidder/Contractor. The Bidder/Contractor will also grant the Monitor, upon his request and demonstration of a valid interest, unrestricted and unconditional access to his project documentation including minutes of meeting. The same is applicable to Sub-Contractors and Associates. The Monitor is under obligation to treat the information and documents of the Authority and Bidder/Contractor/Sub-Contractors/Associates with confidentiality.~~

~~7.5. — That as soon as the Monitor notices, or believes to notice, a violation of this Pact, he will so inform the management of the Authority and request the management~~



~~to discontinue or heal the violation, or to take other relevant action. The Monitor(s) can in this regard submit his recommendations/ suggestions. Beyond this, the Monitor(s) has no right to demand from the parties that they act in a specific manner, refrain from action or tolerate action.~~

~~7.6 That the Authority will provide to the Monitor(s) sufficient information about all meetings among the parties related to the project provided such meetings could have an impact on the Contractual relations between the Authority and the Contractor / Bidder. The parties offer to the Monitor(s) the option to participate in such meetings.~~

~~7.7 That the Monitor(s) will submit a written report to the Chairperson of the Board of the Authority within 2 weeks from the date of reference or intimation to him by the Authority and, should the occasion arise, submit proposals for correcting problematicsituations.~~

~~7.8 That if the Monitor(s) has reported to the Chairperson of the Board a substantiated suspicion of an offence under relevant Anti Corruption Laws of India and the Chairperson has not, within reasonable time, taken visible action to proceed against such offence or reported it to the Vigilance Department, the Monitor may also transmit this information directly to the Central Vigilance Commissioner, Government of India.~~

~~7.9 The word 'Monitor' would include singular andplural.~~

~~8. Facilitation of Investigation.~~

~~In case of any allegation of violation of any provisions of this Pact or payment of emmission, the Authority or its agencies shall be entitled to examine all the documents including the Books of Accounts of the BIDDER and the BIDDER shall provide necessary information and documents in English and shall extend all possible help for the purpose of suchExamination.~~

~~9. Law and Place ofJurisdiction.~~

~~That this Pact is subject to provisions under Indian Law. The place of performance and jurisdiction is the Corporate Headquarter/the Regional Headquarter/Office of the Authority, asapplicable.~~

~~10. Other LegalActions~~

~~10.1 That the changes and supplements as well as termination notice need to be made inwriting.~~

~~10.2 That if the Bidder / Contractor are a partnership or a consortium, this Pact must be signed by all the partners and consortium members or their authorized representatives.~~



~~11. Pact duration(Validity)~~

~~11.1 That this Pact comes into force when both the parties have signed it. It expires for the Contractor 12 months after the final payment under the respective Contract, and for all other Bidders 3 months after the Contract is awarded.~~

~~11.2. That if any claim is made / lodged during this period, the same shall be binding and continue to be valid despite the lapse of this Pact as specified herein before, unless it is discharged/determined by Chairman of the Authority.~~

~~11.3 That should one or several provisions of this Pact turn out to be invalid; the remainder of this Pact shall remain valid. In this case, the parties will strive to come to an agreement to their original intentions.~~

~~12. Company Code of Conduct~~

~~Bidders are also advised to have a company code of conduct (clearly rejecting the use of bribes and other unethical behaviour) and a compliance program for the implementation of the code of conduct throughout the company.~~

~~13. The parties hereby sign this Integrity Pact at _____ on _____~~

Buyer

~~Name of the Officer~~

~~Designation~~

~~Deptt./Ministry/PSU~~

~~Witness~~

1. _____

2. _____

Bidder

~~CHIEF EXECUTIVE OFFICER~~

~~Witness~~

1. _____

2. _____

**APPENDIX XVII**

(To be filled by Contractor)
(~~CLAUSE 47~~)

Ratio of direct payment to the specialized _____ : _____ % of the net payment to be made to Specialized Agency in case of composite Contract _____ Agency

Sl. No.	Sub-head	Nature of work	% of the net payment to be made to Specialized Agency
1	Sub Head I		

Note:

1. ~~NIT approving authority must ensure that all sub-heads of works are covered in above table. The bidder must indicate percentage payable to specialized Agency in case of all sub-heads.~~
2. ~~If % is not filled in by the Contractor against one or more sub-head in this Schedule, then 75% of the net payment admissible as per AAI for the sub-head under consideration shall be paid directly to specialized Agency in case of composite Contract.~~



APPENDIX XVIII

INDENTURE FOR SECURED ADVANCES

(Reference Clause 10 B)

~~(For use in cases in which the contract is for finished work and the contractor has entered into an agreement for the execution of a certain specified quantity of work in a given time)~~

~~THIS INDENTURE made the..... day of 20.....
BETWEEN.....(hereinafter called the Contractor which expression shall where the
context so admits or implies be deemed to include his executors administrators and assigns) of
the one part and the CHAIRMAN, AAI (hereinafter called the AAI which expression shall where
the context so admits or implies be deemed to include his successors in office and assigns) of
the other part.~~

~~WHEREAS by an agreement dated (hereinafter called the said agreement)
the Contractor has agreed AND WHEREAS the Contractor has applied to the AAI that he may be
allowed advances on the security of materials absolutely belonging to him and brought by him to
the site of the works the subject of the said agreement for use in the construction of such of the
works as he has undertaken to execute at rates fixed for the finished work (inclusive of the cost
of materials and labour and other charges) AND WHEREAS the AAI has agreed to advance to
the Contractor the sum of Rupees on the security of materials
the quantities and other particulars of which are detailed in Accounts of Secured Advances
attached to the Running Account Bill for the said works signed by the Contractor on
..... and the AAI has reserved to himself the option of making any further advance
or advances on the security of other materials brought by the Contractor to the site of the said
works. Now THIS INDENTURE WITNESSETH that in pursuance of the said agreement and in
consideration of the sum of Rupees..... on or before the execution of these
presents paid to the Contractor by the AAI (the receipt whereof the Contractor doth hereby
acknowledge) and of such further advances (if any) as may be made to him as aforesaid the
Contractor doth hereby covenant and agree with the AAI and declare as follows:—~~

- ~~(1) That the said sum of Rupees so advanced by the
AAI to the Contractor as aforesaid and all or any further sum or sums advanced as aforesaid
shall be employed by the Contractor in or towards expediting the execution of the said works
and for no other purpose whatsoever.~~
- ~~(2) That the materials detailed in the said Account of Secured Advances which have been
offered to and accepted by the AAI as security are absolutely the Contractor's own property
and free from encumbrances of any kind and the contractor will not make any application for
or receive a further advance on the security of materials which are not absolutely his own
property and free from encumbrances of any kind and the Contractor indemnifies the AAI
against all claims to any materials in respect of which an advance has been made to him as
aforesaid.~~
- ~~(3) That the materials detailed in the said Account of Secured Advances and all other materials
on the security of which any further advance or advances may hereafter be made as
aforesaid (hereinafter called the said materials) shall be used by the Contractor solely in the
execution of the said works in accordance with the directions of the Engineer in Charge of
the project (hereinafter called the Engineer in Charge) and in the term of the said
agreement.~~



- ~~(4) That the Contractor shall make at his own cost all necessary and adequate arrangements for the proper watch, safe custody and protection against all risks of the said materials and that until used in construction as aforesaid the said materials shall remain at the site of the said works in the Contractor's custody and on his own responsibility and shall at all times be open to inspection by the Engineer in Charge or any officer authorised by him. In the event of the said materials or any part thereof being stolen, destroyed or damaged or becoming deteriorated in a greater degree than is due to reasonable use and wear thereof the Contractor will forthwith replace the same with other materials of like quality or repair and make good the same as required by the Engineer in Charge.~~
- ~~(5) That the said materials shall not on any account be removed from the site of the said works except with the written permission of the Engineer in Charge or an officer authorised by him on that behalf.~~
- ~~(6) That the advances shall be repayable in full when or before the Contractor receives payment from the AAI of the price payable to him for the said works under the terms and provisions of the said agreement. Provided that if any intermediate payments are made to the Contractor on account of work done then on the occasion of each such payment the AAI will be at liberty to make a recovery from the Contractor's bill for such payment by deducting there from the value of the said materials then actually used in the construction and in respect of which recovery has not been made previously, the value for this purpose being determined in respect of each description of materials at the rates at which the amounts of the advances made under these presents were calculated.~~
- ~~(7) That if the Contractor shall at any time make any default in the performance or observance in any respect of any of the terms and provisions of the said agreement or of these presents the total amount of the advance or advances that may still be owing to the AAI shall immediately on the happening of such default be repayable by the Contractor to the President together with interest thereon at twelve per cent per annum from the date or respective dates of such advance or advances to the date of repayment and with all costs charges, damages and expenses incurred by the President in or for the recovery thereof or the enforcement of this security or otherwise by reason of the default of the Contractor and the Contractor hereby covenants and agrees with the President to repay and pay the same respectively to him accordingly.~~
- ~~(8) That the Contractor hereby charges all the said materials with the repayment to the President of the said sum of Rupees and any further sum or sums advanced as aforesaid and all costs charges, damages and expenses payable under these presents PROVIDED ALWAYS and it is hereby agreed and declared that notwithstanding anything in the said agreement and without prejudice to the powers contained therein if and whenever the covenant for payment and repayment herein before contained shall become enforceable and the money owing shall not be paid in accordance therewith the AAI may at any time thereafter adopt all or any of the following courses as he may deem best :-~~
- ~~(a) Size and utilize the said materials or any part thereof in the completion of the said works on behalf of the Contractor in accordance with the provisions in that behalf contained in the said agreement debiting the Contractor with the actual cost of effecting such completion and the amount due in respect of advances under these presents and crediting the Contractor with the value of work done as if he had carried it out in accordance with the said agreement and at the rates thereby provided. If the balance is against the Contractor, he is to pay same to the AAI on demand.~~



- (b) ~~Remove and sell by public auction the seized materials or any part thereof and out of the moneys arising from the sale retain all the sums aforesaid repayable or payable to the AAI under these presents and pay over the surplus (if any) to the Contractor. Deduct all or any part of the moneys owing out of the security deposit or any sum due to the Contractor under the said agreement.~~
- (9) ~~That except in the event of such default on the part of the Contractor as aforesaid interest on the said advance shall not be payable.~~
- (10) ~~That in the event of any conflict between the provisions of these presents and the said agreement the provisions of these presents shall prevail and in the event of any dispute or difference arising over the construction or effect of these presents the settlement of which has not been herein before expressly provided for the same shall be finally resolved as per provisions of clause 25 of the contract.~~

~~In witness whereof the said and by the order and under the direction of the AAI have hereunto set their respective hands the day and year first above written.~~

~~Signed, sealed and delivered by the said contractor in the presence of
.....
...~~

~~Signature~~

~~Witness Name~~

~~Address~~

~~Signed by~~

~~by the order and direction of the AAI in the presence of~~

~~Signature~~

~~Witness Name~~

~~Address~~



SCHEDULES

SCHEDULE 'A'

The Tenderer shall upload the digitally signed **Schedule of Price Bid in the Form of BOQ.xls**. Bidders may please note that, the Schedule of Quantities is available in the Portal. The same (BOQ) shall be downloaded and be filled in the editable (un protected/Coloured) cells only and they should necessarily submit their Financial Bids in the format provided after entering the financial quotes, Name of Bidder etc.. No other cells (protected-un-coloured) should be changed. Once the details have been completed, the bidder should save it and submit it online, without changing the filename. If the BOQ File is found to be modified/alterd in protected un-coloured cells by the bidder, the respective bid will be rejected and EMD will be forfeited.

SCHEDULE 'B'

Schedule of Materials to be issued to the Contractor.

Sl. No.	Description of Item	Quantity	Rates in figures & words at which the material will be charged to the Contractor	Place of Issue
1	2	3	4	5
THIS WILL BE AS PER TECHNO COMMERCIAL SPECIFICATIONS				

~~SCHEDULE 'C'~~

~~Tools and Plants to be hired to the Contractor.~~

Sl.No.	Description	Hire Charges per day	Place of Issue
1	2	3	4
THIS WILL BE AS PER TECHNO COMMERCIAL SPECIFICATIONS			

**SCHEDULE 'D'**

Extra Schedule for specific requirements/documents for the work, if any.

N I L**SCHEDULE 'E'**

1	Name of Work	Development of Lal Bahadur Shastri International Airport, Varanasi; SH: SITC of Perimeter Lighting, WDI and Landing T.
2	Estimated Cost of Work	Rs. 4,86,15,526.00 (Excluding GST)
3	Earnest Money Deposit	Rs. 14,58,466.00
4	Performance Guarantee	As per Tender Conditions
5	Additional Performance Security	As per Tender Conditions
6	Security Deposit	As per Tender Conditions

SCHEDULE 'F'**GENERAL RULES & DIRECTION**

Officer Inviting Tender	AGM (E-E), LBSI Airport, Varanasi
Maximum Percentage for Quantity of Items of work to be executed beyond which rates are to be determined in accordance with Clauses 12.2 & 12.3	See Below

CONDITIONS OF CONTRACT-DEFINITIONS:

2(v) Engineer-in-Charge	<u>AGM (E-E)</u>
2(viii) Accepting Authority	<u>DGM/JGM (E-E)</u>
Percentage on Cost Materials & Labour to cover All Overheads & Profits	15%
2(x) Standard Schedule of Rates	DSR/Market Rates.
2(xii) Department	AAI, Engineering-Electrical, LBSI Airport.

Clause 1

(i)	Time allowed for submission of Performance Guarantee and Additional Performance Security from the date of Issue of Letter of intent	Within 30 Days
(ii)	Time allowed for signing of contract agreement after issue of award letter	Within 10 days



(iii)	Maximum allowable Period of Extension	As per Clause 1
-------	---------------------------------------	-----------------

Clause 2

Authority for fixing Compensation under Clause 2	As per DoP
--	------------

Clause 2A

Whether Clause 2A shall be applicable	Yes /No
---------------------------------------	--------------------

Clause 5

Number of Days from the Date of Issue of Letter of Acceptance for Reckoning Date of Start	As per work order
Time Allowed for Execution of Work	7 (Seven) Months
Authority to decide Extension of Time	As per DoP
Rescheduling of Milestone	Accepting Authority
Shifting of date of start in case of delay in handing over of site	Accepting Authority

Mile Stone(s) As Per Table Given Below:

Sl.No.	Description of Milestones (Physical)	Time allowed in days (from date of start)	Amount to be withheld in case of non achievement of milestone

Clause 6/6A

Clause Applicable 6 or 6A : 6A

Clause 7

Gross work to be done together with net payment/adjustment of advances for material collected, if any since the last such payment for being eligible to interim Payment	NA
---	----

**Clause 10A****TESTING EQUIPMENT TO BE PROVIDED BY THE CONTRACTOR AT SITE LAB**

All the Testing Equipment required for conducting test for Building/Pavement Works as per CPWD, MORTH, IRC and AAI Specifications as applicable.

Clause 10 B(II)

Whether Clause 10B(II) [Mobilization Advance] shall be applicable	Yes /No
Interest on mobilization advance	Not Applicable

Clause 10C**Applicable/Not Applicable**

Component of Labour expressed as percent of value of work: NA

Clause 10 CA ~~Applicable/Not Applicable~~

Materials covered under this Clause	Nearest Material (other than cement*, reinforcement bars, structural steel & Bitumen) for which All India Wholesale Price index is to be followed	Base price and its corresponding period of all the materials covered under Clause 10CA
1. Cement (OPC/PPC)	Deleted	Base price for cement and reinforcement steel to be determined as issued under authority of DG (Works), CPWD or concerned Zonal Chief Engineer, CPWD as on last date of receipt of tender. In case base price for cement, reinforcement steel and Bitumen as to be issued by CPWD is not available concerned ED (Engg) empowered to determine the same.
2. Reinforcement steel bars (TMT)		
3. Structural Steel		
4. Bitumen		

***Note:**

1. Includes cement component used in RMC brought at site from outside approved RMC plants, if any.
2. Base price and its corresponding period of all the materials covered under Clause 10CA is to be mentioned at the time of approval of NIT. In case of recall of tenders, the base price may be modified by adopting latest base price and its corresponding period.

**Clause 10 CC****Applicable/Not Applicable**

Clause 10CC to be applicable in Contracts with stipulated period of completion exceeding the period shown in next column	18 Months
--	-----------

A. — For Construction period

Sl.No	Relevant component of Material / Labour for price escalation	*Percentage against total value of work
1.	Cement component	
2.	Labour component	
3.	Civil component of other construction materials	
4.	E&M (Electrical and Mechanical i/c IT & Airport system) component of construction materials	
5.	POL (Diesel) component	
6.	Reinforcement steel bars / TMT bars / structural steels (including strands and cables) component	
7.	Bitumen component	
	Total	100%

*% of components to be decided by NIT approving authority for particular tender.

B. — For Operationa & Maintenance period

Sl.No	Relevant component of Material / Labour for price escalation	*Percentage against total value of work
1.	Labour component	
2.	Civil component of other construction materials	
3.	E&M (Electrical and Mechanical i/c IT & AS) component of construction materials	
4.	Bitumen component (For pavement work component)	
	Total	100%

*% of components to be decided by NIT approving authority for particular tender.

Clause 11

Specification to be followed for execution of work	a) CPWD Latest Specifications with up to date correction slips or other specs as applicable. b) AAI Techno-Commercial Specifications. c) Manufacturer's Specification.
--	--



	d) BCAS & DGCA Guidelines.
--	----------------------------

Clause 12

12.2 & 12.3	Deviation limit beyond which Clauses 12.2 & 12.3 shall apply for Buildings, Pavements and all other Works Above Foundation Level	15% (Fifteen Percent)
12.5	Deviation limit beyond which Clauses 12.2 & 12.3 shall apply for foundation work	100% (Hundred Percent)
	Overall deviation i/c extra items, if any	30% (Thirty Percent)

Clause 16

	Competent Authority for deciding reduced rates	Accepting Authority
--	--	---------------------

Clause 18**MANDATORY MACHINERY, TOOLS & PLANTS TO BE DEPLOYED BY THE CONTRACTOR AT SITE:**

To be provided as per NIT and other Machinery required for timely completion of work.

Clause 19L – Not Applicable.**Clause 20A – Not Applicable.****Clause 25**

Place of Arbitration : New Delhi.

Clause 34 – Not Applicable.**Clause 35 – Not Applicable.****Clause 36(1)****Requirement of Technical Representative(s) and Recovery Rate**

Sl. No.	Minimum Qualification of Technical Representative	Discipline	Designation (Principal Technical Representative)	Minimum Experience	Number	Rate at which recovery shall be made from the Contractor in the event of not fulfilling provision of Clause 36	
						Figures Rs.	Words



01	Diploma	Electrician	Site Supervisor	2 Years	01	PerDay Labour Wage of Highly Skilled as applicable +Rs. 100.00 per Day
02	Graduate/Diploma/ITI	-	Store Supervisor	01/02/10 Years	01	

- a. ~~Assistant Engineers retired from Government services that are holding Diploma will be treated at par with Graduate Engineers.~~
- b. ~~Diploma holder with minimum 10 year relevant experience with a reputed construction company can be treated at par with Graduate Engineer for the purpose of such deployment subject to the condition that such diploma holder should not exceed 50% of requirement of Degree Engineers~~

Clause 37

Licence Fee for Unpaved Land _____ Rs. _____ [Not Applicable]

Clause 41(A)

Integrity Pact Applicable _____ Yes/No

Clause 42

(i)	Schedule/Statement for determining Theoretical Quantity of Cement & Bitumen on the basis of Delhi Schedule of Rates	DSR 2018 printed by C.P.W.D with up-to-date correction slips till last date of submission of tender, technical specifications & BOQ.
(ii)	Variations permissible on theoretical quantities	
a.	Cement for works with estimated cost put to tender not more than Rs.5lakhs.	3% plus/minus
	For works with estimated cost put to tender more than Rs.5lakhs	2% plus/minus
b.	Steel Reinforcement and structural steel section for each diameter, section and category	2% plus/minus
c.	Bitumen	2.5% plus only & NIL on minus side
d.	All other materials	

RECOVERY RATES FOR QUANTITIES BEYOND PERMISSIBLE VARIATION

(Not Applicable)

Sl. No.	Description of items	Rates in figures and words at which recovery shall be made from the Contractor	
		Excess beyond permissible Variation	Less use beyond the permissible variation*
1.	Cement		
2.	Steel Reinforcement		
3.	Structural Sections		
4.	Bitumen Issued Free		
5.	Bitumen issued at stipulated fixed price		

* ~~Provided work is considered technically sound. Otherwise work has to be re-executed as per direction of Engineer in Charge~~

Clause 47 – Not Applicable.

Clause 48

Escrow Account : ~~Applicable~~ / Not applicable.

Annexure to Clause 34 (x)

Annexure to Clause 34 (x) showing quantities of materials for areas of surfacing to be considered for working out minimum period for which hire charges of road roller are to be recovered.

[NOT APPLICABLE FOR THIS WORK]

Sl.No.	Material of surfacing	Quantity or areas
1.	Consolidation of earth subgrade	1860 Sq.m
2.	Consolidation of stones soling 15 cm to 22.5 cm thick	170 Cu.m
3.	Consolidation of brick soling 10 cm to 20 cm thick	230 Cu.m
4.	Consolidation of wearing coat of stone ballast 7.5 cm to 11.5 cm thick	30 Cu.m
5.	Consolidation of wearing coat of brick ballast 10 cm thick	60 Cu.m
6.	Spreading and consolidation of red bajri 6mm	1860 Sq.m
7.	Painting one coat using stone aggregate 12.5mm nominal size	
	(a) @ 1.65 m3 per 100 m2 and paving bitumen A-90 or S-90 @ 2.25 Kg per m2 or	
	(b) @ 1.50 m3 per 100 m2 and bitumen emulsion or Road tar @ 2.25 Kg per m2	930 Sq.m.
8.	Painting two coats using	
	(a) For first coat, stone aggregate 12.5 mm nominal size	
	@ 1.50 m3 per 100 m2 and paving bitumen A-90 or S-90 @ 2.25 Kg per m2 or	
	@ 1.35 m3 per 100 m2 and bitumen emulsion @ 2 Kg per m2 600 Sq.m. or	
	(iii) @ 1.25 m3 per 100 m2 with roadtar @ 2.25 Kg per m2	600 Sq.m.
	(b) For 2nd Coat, stone aggregate 10 mm nominal size 0.9 Cu.m. per 100 Sq.m with	
	(i) 1kg of paving bitumen A-90 or S-90 or bitumen emulsion per Sq.m. or	
	(ii) 1.25 Kg. of road tar, per Sq.m. 600 Sq.m.	600 Sq.m.
9.	Re-painting with stone aggregate 10 mm nominal size 0.9 Cu.m. per 100 Sq.m. with	
	(i) 1kg of paving bitumen A-90 or S-90 per Sq.m. ;k or	
	(ii) 1.25 kg of bitumen emulsion per Sq.m. 1670 Sq.m.	1670 Sq.m.



10.	2 cm premix carpet surfacing using 2.4 m ³ of stone aggregate 10 mm nominal size per 100 m ² and binder including tack coat, the binder being hot cut back bitumen or bitumen emulsion in specified quantities.	930 Sq.m
11.	2.5 cm premix carpet surfacing using 3 m ³ of stone aggregate 10 mm nominal size per 100 m ² and binder including tack coat, the binder being hot cut back bitumen or bitumen emulsion in specified quantities.	930 Sq.m
12.	4 cm thick bitumen concrete surfacing using stone aggregate 3.8 Cu.m. (60% 20 mm nominal size and 40% 12.5 mm nominal size) per 100 m ² and coarse sand 1.9 Cu.m. per 100 m ² and hot cut back bitumen over tack coat of hot cut back bitumen.	460 Sq.m.
13.	5 cm thick bitumen concrete surfacing using stone aggregate 4.8 Cu.m. (60% 25 mm nominal size and 40% 20 mm nominal size) per 100 m ² and coarse sand 2.4 Cu.m. per 100 m ² and hot cut back bitumen over tack coat of hot cut back bitumen.	370 Sq.m.
14.	6 cm thick bitumen concrete surfacing using stone aggregate 5.8 Cu.m. (60% 40 mm nominal size and 40% 25 mm nominal size) per 100 m ² and coarse sand 2.9 Cu.m. per 100 m ² and hot cut back bitumen over tack coat of hot cut back bitumen.	280 Sq.m.
15.	7.5 cm thick bitumen concrete surfacing using stone aggregate 7.3 Cu.m. (60% 50 mm nominal size and 40% 40 mm nominal size) per 100 m ² and coarse sand 3.65 Cu.m. per 100 m ² and hot cut back bitumen over a tack coat of hot cut back bitumen.	230 Sq.m.
16.	2.5 cm bitumastic sheet using stone aggregate 1.65 Cu.m. (60% 12.5 mm nominal size 40% 10 mm nominal size) per 100 Sq.m. and coarse sand 1.65 Cu.m. per 100 Sq.m. and hot cut back bitumen over a tack coat of hot cut back bitumen.	750 Sq.m.
17.	4 cm bitumastic sheet, using stone aggregate 2.6 Cu.m. (60% 12.5 mm nominal size, 40% 10 mm nominal size) per 100 Sq.m. and coarse sand 2.5 Cu.m. per 100 Sq.m. and hot cut back bitumen over a tack coat of hot cut back bitumen.	560 Sq.m.
18.	Laying full grouted surface using stone aggregate 40 mm nominal size 6.10 Cu.m. per 100 Sq.m. with binder, binding with 20 mm to 12.5 mm nominal size stone grit. 1.83 Cu.m. per 100 Sq.m. and seal coat of binder and stone grit 10 mm nominal size, 1.07 Cu.m. per 100 Sq.m., the binder being hot bitumen or tar as specified.	460 Sq.m.
19.	Laying full grouted surface using stone aggregate 50 mm nominal size 9.14 Cu.m. per 100 Sq.m. with binder, binding with stone grit 20 mm to 12.5 mm nominal size 1.83 Cu.m. per 100 Sq.m. and seal coat of binder and stone grit 10 mm nominal size, 1.07 Cu.m. per 100 Sq.m., the binder being hot bitumen or tar,	370 Sq.m.
20.	4 cm. thick premix macadam surfacing using stone aggregate 25 mm nominal size 4.57 Cu.m. per 100 Sq.m. and hot bitumin binding with stone aggregate 12.5 mm nominal size 1.52 Cu.m. per 100 Sq.m. and seal coat of hot bitumen and stone aggregate 10 mm nominal size 1.07 Cu.m. per 100 Sq.m.	560 Sq.m.
21.	5 cm. thick premix macadam surfacing using stone aggregate 25 mm nominal size 6.10 Cu.m. per 100 Sq.m. and hot bitumin binding with stone aggregate 12.5 mm nominal size 1.52 Cu.m. per 100 Sq.m. and seal coat of hot bitumen and stone aggregate 10 mm nominal size 1.07 Cu.m. per 100 Sq.m.	460 Sq.m.

SPECIAL CONDITIONS OF CONTRACT

1. **General:** The following special conditions shall be read in conjunction with General Conditions of Contract and amendments/corrections thereto. If there are any provisions in these Special Conditions which are at variance with the provisions in the above-mentioned documents the provisions in these special conditions shall take precedence.

2. **Scope of work:**

The scope of Electrical works are as follows:-

- Supply of LED light for street lighting
- Supply of 06 mtrs. high GI OCTAGONAL street light pole
- Erection of 06 Mtr. high G.I.OCTAGONAL pole
- S.I.T.C. of High Efficiency Solar Lights
- S.I.T.C. of outdoor type Feeder Pillar
- Supply and making cable end termination
- Supply of following Size 1.1 KV grade cables: 3.5 Core X 185 Sq.mm; 3.5 Core X 95 Sq.mm; 4 Core X 25 Sq.mm
- Supply and making straight through joints
- Supply of DWC HDPE Pipes
- Laying of HDPE Pipe
- Laying of cables etc
- Pipe Earthing
- SITC of Landing H
- SITC of WDI
- SITC of 27.5 m Flag Mast
- Dismantling of existing terminated cables and any other minor installations en route as and when required by such means so that minimum Power Supply interruption is there. Nothing extra shall be paid on this account.

3. **Materials:**

The Materials shall be new as per schedule satisfying tender specifications, terms & conditions in physically & operationally good condition in manufacturer's original packing.

- a) Approval of material: Contractor has to submit Technical brochures/ catalogues and get the material approved from EIC prior to supply the materials.
- b) Test certificates: Necessary Test certificates (type test / routine test) etc shall be submitted before/ with the supply of the materials.

4. **Terms of Payment:**

AAI shall pay to the contractor in the pro-rata basis on satisfactory supply, installation, testing and Commissioning as below after applicable deductions like security deposit, taxes, deduction / recoveries etc., if any.

(A) **FOR SITC ITEMS**

- (i) 70 % of item rate on pro rata basis (item wise) shall be made on receipt of material at

{ C- Nil, I- Nil, O- Nil, OW- Nil}

SCC-1

site in good condition.

- (ii) 20 % of item rate on pro rata basis (item wise) shall be made on completion of installation.
- (iii) Balance 10% of item rate on pro rata basis (item wise) shall be made on completion of testing and commissioning and handing over of system.

(B) FOR SUPPLY ITEMS

- (i) 90 % of item rate on pro rata basis (item wise) shall be made on receipt of material at site in good condition.
- (ii) Balance 10 % of item rate on pro rata basis (item wise) shall be made on completion of testing and commissioning and handing over of system.

(C) FOR WORK ITEMS (ITC items)

- (i) 80% of the item rate on pro- rata basis on installation.
- (ii) 20% of the item rate on testing & Commissioning handing over.

The payment will be released after deduction of Security deposit and Taxes as per contract and statutory requirements and adjusting any dues from the firm, which might have rendered itself liable as per provision of the contract.

The Security Deposit shall be deducted from the running/final bills, which shall be released after successful completion of Defects Liability Period.

Running /Final measurement will be jointly measured by AAI representative and contractor or his authorized representative in measurement book and duly signed by both for processing of running / final bill.

Delivery Challan & Original tax invoice, Valid test certificates and warranty certificate (if applicable) shall need to be submitted for processing of the RA/Final bill.

5. Agreement: Upon award of the work, the successful tenderer (Contractor) shall execute the contract agreement within 10 days of award of work in a non judicial stamp paper of Rs. 100/- with the Engineer in charge. The cost of stamp paper shall be borne by the contractor. **No payment will be released before executing the agreement.**

6. Completion Period and Defect Liability Period: The time allowed for this work is **7 (Seven) Months** which shall be reckoned as per Work order. **The entire materials shall be guaranteed for any manufacturing defects for a period of 12 months from the certified date of completion (except LED Light fittings, for which warranty period shall be 5 years from**

actual date of completion of work). The contractor shall have to replace the defective material during the period of defects liability at his own cost, to the satisfaction of the Engineer in Charge. The contractor shall provide necessary identification for the supplied items. In the absence of such identification the AAI's claim on defective material will have precedence.

Security deposit will be released only after the satisfactory completion of the defects liability period of one year. The materials supplied shall be guaranteed against any type of damages during manufacturing, transit, mishandling during transportation, installation and laying etc as required. The contractor shall replace the materials immediately in case of damages/ defects.

- In case of non-submission of warranty card for LED Light Fittings for 5 Years warranty, additional 10% of cost of LED Light Fittings shall be withheld, and SD for only remaining items shall be released upon successful completion of DLP.
- In case the contractor fails to replace the defective material, AAI will be at liberty to deduct the cost of the item along with incidental and departmental charges, as per the prevailing market rate. The rate so finalized by AAI shall be final and binding on the contractor.
- In case the security deposit available with AAI for the work falls short of the value of defective items, AAI will be at liberty to demand additional amount within a reasonable period and in the event of failure to remit such amount, AAI will have powers to adjust such amounts against any amount due to the contractor at any of the Airports/ Establishments of AAI

7. Preferred make of materials:

The make of materials shall be as per the preferred make list of materials enclosed subject to meeting their technical requirement as spelt out under the schedule of quantities and the technical specifications enclosed in the tender document.

Make in India material other than AAI preferred make shall be considered subject to meeting Technical Specification of Tender documents or Technical specifications shall, to the extent practicable, be based on national technical regulation or recognized national standards or building code, wherever such standards exist, and in their absence be based on relevant international standard. Such material/item is required to be get approved by the competent authority before supply.

8. WORK PROGRAMME

- i. No additional payment shall be made to the contractor for any multiple shift work or other incentive methods contemplated by him in his work Schedule even though the time schedule is approved by the Engineer-in-Charge.

- ii. The approval to the revised schedule resulting in completion date beyond the stipulated date of completion shall not automatically amount to grant of extension of time to the Contractor.
- iii. Cleaning, dressing of work place including all ancillary works connected with this work shall be responsibility of the Contractor and the price quoted by them shall be deemed to have included in the quote.
- iv. Agency shall be responsible to depute sufficient machines and manpower for completing the work in time. Nothing shall be reimbursed on this account.

9. SCHEDULE OF QUANTITIES (SOQ)

The bill of quantities shall be read in conjunction with general conditions of contract, special conditions of contract, technical specifications and any other document forming a part of this tender. The quantities shown against the various items are only approximate and subject to variations as made in general conditions of the contract. Only required items & quantities are to be supplied/ installed/executed.

Contractor shall take detailed site measurements, before placing purchase order/taking procurement action. Contractor shall monitor the requirements of various items and shall keep informing Engineer- in- charge time to time with the progress of work.

10. SITE PRECAUTIONS

- i. The work is to be carried out in Operational Area of Varanasi Airport. The contractor shall provide caution boards at site designated by the Engineer-in-Charge. One representative has to present at site all the time during work execution.
- ii. For the purpose of inspection of site and relevant documents the contractor is required to contact the concerned Asst. General Manager Engg. (E) who shall give reasonable facilities for inspection of the same. The contractor shall be deemed to have satisfied himself as to the nature of the site of work, Local facilities of access, availability of materials and all other matters affecting his prices for the execution and completion of work. He is required to make himself fully acquainted with the nature and scope of work.
- iii. The contractor shall remove all the dismantle materials etc. on day-to-day basis & after completion of the work and leave the site in a neat and tidy state. The payment of final bill will be subject to the compliance of this condition by the contractor.
- iv. The work lies in Restricted Area/Nearby area of airport. The tenderer shall apply in writing, in advance of commencement of work, for the **issue of security passes** wherever

required and shall submit a list of personnel concerned and shall satisfy the Engineer-in-Charge, who shall at his discretion have the right to recommend the issue of passes to control the movement of the contractor, his agents, his staff and workmen. **The cost of photograph and prescribed fee (INR), if required, for the issue of the passes will be borne by the contractor.** The contractor shall ensure that his men work only in areas/zones allotted to them. The entry passes shall be deposited with the Engineer-in-Charge on demand and in any case immediately after completion of work. The contractor, his staff and workmen shall observe all the rules promulgated from time to time by the Airports Authority of India, e.g., prohibition of smoking and lighting, frisking of persons on entry and exit, keeping to specified routes etc. Any person found violating the security rules laid down by the Airports Authority of India will be expelled from the area without assigning any reason whatsoever and contractor shall have no claim on this account.

11. REGULATIONS

CPWD/ Indian/ International Standard norms/ IE rules and regulations for all the work.

12. MAN POWER AND SITE ORGANISATION

- i. The contractor shall provide adequate qualified and skilled personnel on the work with prior approval of the engineer-in-charge.
- ii. The nationality of the engaged manpower should be preferable Indian, with the security clearances from the concerned statutory authorities.
- iii. Site supervisor with minimum qualification as per Schedule-F, shall be deputed at site from date of taking over of site till completion of work. Nothing shall be reimbursed on this account.

13. MODE OF DESPATCH FOR ITEMS

The successful tenderer shall be solely responsible to ensure the following:

- Sound packing of equipment/components.
- The items by the due date as per schedule.
- Insurance.
- Forwarding and transportation of equipment/components up to the site.
- Receipt of billti/receipt & invoice of materials at site in good condition.
- Warranty cards as offered by OEM.

14. PRICES:

a) Prices shall be inclusive of any taxes, duties, cess, fee and charges etc. but exclusive of GST.

The other duty levied by Custom Authorities in respect of import of any materials or any other tax on material, labour, services or contract in respect of this work contract including payment to local/Govt./Statutory authorities shall be payable by the contractor and Airports Authority of India will not entertain any claim whatsoever in this respect. Statutory deductions i.e., Income tax, TDS/GST etc will be deducted at the time of making payment of running account bill applicable as per government law during payment made to the Contractor. Nothing extra will be paid by AAI in this respect.

b) AAI shall not give any concessional forms/ certificates/ permits towards any taxes, duties & other levies like sales tax, road taxes etc.

c) Price shall be firm throughout the contract period or any extended period of completion.

d) The tenderer is responsible for ascertaining all relevant information and making due allowance in his tender for any factors likely to affect his contract works. The contractor shall be deemed to have examined the tender documents, detailed specification, data etc. and to have visited the site or ascertained all relevant details for offering their quotes.

e) The contractor shall be deemed to have satisfied himself before tendering as to the correctness and sufficiency of his tender for the works and of the rates and prices quoted in the schedule of quantities or in bills of Quantities which rates and prices shall, except and otherwise provided, cover all his obligations under the contract and all matters and things necessary for the proper completion and maintenance of the works.

15. POWER SUPPLY & WATER

Contractor shall make his own arrangements for power supply & water supply for the execution of the work. No amount shall be payable by AAI on this account. However, AAI can provide electrical connection, if feasible at site during execution of work on chargeable basis. The required energy meter and cable shall be provided by the contractor.

However, AAI will provide power supply free of cost for testing & commissioning of the system.

16. STORES AND MATERIALS

i. No storage accommodation will be arranged by AAI, Contractor shall make all such arrangements at his own cost. AAI may give open space for store on chargeable basis as per AAI norms. The contractor shall be responsible for watch & ward, safe custody of materials till the installation is commissioned and handed over to AAI.

- ii. All materials required for satisfactory completion of the work shall be arranged by contractor from his own sources. No claim whatsoever shall be entertained by the Authority on account of delay in either providing or non-availability of these materials in the market.
- iii. All the materials required for this work should conform to relevant specifications. The copies of Purchase Vouchers / Gate Passes should be produced along with the materials. The test certificates, routine test certificates and acceptance test certificates are also to be submitted.
- iv. The contractor shall take away the balance of any materials left at the site after Commissioning of the system. The cost, if already paid, for such items shall be deducted from the subsequent running bills. AAI shall not be liable to pay for any of the incidental charges connected with the above.

17. PLANTS AND TOOLS:

The plants & tools required for execution and timely completion of works as per schedule. Tenderer shall deploy the required no.s of machinery, plants, tools and manpower accordingly. The details of machinery, plant & tools shall be submitted by contractor to AAI. Tenderer shall closely monitor the progress and if required additional machinery, plants, tools & labour (both skilled & unskilled) shall be deployed to complete the work in time as per Contract agreement.

18. WORKMANSHIP

- i. To determine the acceptable standard of workmanship, the contractor shall execute portion of the item of work as sample for approval of the Engineer-in-Charge, before taking up the actual execution of the particular item of work.
- ii. Contractor has to give utmost care for discharging the responsibility of the harmonization / providing power supply arrangement. The expertise and workman ship for these activities are prime important for this work.

19. BYE-LAWS

- i. The contractor shall comply with all bye-laws and regulations of local and statutory authorities having jurisdiction over the works and shall be responsible for payment of all fees and other charges and for giving and receiving of all necessary notices and keeping the Engineer-in-Charge, informed of the said compliance with the bye-laws, payments made, notices issued and received.
- ii. The contractor shall indemnify the AAI against all claims in respect of patent rights, design, trademarks of name or other protected rights in respect of any plant, machine, work or materials used for or in connection with the work or temporary works and from and against all claims,

demands proceedings, cost, charges and expenses whatsoever in respect of or in relation thereto. The contractor shall defend all actions arising from such claims and shall himself pay all royalties license fees, damages, costs and charges of all and every sort that may be legally incurred in respect thereto.

20. ARRANGEMENT TO BE MADE BY THE CONTRACTOR AT SITE

- i. The agency is also required to provide safety devices to the manpower deployed at site for the work.
- ii. All tools and plants, testing facility for ITC works.

21. PERFORMANCE

- i. The contractor shall perform all works in substantial and acceptable manner. The work must be progressed as per contract agreement in stipulated period of time.
- ii. It must be clearly understood that whole of the conditions are intended to be strictly enforced and that no extra charges in respect of extra work will be allowed unless they are clearly outside the spirit and meaning of the conditions or unless such works shall have been ordered in writing by the Engineer-in-Charge.

22. DIFFERENCE BETWEEN FIRST LOWEST BIDDER AND SECOND LOWEST BIDDER:

Final bill will be worked out at the accepted tender rates and also with quoted rates of second lowest. **The amount of final bill to be paid will be restricted to the lower of the two.**

23. SUFFICIENCY OF TENDER

The contractor shall be deemed to have satisfied himself before tendering as to the correctness and sufficiency of his tender for the works and of the rates and prices quoted in the schedule of quantities or in bills/schedule of quantities which rates and prices shall, except as otherwise provided, cover all his obligations under the contract and all matters and things necessary for the proper execution and completion of the works. All sundry fittings, assemblies, accessories, hardware items, foundation bolts, termination legs for electrical connections as required and all other sundry which are useful and necessary for proper assembly and efficient working of the various components of the work shall be deemed to have been included in the tender, whether such items are specifically mentioned in the tender documents or not.

24. PRINTED TERMS AND CONDITIONS OF TENDERING FIRMS

Printed terms and conditions of the tenderers will not be considered as forming part of their tenders. In case terms and conditions of the contract applicable to this tender are not acceptable to any tenderers, the tenderer should get clarifications on SOQ, technical specifications, commercial terms & conditions, drawing etc well before submission of bid. The AAI reserves the right to accept or reject the tender. AAI shall not be bound to give reasons for refusal to consider the tender with such deviations.

25. RESPONSIBILITY FOR COMPLETENESS

Any fitting or accessories may not be mentioned in the specifications but which are usual or necessary are to be provided by the Contractor without extra charge, so as to make the equipment complete in all details to meet the specifications. In all cases, where the contract provides for test on site, AAI, except where otherwise specified, shall be provided by the contractor, free of charge, such labour, materials, fuels, equipment apparatus and instruments as may be required from time to time and as may reasonable be demanded efficiency to carry out such tests of the equipment, materials or workmanship in accordance with the contract.

26. SITE TESTS/ PERFORMANCE TESTS

Necessary site tests/ performance tests/IR value test/continuity test etc. shall be conducted on the equipment to ascertain the functional / design/ site requirements. Reports shall be prepared recording the various values, parameters, observations, settings made etc. In case of unsatisfactory results, the same shall be replaced/ rectified as per the requirement.

Equipment for measurement of work and testing the installation shall be procured by the Contractor for their use at their own cost.

27. DAMAGE TO PERSON AND PROPERTY

The contractor shall indemnify and keep indemnified AAI against all losses and claims injuries or damage to any person or any property whatsoever, which may arise out of or in consequence of the construction and maintenance of works by them and against all claims, demands and proceedings of or in relation thereof.

28. TESTING/INSPECTION OF MATERIALS

AAI reserves the right to inspect the material at factory before dispatch. If inspection equipment at the factory is to be done, 10 days prior intimation should be given in advance. All arrangements for conducting the inspection/testing at the factory NABL accredited lab/any NABL accredited labs shall be the responsibility of the contractor.

The traveling and daily allowance for the 1st inspection at factory will be borne by AAI. In case the material /test is not ready or the test fails during the 1st inspection the TA/DA for the AAI staff for the 2nd inspection shall be borne by the contractor.

For visual/destructive tests of materials, the Contractor shall provide samples of all the materials free of cost well in advance.

29. TAKING OVER

When all performance tests have been successfully carried out after completion of the work in presence of Engineer-in-charge & successful bidder or in presence of their authorized representative the same shall be accepted and taken over. Engineer-in-charge shall forthwith issue a taking over Certificate.

30. MEASUREMENTS

The measurement shall be made as per SOQ/BOQ, Specifications & conditions for items, also guidelines as given in CPWD specifications.

31. CTE Inspection

CTE may inspect the work during execution or after completion of work. During inspection any material / equipment may be sent to test lab. The fee payable for testing material / equipment shall be paid by contractor. Nothing shall be paid to the contractor on this account.

32. FOR SUBMISSION OF BANK GUARANTEE:

Wherever the contractor is submitting Bank Guarantee, it has to be done in accordance with the following bank details:

Corporate Name: AIRPORTS AUTHORITY OF INDIA

Bank Name: ICICI BANK

IFSC: ICIC0000007

BG Advancing Message: IFN760COV (FOR BG ISSUE)
IFN767COV (FOR BG AMENDMENT)

Unique Identifier Code: AAIVARANASI to be mentioned in the field 7037 of the BG Advising messaging code.

Also, while submitting the documents to the BG issuing bank, the contractor has to submit letter to the BG issuing bank as per the format attached at Annexure-VI at Page- PR-7.

It shall be ensured by the contractor that the BG issuing/amending bank sends the BG advice in the form of message format IFN 760COV (BG Issuance)/IFN 767COV via Structured Financial Messaging System (SFMS).

While submitting the Original BG document for acceptance the contractor has to attach the copy of SFMS BG Confirmation message sent by the BG issuing bank to ICICI bank.

TECHNICAL SPECIFICATIONS

A. SCOPE OF WORK:

Scope of work covers design, fabrication, supply, installation, testing and commissioning of Apron Flood light high mast and Perimeter light including providing and fixing LED light fixtures, LT panel system etc., supply and laying of LT cables & HDPE hollow sections, SITC of feeder pillar and earthing. Scope includes supply of all fabrication material required for completion of job.

1. General Description:

The work is to be carried out at Jammu Airport. The details of the high masts, fittings, cables, panels and other associated items are indicated in the schedule of quantities. The tenderers are to design the system accordingly and submit the calculation details before starting the work. On award of the work, tenderer shall submit his detailed design, drawings and design calculations for the scrutiny to the Engineer-in-charge. All the above shall be done in accordance with time schedule submitted by the tenderer and approved by Engineer-in-charge immediately on award of the work. Tenderers are also advised to visit the site before submission of their offer in order to acquaint themselves with the site conditions. Firm should be responsible for achieving the desired illumination levels. In case of any short fall the firm will have to ensure the same by providing additional fittings as required. Quantities of the fittings taken in the schedule are tentative and can be varied as per design of the tenderer duly approved by the Engineer-in-charge.

2. OCTAGONAL POLES SPECIFICATION:

This section deals with Design, supply, installation, testing, commissioning of outdoor lighting along with foundation details. Standards to be followed for design and execution of works along with factory acceptance test details provided. The electrical work will be carried out by the contractor as per the approved drawings.

Octagonal perimeter light poles & brackets:

- The octagonal pole shall be designed to withstand the wind speed applicable as per IS 875 (Part 3). The max stress at wind speed as per above IS shall not exceed 80% of the strength of steel.
- The details of top loading i.e. weight and area of luminaries are to be worked out based on this consideration. Max deflection of the pole shall meet the requirement of relevant IS with up to date amendments.
- The pole shaft shall have octagonal cross section and shall continuously taper with aesthetically pleasing appearance. The pole shall be manufactured in single piece construction from min 3mm thick high tensile steel sheet.
- The pole shaft shall be continuously tapered with single longitudinal welding. There should not be any circumferential welding. The steel used in the manufacturing of the pole shaft, base flange etc. shall be suitable for such type of pole. The pole shall be hot dip galvanized after fabrication, internally and externally in accordance with relevant IS with up to date amendments.
- The average coating thickness of galvanization shall not be less than 70 micron. Hot dip galvanizing shall be done in single dip operation. A rigid flange plate of suitable thickness with provision for fixing minimum 4 nos. of foundation bolts shall be provided.
- This base plate shall be fillet welded to the pole shaft from inside and outside. The octagonal pole shall have door opening of suitable length at appropriate elevation from the base plate.

- The door shall be flush, and shall be weather proof to ensure safety of inside connections. The door shall be flush with the exterior surface and shall have suitable locking arrangement. Suitable earth stud(s) shall be provided for earthing the poles. Required door reinforcement shall be provided to compensate for loss in section.
- A terminal plate made of 5 mm thick Bakelite sheet with 32 A heavy duty connector / terminal studs with insulated caps (suitable for loop in loop out connection of up to 2 nos. armoured cables of size up to 4 C x 16 sq.mm or as specified in SOQ) and 1 or 2 no. 2 A DP MCB (or as specified in SOQ) for ON / OFF operation of the luminaries shall be provided inside the door.
- Octagonal Pole shall be of flanged type to be fixed on the foundation bolts. Material for octagonal pole shall be as per BSEN 10025 or of Gr- E350 BR grade as per IS 2062 and base flange material shall be as per IS 2062. Exposed portion of foundation bolts shall be hot dip galvanized. 2 no. Earthing stud for connecting earth wire shall also be provided opposite side of poles.
- The pole shaft shall have octagonal cross section and shall continuously taper with aesthetically pleasing appearance and as per IS: 875 Part-III. Design life of the pole shall be 25 years.
- The pole shall be hot dip galvanized after fabrication, internally and externally in accordance with IS- 2629/ IS 4759 / BS EN ISO 1461 or equivalent standards.
- The octagonal pole shall be provided with a door flush with the pole surface without any projection with special locking arrangement. Door opening shall be of approx. 400 — 500 mm height. Required door reinforcement shall be provided to compensate for loss in section.
- Material of steel foundation bolts shall confirm to Gr. 4.6 as per IS 1367 / of EN8 grade. The length of foundation bolts shall be 450 mm and the diameter shall be 16 mm.

Bracket for octagonal pole: The bracket shall be suitable for installation of LED luminaire of required wattage (as specified in SOQ) so as to achieve that specified lux level. The brackets shall have a suitable tilt angle and shall be galvanized internally and externally by hot dip galvanizing process. The octagonal poles and brackets should be from same manufacturer to ensure proper matching and alignment of the pole and bracket and Light fixture.

SPECIFICATION FOR INSTALLATION OF POLES AND FOUNDATION:

Design & Approval:

The foundation shall be designed to withstand the wind velocity applicable as per relevant IS 875 Part - III and maintaining the maximum deflection of the pole as specified with bracket & fixtures within limits of specified standard. Foundation for the pole shall be made as per the design of manufacturer & should be suitable for site. The agency shall submit the design calculation & foundation drawing duly vetted / certified by a Chartered Engineer or authorized structural engineer or OEM for approval of Engineer-in-charge before casting the foundations. The cost for the same shall be borne by the agency.

Casting of Foundation:

Cement concrete (CC) foundation of minimum M20 grade / 1:1.5:3 grade concrete shall be casted as per item nomenclature given in the schedule of work / as per approved design and drawing. The curing shall be done for two weeks before installing the poles on foundation. The foundation shall project above ground by 200 mm or as per direction of Engineer-in-charge which shall be neatly finished with sand cement plaster.

Cable Guard pipe:

40 mm dia. ISI marked HDPE DWC pipe including bending / coupling as required shall be provided for laying of loop-in loop-out cables in soil / concrete for easy laying & relaying of cable without any change to the CC work. The end of the pipe shall be sealed after cable is laid & tested. Separate pipe will be used for laying of separate cables.

Wiring to Light Fixtures:

Each street light fixture shall be wired from DP MCB provided on loop-in-loop-out box of pole by means of a separate flexible un armoured 3 core, 2.5 sq. mm, copper conductor, FRLS PVC insulated cable.

Installation of pole:

The octagonal poles shall be installed with good workmanship so that it is levelled, properly aligned and oriented. Care shall be taken in handling the octagonal pole to avoid any distortion to the supporting structure or damage to the delicate instruments & electrical parts. After erection of pole, bracket and all Accessories, the poles shall be numbered as per the direction of Engineer-in-charge and the exposed portion of concrete foundation shall be painted with black and yellow zebra marking. The cost of the same is deemed to be included within the quoted cost for erection of poles.

Submission of lux level and measurement:

Submission of lux level and measurement: Before taking up the work, the contractor shall furnish the typical lux level calculation sheets for the given fixtures, type of fixture, pole height & bracket mentioned in the schedule of work for approval of the Engineer In-charge. On completion of work the contractor shall demonstrate & furnish the same as final lux level of typical areas and submitted for acceptance of Engineer In-charge. The Manufacturer along with the successful tenderer shall visit Varanasi Airport and lighting design shall be carried out with the following basic data: The luminaire mounting height from ground shall be 3.0 meter and 5.0 Metres. The span between luminaires may vary from 10 to 20 metres as per the design to meet the required lux level. Lux level design shall be done with good uniformity of lighting distribution to achieve 3 to 5 lux at full length of boundary wall and angle of fitting should be such that aircraft may not get misguided. Contractor shall take detailed site measurements and the design shall be submitted to the Engineer in Charge for approval. The quantities given in the tender SOQ / BOQ are tentative and shall vary as per the site/AAI requirements. Only required items & quantities are to be supplied & installed. Also, the tilt angle of the bracket shall be decided on the basis approved lux level design and aerodrome requirement.

The Successful bidder shall submit LM 79 & LM 80 test reports of the fitting and LED while Submitting the design along with OEM test certificates.

Suitable reflector / lenses may also be provided to increase the illumination uniformity and Distribution. Relevant warranty certificate for Min 5 Years Warranty from the manufacturer of the fitting shall be submitted.

Pre-commissioning and commissioning test of perimeter light:

- Check erection and alignment of poles, bracket and fixtures.
- Incoming and outgoing cables are brought with ample clearance.
- Terminal plate is tightly held to pole / mast etc.
- Terminal connections of incoming and outgoing wires / cables are O. K.
- Megger of incoming and

outgoing cable and wire going to fixtures etc. • Pole junction box covers are water tight and lockable. • Foundations are firm and approved by competent authority. • Electrical load balancing is properly carried out and readings to be taken and submitted. • Taking lux level reading of typical areas & its submission. • Numbering of poles and proper nomenclature on MV panels, feeder pillars indicating Incoming and outgoing etc.

Exterior lighting control:

Lighting for exterior applications shall be controlled by timer switch is capable of automatically turning off the all exterior lighting when day light is available or the lighting is not required.

Testing of installation: This section describes the details of test to be conducted for the completed internal electrical.

Tests:

On completion of installation, the following tests shall be carried out: -

- i) Insulation resistance test.
- ii) Polarity test of switch.
- iii) Earth continuity test.

Tests:

Testing shall be carried out for the completed installations, in the presence of and to the satisfaction of the Engineer-In-Charge by the Contractor. All test results shall be recorded and submitted to AAI.

Witnessing of tests:

Testing shall be carried out for the completed installations, in the presence of and to the satisfaction of the Engineer-In-Charge by the Contractor. All test results shall be recorded and submitted to AAI.

Insulation resistance:

The tests described below shall be made before the installation is permanently connected to the supply. For these tests large installations may be divided into groups of outlets, each containing not less than 50 outlets. For the purposes of this code the term 'outlet' includes every point and every switch except that a socket outlet, appliance or luminaire incorporating a switch is regarded as one outlet. The test voltage for insulation resistance measurement shall be 500 V.

When measured with all fuse links in place, all switches (including, if practicable, the main switch) closed and, all poles or phases of the wiring electrically connected together, the insulation resistance to earth shall be not less than 1 mega ohm. When measured between all the conductors connected to any one phase or pole of the supply and, in turn, all conductors connected to each other phase or pole the insulation resistance shall be not less than 1 mega ohm.

Wherever practicable, so that all parts of the wiring may be tested, all lamps shall be removed and all current using equipment shall be disconnected and all local switches controlling such lamps or other equipment shall be closed. Where the removal of lamps and/or the disconnection of current-using equipment is impracticable, the local switches controlling such lamps and/or equipment shall be open. Particular attention shall be given to the presence of electronic devices

connected in the installation and such devices shall be isolated so that the test voltage does not damage them.

Where equipment is disconnected for the tests prescribed above, and the equipment has exposed conductive parts required by these clauses to be connected to protective conductors, the insulation resistance between the exposed conductive parts and all live parts of the equipment shall be measured separately and shall comply with requirements of the appropriate Indian Standard and the insulation resistance shall not less than 0.5 mega ohm.

Testing of earth continuity path:

The earth continuity conductor, including metal conduits and metallic envelops of cables in all cases, shall be tested for electric continuity. The electrical resistance of the same along with the earthing lead, but excluding any added resistance, or earth leakage circuit breaker, measured from the connection with the earth electrode to any point in the earth continuity conductor in the completed installation shall not exceed one (05) ohm.

Measurement of earth electrode resistance:

As described in specification of section 'Earthing' above.

Test certificate: On completion of an electrical installation or an extension to an installation, a certificate shall be furnished by the Contractor, countersigned by the certificate supervisor under whose direct supervision the installation was carried out. The certificate shall be in the prescribed form in addition to test certificate required by the local Electricity supply authorities. Testing shall be carried out for the completed installations, in the presence of and to the satisfaction of the Engineer-In-Charge by the Contractor. All test results shall be recorded and submitted to AAI.

LED LUMINAIRES:

Sl.No	TECHNICAL PARAMETER	FOR INDOOR LIGHT	FOR OUT DOOR LIGHT
1	Efficiency of LED light fitting (Efficacy)	Min 100 Lumens/watt	Min 110 Lumens/watt
2	Life of LED light Fitting	Not less than 50000 burning Hours	Not less than 50000 burning Hours
3	Approved make for LED	Nichia/cree/Osram/Phillips (Lumiled)/Sharp/Seoul/Everlite/Citizen (Japan)/Bridgelux (USA)/Samsung.	Nichia/cree/Osram/Phillips (Lumiled)/Sharp/Seoul/Everlite/Citizen (Japan)/Bridgelux (USA)/Samsung.
4	CRI (Colour Rendering Index)	Min 80 for indoor applications.	Min 70 for outdoor applications.
5	THD (Total Harmonic Distortion)	Less than 10%	Less than 10%
6	Voltage Range	140 V to 270 V	140 V to 270 V
7	Type of Housing	Extruded aluminium/CRCA/Standard alloy housing	High pressure die cast aluminium/ Standard alloy outdoor applications
8	IP Category	IP 20 or higher for indoor applications.	≥ IP65

9	Surge Protection	Shall be provided conforming to relevant IS standard/IEC for LED Driver (In-built):EN61000-4-5 or as specified in BOQ > 2KV	> 4KV
10	Labeling/identification Mark	Manufactures Name/Logo shall engraved/Embossed on housing/body or on aluminium plate Labels or screen printed on housing/ body.	Manufactures Name/Logo shall engraved/Embossed on housing/body or on aluminium plate Labels or screen printed on housing/ body.
11	Warranty period	5 years warranty from actual date of completion of work on complete luminaire including driver/control gear, LED, all accessories etc.	5 years warranty from actual date of completion of work on complete luminaire including driver/control gear, LED, all accessories etc.
12	Power Factor	Equal to 0.95 or more	Equal to 0.95 or more
13	Total Power consumption of fitting.	Not More than 110% of rated capacity of LED light fitting.	Not More than 110% of rated capacity of LED light fitting.
14	Approved Make of Driver	Meanwell/Inventronics/C&S/Moso Power/BAG/Phillips/Wipro/Osram/Bajaj/Pharos/Fulham/Helver/OEM of light Fixture.	Meanwell/Inventronics/C&S/Moso Power/BAG/Phillips/Wipro/Osram/Bajaj/Pharos/Fulham/Helver/OEM of light Fixture.
15	Type of Driver	Enclosed/Encapsulated	Enclosed/Encapsulated
16	Efficiency of Driver	$\geq 85\%$	$\geq 85\%$
17	Testing Facility	LED Luminaire manufacturer shall have In-house NABL accredited Photometry lab.	LED Luminaire manufacturer shall have In-house NABL accredited Photometry lab.
18	BIS Registration	All luminaires & drivers shall be BIS registered.	All luminaires & drivers shall be BIS registered.
19	Housing thickness	Housing of luminaires shall ≥ 0.5 mm for CRCA or 1 mm for Extruded Aluminium or 1.5 mm for PDC aluminium or heavier if so required to meet the application requirement.	Housing of luminaires shall ≥ 0.5 mm for CRCA or 1 mm for Extruded Aluminium or 1.5 mm for PDC aluminium or heavier if so required to meet the application requirement.
20	IK Rating	IK 04 or above	IK 07 or above
21	LED Binning (Standard Deviation Colour Matching)	< 5 (SDCM)	< 5 (SDCM)
22	Unified Glare Rating (UGR)	≤ 19	NA

Note: LM79 & LM80 test reports test report/certificate from NABL / Govt. approved laboratory and other OEM test certificates to be submitted before supply of LED fittings.

L.T CABLES:

1.1 General

L.T. Cables shall be supplied, laid, tested and commissioned in accordance with drawings, specifications, relevant Indian Standards specifications and cable manufacturer's instructions. The cable shall be delivered at site in original drums with manufacturer's name clearly written on the drums. The recommendations of the cable manufacturer with regard to jointing and sealing shall be strictly followed.

2.1 Materials

All L.T. Power cables shall be XLPE insulated PVC sheathed type stranded aluminum / copper conductor armoured cable whereas control cable shall be armoured / unarmoured conforming to IS: 7098: 1988 (Part-I) with upto date amendments as specified in SOQ. outer sheath shall be FRLS.

3.1 Inspection

All cables shall be inspected at site and checked for any damage during transit.

4.1 Joints in Cables

The Contractor shall take care to see that the cables received at site are apportioned to various locations in such a manner as to ensure maximum utilization and avoiding of cable joints. This apportioning shall be got approved from Engineer-In-Charge before the cables are cut to lengths.

5.1 Inspection & Testing

- The LT cables shall be inspected in the OEM factory before dispatching.
- All LT Cables shall be inspected at site and checked for any damage during transit
- All the routine & acceptance as per IS: 7098 (Part I) shall be conducted in the presence of AAI representative.

6.1 Testing of Cables

Prior to installation burying of cables, following tests shall be carried out. Insulation test between phases, phase & neutral, phase & earth for each length of cable.

- Before laying.
- After laying.
- After jointing.

On completion of cable laying work, the following tests shall be conducted in the presence of the Engineer in Charge.

- a. Insulation Resistance Test (Sectional and overall).
- b. Continuity Resistance Test.
- c. Earth Test.

Note -All tests shall be carried out in accordance with relevant Indian Standard code

of practice and Indian Electricity Rules. The Contractor shall provide necessary instruments, Equipment and labour for conducting the above tests & shall bear all expenses of conducting such tests.

7.1 LT Cable laying

- Cables shall be laid directly in ground, pipes, HDPE pipe masonry ducts, on cable tray, etc. as as per the design & site requirements.
- All the LT cables shall be laid in accordance to CPWD specifications/ IS: 1255 amended upto date.

7.2 Cable Tags

Cables Tags

Cable tags shall be made out of 2mm thick aluminium sheets. Tags to be provided at incomer end, outgoing end and at feeder pillars in between.

EARTHING

Scope

This section covers the essential requirements of earthing system components and their installation. For details not covered in these specifications, IS Code of Practice on earthing (IS: 3043-1987) CPWD General Specifications for Electrical works (Part-I-Internal) as amended upto date and in the regulations of the local Electrical Supply Authority shall be referred to.

Application

- i) The electrical distribution system is with earthed neutral (i.e. neutral earthed at the transformer / generator end). In addition to the neutral earthing, provision is made for earthing the metallic body of equipments and non-current carrying metallic components in the substation, as well as in the internal / external electrical installations.
- ii) Earthing requirements are laid down in Indian Electricity Rules, 1956 and Indian Standard Specification IS: 3043:1987 with latest amendment as amended from time to time, and in the Regulations of the Electricity Supply Authority concerned. These shall be complied with.

Materials

The material of earth and earth conductor shall be as specified in SOQ.

Earth Electrodes

The earth electrode shall be Plate / Hollow sections earth electrode as specified in SOQ and the materials and size of earth electrodes shall be as specified.

Earthing Conductor

The earthing conductor (protective conductor from earth electrode upto the main earthing terminal/ earth bus, as the case may be) shall be of the same material as the electrode, viz. GI or copper and in the form of wire or strip as specified. The size of earthing conductor shall be as specified. Each equipment shall be connected with two independent earth conductors to earth bar located in respective area. Each earth bar shall be connected to Earth Grid by two independent earth conductors. Earthing Grid shall be directly connected by two independent earth electrodes. Earthing shall be of GI or Copper.

Location for Earth Electrodes

Normally earth electrodes shall not be located closer than 1.5 m from any building. Care shall be taken to see that the excavation for earth electrode does not affect the foundation of the building; in such cases electrodes may be located further away from the building, with the prior approval of the Engineering-In-Charge. The location of the earth electrode shall be such that the soil has a reasonable chance of remaining moist as far as possible. Entrances, pavements and roadways, shall be avoided for locating earth electrodes. When more than one electrode (plate / hollow sections) are to be installed, a separation of not less than 2m shall be maintained between adjacent electrodes.

INSTALLATION

ELECTRODES

Hollow sections Electrode

Earthing electrode shall consist of a medium class GI Hollow sections of approved make not less than 40 mm dia and 4.5 meters long. GI Hollow sections electrode shall be cut tapered at the bottom and provided with holes of 12mm dia drilled at not less than 75 mm interval upto 2 meters length from bottom. The electrode shall be buried vertically in the ground as far as practicable below permanent moisture level with its top at not less than 20 cm below ground level. The electrode shall be in one piece and no joints shall be allowed in the electrode. Wherever possible earth electrodes shall be located as near water tap, water drain or a down take hollow sections. Earth electrodes shall not be located in proximity to a metal fence. It shall be kept clear of the building foundations and in no case shall be nearer than 2 meters from the outer face of the wall. The hollow sections earth electrode shall be kept vertically and surrounded with 150 mm thick layer of charcoal dust and salt mixture upto a height of 2.0 meters from the bottom. At the top of the electrode a funnel with a mesh shall be provided for watering the earth. The main earth conductors shall be connected to the electrode just below the funnel, with proper terminal lugs and check nuts. In locations where the full length of hollow sections electrode is not possible to be installed due to meeting a water table, hard soil or rock, the electrode may be reduced length, provided the required earth resistance result is achieved with or without additional electrodes, or any alternative method of earthing may be adopted, with the prior approval of the Engineer-In- Charge. Hollow sections electrodes may also be installed in horizontal formation in such exceptional cases.

Plate Earth Electrode

Earthing shall be provided with GI / copper plate electrode as mentioned in SOQ of following. i. GI Plate Electrode. : 600 mm x 600 mm x 6 mm thick ii. Copper Plate Electrode. : 600 mm x 600 mm x 3 mm thick The electrode shall be buried in ground with its faces vertical and not less than Three (3) meters below ground level. 20 mm dia medium class GI hollow sections shall be provided and attached to the electrode. Earth electrode shall not effect the column footing or foundation of the building. In such cases electrode shall be further away from the building.

Watering Arrangement

i) In the case of plate earth electrodes, a watering hollow sections of 20 mm dia. medium class GI hollow sections shall be provided and attached to the electrodes as shown in the drawing and a funnel with mesh shall be provided on the top of this hollow sections for watering the earth. ii) In the case of hollow sections electrodes, a 40 mm x 20 mm reducer shall be used for fixing the funnel with mesh. iii) The watering funnel attachment shall be housed in a masonry enclosure of size not less than 300 mm x 300 mm x 350 mm deep. MS frame with 6 mm thick MS cover and having ALLEN Key locking arrangement shall be suitably embedded in the masonry enclosure.

The top enclosure shall be provided of 50 mm thick PCC. The details of Plate / Hollow sections earth electrode, a detailed drawing as referred in CPWD specification of Internal EI shall be referred.

Earth Conductor

In the case of plate earth electrodes, the earthing conductor shall be securely terminated on to the plate with two bolts, nuts, check nuts and washers. In the case of hollow sections earth electrodes, wire type earthing conductor shall be secured by using a through bolts, nuts and washers and terminating socket. The earthing conductor from the electrode upto the building shall be protected from mechanical injury by a medium class, 15 mm dia GI hollow sections in the case of wire, and by a minimum of 40 mm dia, medium class GI hollow sections in the case of strip. The protection hollow sections in ground shall be buried at least 30 cm deep (to be increased to 60 cm in case of road crossing and pavements). The portion within the building shall be fixed on walls. The earthing conductor shall be securely connected at the other end to the earth stud/ earth bar provided on the switch board by Soldered or preferably crimped lug, bolt, nut and washer in the case of wire, and, Bolt nut and washer in case of strip conductor. Earth Bus and Main Earthing Terminal In all installations, main earthing terminal shall be provided at the main switchboard. This may be in the form of earth stud or single earth bar depending on the type of the switchboard. Following conductors shall be terminated on to the main earthing terminal. a) Earth connection from electric supply company (where provided) b) Earthing conductor from electrode. c) Protective conductors d) Equi-potential bonding conductors. Protective (Loop Earthing / Earth Continuity) Conductor Earth terminal of every switchboard in the distribution system shall be bonded to the earth bar / terminal of the upstream switchboard by protective conductors. Two protective conductors shall be provided for a switchboard carrying 3 phase switchgear thereon.

Earth Resistance

The earth resistance at each electrode shall be measured. No earth electrode shall have a greater ohmic resistance than 5 ohms as measured by an approved earth testing apparatus. In rocky soil the resistance may be upto 8 ohms. Where the above stated earth resistance is not achieved, necessary improvement shall be made by additional provisions, such as additional electrode (s), different type of electrode, or artificial chemical treatment of soil etc., as may be directed by the Engineer-In-Charge.

Marking

- i) Earth bars / terminals at all switch board shall be marked permanently, as 'E'.
- ii) Main earthing terminal shall be marked 'SAFETY EARTH- DO NOT DISCONNECT'.

Measurement of Earth Electrode Resistance

Two auxiliary earth electrodes, besides the test electrode, are placed at suitable distance from the test electrode. A measured current is passed between the electrode 'A' to be tested and an auxiliary current electrode 'C' and the potential difference between the electrode 'A' and auxiliary potential 'B' is measured. The resistance of the test electrode 'a' is then given by $R = V / I$ Where, R- Resistance of the test electrode in ohms V- Reading of the voltmeter in volts I- Reading of the ammeter in amps Stray currents flowing in the soil shall produce serious errors in the measurement of earth resistance. To eliminate this, hand driven generator is used. If the frequency of the supply of hand driven generator coincides with the frequency of stray current, there shall be wandering of instrument pointer. An increase or decrease of generator speed shall cause this to disappear. At the time of test, the test electrode shall be separated from the earthing

NOT TO SCALE



TSC- 11

PTTA MV/LT SWITCH BOARD PANEL

1.1 SCOPE OF WORK

This Section covers the Detailed Requirements of Medium Voltage Switch Boards suitable for 415 V, 3 Phase, 50 Hz, 4 Wire Neutral Solidly Earthed System to be supplied, installed and its testing and commissioning. (PTTA Panels are LT Panels with Incomer Switch Gear Rating Below 250 Amps (Including 250 Amps)).

1.2 STANDARDS AND CODES

Updated and Current Indian Standard Specifications and Codes of Practices will apply to the Equipment and the Work covered under the scope of this Contract.

Low Voltage switchgear Assemblies		For TTA: IEC 61439-1& 2 For PTTA: IEC 60439
Low Voltage switchgear & control gear		For TTA: IEC 61439-1& 2 For PTTA: IEC 60439
Part I	General rules	
Part II	Circuit Breakers	
Part III	Switches, disconnectors, switch disconnectors and fuse combination units	
Part IV	Contactors and Motor starters	
Part V	Control circuit devices and switching elements	
Degree of Protection of Enclosures for low voltage switchgear.		IEC60529 / IS 2147 : 1962
Internal arc tests		IEC61641
Voltage Transformer		IS – 3156
Current Transformer		IS - 2705

1.3 CONSTRUCTION

The LT Panel Switch Board shall be fabricated out of CRCA Sheet Steel (Thickness as per SoW) and shall be of totally enclosed, dust tight, vermin proof, weather proof, free standing, floor/wall mounting totally compartmentalized cubicle construction. The general construction shall conform to IS: 8623 for factory assembled switchboard.

The enclosures shall be designed to take care of normal stress as well as abnormal electro-mechanical stress due to short circuit conditions. All covers and doors provided shall offer adequate safety to operating persons and provide ingress protection of IP 42 for Indoor and IP 54 for Outdoor use unless otherwise stated.

Ventilating opening and vent outlets, if provided, shall be arranged such that same ingress protection is retained.

For operator safety, IP 2X (Touch Proof) Protection shall be available even after opening the Feeder Compartment Door. The compartmentalization is to be achieved by using metal separators, and use of PVC sheet / Hylem sheets shall not be allowed. Wherever necessary, such sheet steel members shall be stiffened by angle iron framework. General construction shall employ the principle of compartmentalization and segregation for each circuit. Each section of

the front side shall have hinged access doors. Metal based neoprene gaskets between all adjacent units and beneath all covers shall be provided to render the joints dust and vermin proof to provide a degree of protection of IP 42/IP 54 as stipulated in SoW. The unused openings within the switchboards shall be closed using suitable grommets. Special care to be taken to ensure effective earthing of the frame and doors of the switch boards by Double earthing. Switchboard shall be provided with "Danger Notice Plate" conforming to relevant Indian Standards.

The overall height of the switchboard shall be limited to 2400 mm for all the Bus bar ratings and type of switchboards. The panel shall be provided with base frame of 100 mm x 50mm x 5mm thick ISMC. Hence total panel height should not be more than 2500 mm. The height of the operating handle, push buttons etc shall be restricted between 300 mm and 1800 mm from finished floor level. All cable entries shall be through gland plates of 3mm thick. The construction shall include necessary cable supports for clamping in the cable alley.

Bus bars shall be made of high conductivity, and high strength Aluminum E 91 Grade. The Current Density to be considered is 0.8A/mm² only. Bus Bars shall be of rectangular cross section, suitable for full load current for phase bus bars and neutral bus bar. Bus bar shall be suitable to withstand the stresses of fault level as specified in SoW. Main Horizontal bus bar and Neutral should be in same compartment. The bus bars shall be supported on non-breakable, non-hygroscopic epoxy resin or glass fiber reinforced polymer insulated supports able to withstand operating temperature of 1100 C at regular intervals, to withstand the forces arising from a fault level as stipulated in SoW.

Auxiliary buses for control power supply, space heater power supply or any other specified service shall be provided. These buses shall be insulated, adequately supported and sized to suit specific requirement. The material for auxiliary supply bus will be insulated electrolytic copper wires.

Clearances between phases should be in line with IEC. All connection and tap offs shall be through adequately sized connectors appropriate for fault level at location.

For unit ratings up to 100 amps, PVC insulated copper conductor wires of adequate size (to carry minimum 1.5 times the Switchgear) to carry full load current shall be used. Solid connections shall be used for all rating of above 100 amps. Bus Links/Wires with Connectors (Suitable for terminating PVC/XLPE Cable of Sizes as per Site Requirements) shall be provided for Incoming Side of Incomer and Outgoing Side of Outgoing Switch Gears.

The terminations of all interconnections shall be crimped and firmly bolted. All screws, bolts, washers shall be zinc plated. All bus bars and connections shall be suitably sleeved with PVC sleeves of appropriate colour coding.

All Control/Power Wirings shall be with 2.5 Sq.mm. Copper conductor for current carrying. Ferrules shall be provided for easy identifications of the wires.

Anti-condensation heaters shall be fitted in cubicle of MCCBs of rating upto & above 200 Amps together with an ON/OFF isolating switch suitable for electrical operation at 230 Volts AC 50 Hz single phase of sufficient capacity to raise the internal ambient temperature by 50 C. The electrical apparatus so protected shall be designed so that the maximum permitted rise in temperature is not exceeded if the heaters are energized while the switchboard is in operation. As a general rule, the heaters shall be placed at the bottom of the cubicle.

The board shall have a common earth bar [not less than 50x6 mm Al] with two terminals for earth connections. Hinged doors/ frames to be connected to earth (Double Earthed) through adequately sized flexible braids. ~~Suitable provisions shall be made in the panel for proper heat~~

~~dissipation. Air aspiration louvers for heat dissipation shall be provided as necessary. The switchboard shall be provided with panel mounting type ventilation fans if required.~~

Sheet steel used in the fabrication of switchboards shall undergo a rigorous cleaning and surface treatment of seven tank process. Final paint coat of oven baked powder coating of minimum 70-micron thickness of sheet approved by Engineer-in-Charge shall then be provided. Suitable engraved white on black Name Plates and Identification Labels of metal for all switchboards and circuits shall be provided.

These shall indicate the feeder number and feeder designation. The Outdoor Feeder Pillars shall have Rain Guard as required. The General Arrangement Diagram (GAD) shall be got approved before fabrication.

1.4 RATING AND REQUIREMENTS OF COMPONENTS

The Rating and Requirements of Each Components of the Switch Board shall meet the following Specifications/SoW.

1.4.1 MCCBs

All MCCBs shall be 4 Pole or 3 Pole as per SoW and suitable for not less than Breaking Capacity as specified in Schedule of Work and complied with relevant BIS Code.

MCCBs shall have $I_{cu}=I_{cs}$. MCCBs shall have Micro-processor based Over Load, Short Circuit and in built Earth Fault Protection/TMR as per SoW. The MCCBs shall be provided with Rotary Operating Mechanism with Door Interlock Facility and micro switches for ON/OFF/TRIP Indication. Phase Barriers and Spreaders shall be provided.

1.4.2 METERING AND PROTECTION

Resin Cast C.T. operated Digital Meter [EM 6400 of Conserve/Equivalent Make or as per SoW] shall be used for Metering and the Meter shall be of flush mounted type with HRC cartridge fuses/MCBs protection as per Schedule of Work. Current Transformer shall comply with IS 2705 (Part-II) 1964 and shall be of class I accuracy.

All Voltmeter shall be protected with MCBs.

1.4.3 INDICATION LAMPS

The indication lamps for Phase Indication and ON/OFF/TRIP Indication shall be LED type lamps as required. The LED shall be 5mm dia and in a lamp there shall be seven LED minimum. All lamps shall be protected by MCBs. Instruments and indicating lamps shall not be mounted on the air circuit breaker compartment door for which a separate and adequate compartment shall be provided. For MCCBs, instruments and indicating lamps can be provided on the compartment doors.

1.5 PRE-DELIVERY INSPECTION

The agency shall submit the drawings of all Switch Boards on receipt of award letter for approval. On receipt of approval of drawings, the Switch Boards shall be got manufactured at Manufactures' Works. The Switch Board shall be tested for routine and acceptance tests in the Manufactures' Works in the presence of AAI Representatives and on receipt of dispatch clearance; the panels shall be supplied/installed/tested/commissioned at airport.

During Inspection at Manufactures' Works by AAI, the Agency shall submit the Factory Test Reports of all Major Components like MCCBs, and Calibration Report of Meters/CTs etc.

1.6 INSTALLATION, TESTING AND COMMISSIONING The Installation work shall cover assembly, lining up, grouting the units etc. All protection and other control wirings for indication etc., shall be completed before calibration and commissioning checks are commenced. Commissioning checks and tests shall include all wiring checks and checking up of connections. The Outdoor Feeder Pillars shall be installed on RCC Pedestal of Depth as per SoW. The Area in front of Panels shall be raised and levelled finally (After Termination of Cables) with available nearby earth and rammed. Commissioning Checks and tests shall include the following.

- a) Operation checks of all moving parts.
- b) Continuity checks of wiring, fuses etc. as required.
- c) Insulation test with 500 V Megger.

DWC/ HDPE PIPE

1.1 Specifications for HDPE Pipe

- i. The HDPE pipe should be made from rugged & virgin High Density Poly Ethylene material with double wall construction as per IS- 16205/ IS 14930, part-2, with latest amendments.
- ii. ~~HDPE duct shall conform to the IS 4984.~~
- iii. The HDPE pipe/duct should be free from cracks & have suitable mechanical strength to protect runway lighting cables laid in Runway/Shoulder. The Pipe should high ring stiffness, better impact strength & superior crush resistance.
- iv. HDPE duct shall be suitable for laying through trenchless horizontal directional drilling method.
- v. The pipe should have better ability to withstand heavy external loads when properly buried & back filled or compacted with concrete.
- vi. The pipe should be chemically inert & should have anti rodent, anti termite properties.
- vii. HDPE pipe should have better resistance to flame propagation properties.
- viii. Pipe should be laid at suitable slope while maintaining proper depth to that the water cannot be accommodated in pipes/fittings.
- ix. The guide wires, if required, to be provided in HDPE pipes for pulling of cables with proper arrangement to avoid blockage of pipes.

1.2 Accessories of HDPE Pipe

The following accessories, if required, for jointing the duct/pipe to be provided and nothing shall be paid extra against accessories.

- i) *Coupler*: The coupler shall be used to join two HDPE pipes. The coupling shall be able to provide a durable water tight joint between two ducts without deteriorating the strength of the ducts. The strength of coupler shall match the primary strength of the HDPE duct.
- ii) *End plug*: This shall be used for sealing the ends of empty duct, prior to installation of cable and shall be fitted immediately after laying of the HDPE duct, to prevent entry of any unwanted elements such as dirt, water, moisture, insects/rodents etc.

iii) *Cable sealing plug*: This is used to hold the cable and prevent entry of any unwanted elements, as specified above

iv) The Guide rope is drawn through the HDPE pipes/coils and safely tied to the end caps at either ends with hooks to facilitate pulling of the cables at a later stage.

v) *Joint Chamber*: The Joint chamber shall be provided at every joint location to keep the cable joint well protected and also to house extra length of cable which may be required in the event of faults at a later date. The Joint chamber shall be a Brick chamber.

~~vi) *Rubber Bush*: To prevent entry of rodents into HDPE DUCTS, the ends of HDPE DUCTS are sealed at every manhole and joint using rodent resistant hard rubber bush (cap) after AFL cable is pulled. The rubber bush should be manufactured from hard rubber with grooves and holes to fit into 50 mm HDPE DUCTS pipe, so that it should be able to prevent the entry of insects, rodents, mud, and rainwater into the HDPE DUCTS pipe.~~

1.3 Marking

The entire duct shall be clearly marked at intervals of 1 meter with the following data.

- Manufacture's name or trade mark
- Year of manufacturing
- Type of HDPE duct and size
- Running length marking.

1.4 Packing and delivery

The new branded pipe shall be supplied with standard marking provided on each pipe.

1.5 Inspection and Testing

Visual inspection of 100% of the item/material shall be carried out by AAI on receipt of material at site and any visual damage observed onsite inspection on the supplied item/material would make the consignment liable for rejection.

1.6 Survey

Before execution of the work the Contractor shall carry out the required survey of the routes for Pipe laying at no additional cost to AAI. The Contractor shall prepare the Drawing of these routes in AAI grid map furnishing all distances, details regarding position of joint boxes, manholes, etc .Trial pits may be dug at suitable locations to assess the obstacles.

The Drawing shall have to be submitted by contractor to AAI for approval and requisite clearances need to be obtained before the cable installation work is commenced by the contractor. The installation/ shall be carried out as per the approved drawings. Route maps shall be drawn to the scale.

1.7 Laying of HDPE pipe

Making arrangements for handling, loading/ unloading of pipes shall be done by the contractor. Manual digging of trench shall be done as per direction of EIC so as to protect existing underground cables. The construction practices and standards as per engineering instructions are applicable to all the works.

HDPE Pipe – shall confirm relevant IS standard. ~~Item shall be inspected in factory and shall be accepted after acceptance tests.~~

- The temporary pits made for carrying out the pipe/cable laying work to be restored to the original level to the satisfaction of the Engineer -in-charge.

1.8 Termination and Jointing of Cables

Use of Lugs/Socket

All cable leads shall be terminated at the equipment terminals, by means of crimped type solder less connectors unless the terminals at the equipment ends are suitable for direct jointing without lugs/sockets.

The following is the recommended procedure for crimped joints and the same shall be followed:

- i) Strip off the insulation of the cable end with every precaution, not to sever or damage any stand. All insulation to be removed from the stripped portion of the conductor and ends of the insulation should be clean and square.
- ii) The cable should be kept clean as far as possible before assembling it with the terminal/socket. For preventing the ingress of moisture and possibility of re-oxidation after crimping of the aluminium conductors, the socket should be fitted with corrosion inhibiting compound. This compound should also be applied over the stripped portion of the conductor and the palm surface of socket.
- iii) Correct size and type of socket/ferrule/lug should be selected depending on size of conductor and type of connection to be made.
- iv) Make the crimped joint by suitable crimping tool.
- v) If after crimping the conductor in socket/lug, same portion of the conductor remains without insulation the same should be covered sufficiently with PVC tape.

Coordination with other agencies:

The contractor shall coordinate and cooperate with other agencies by exchange of all technical information as required, like details of weight, over all dimensions clearance and other technical data required for successful and proper completion of his portion of the work in relation to the work of others without any reservation. No remuneration should be claimed from the Department for such technical cooperation. Care shall be taken not to damage any structure.

If any unreasonable hindrance is caused to other agencies and any completed portion of the works has to be dismantled and redone for want of the cooperation and coordination by the

contractor during the course of work, such expenditure incurred will be recovered from the contractor. If the restoration work is not carried out to the satisfaction of the Engineer-in-Charge the same shall be got done at his risk and cost.

FLAG MAST

1. SCOPE

The scope of this specification covers the manufacture, transport, installation, testing and commissioning of the complete Flag system, using Raising and Lowering type of Flag mast Towers, aviation obstruction light including the Civil Foundation Works. SITC of feeder pillar Panel. Supply and laying of cable.

2. WIND TUNNEL TEST

The contractor has to conduct wind tunnel test on a specimen to establish the force coefficients of the 20 side polygon and the value received from the wind tunnel test is to be taken in design. Further type test is to be done on a full size mast at SERC or other reputed institutions to validate the structural program. The winches are to be type tested through reputed institutions/laboratories.

Contractor shall have to submit the wind tunnel test certificate along with the supply.

3. APPLICABLE STANDARDS: Code No.

1. TR NO. – 7 High Masts for Lighting and CCTV (2000 edition) of ILE, U.K.
2. SABS 0225: 1991 High Mast natural frequency calculation
3. IS 875 Part :- 3 Wind Loading
4. BS EN 10025: 1993 High Tensile Steel Sheets
5. IS 2062 Mild Steel
6. BS EN ISO 1461 Galvanization
7. IS 3459/2266 Stainless steel Wire rope
8. IS 325 Motor

4. FLAGMAST:

4.1 Structure:

The Flag mast shall be of continuously tapered, polygonal cross section. 20 sided, presenting a good and pleasing appearance and shall be based on proven In-Tension design conforming to the standards referred to above to give an assured performance and reliable service.

4.2 Construction:

The mast shaft shall be manufactured from high tensile steel plants confirming to BS EN 10025 having minimum yield strength of 355N/Sq. mm. Each mast shaft section shall have only one longitudinal weld and without any circumferential weld joint. Sections with more than one longitudinal weld shall not be accepted. The mast base flange shall be free from any lamination or incursion and provided with supplementary gussets between the bolt-holes to ensure elimination of helical stress concentration.

The minimum A/F dimension of top shall be 150 mm and bottom as per the design and data sheet enclosed. The minimum section length except for the top section shall be 10.98 m and top shall depend on the length required to make the specified height. The masts sections shall be joined at

site by slip-stress-fit method and minimum overlap distance shall be 1.5 times the diameter at penetration.

A door reinforced with welded steel section, vandal resistant, weather proof with Allen bolts and pad locking facility of dimension 1250 mm x 250 mm shall be provided at a height 2 times the width of door from the base of mast to provide clear access to base compartment equipment's winch. Motor, cable, connector etc.

For the environmental protection of the mast. The entire fabricated mast shall be hot dip galvanized internally and externally in single dip having a uniform average thickness of 85 microns for plates more than 5 mm and 70 microns for 5 mm or less thickness.

4.3 Dynamic Loading for the Mast:

The mast structure shall be suitable to sustain an assumed maximum reaction arising from a wind speed as per IS 875 (Three second gust), and shall be measured at a height of 10 meters above ground level. The design life of the mast shall be 25 years. The force co-efficient taken for design of the polygonal structure is to be established from the wind tunnel test data.

4.4 Flag Mast Foundation: Agency shall perform safe soil bearing capacity and wind velocity withstand capacity as per site and accordingly submit Flag Mast foundation design vetted by IIT/NIT/Govt Engineering College (nothing extra shall be paid on this account).

5. Raising and lowering mechanism:

5.1 Winch:

The double drum winch shall be completely self-sustaining without the need for brake shoe, springs or clutches and self-lubricating type by means of an oil bath. The worm gear ratio shall be 53:1 and safe working load 750 KG. The drums are to be grooved to provide perfect seat for stable and tidy rope lay and arrangement for distortion free rope end termination.

The winch shall have provision to operate manually by a handle or electrically through power loof. The capacity, operating speed, safe working load, recommended lubrication and serial number of the winch shall be marked on each winch.

The winch shall be type tested through reputed institutions like IIT/NIT/ Govt. Engineering Colleges as consultants and a test certificate is to be submitted along with supplies.

5.2 Head Frame:

The hot dip galvanized head frame is to be designed as a capping unit of the mast is of welded steel construction and provided with guides and separators between the ropes and cable. The LM6 Aluminum pulleys with bush bearing mounted through stainless steel shaft shall be suitable to accommodate wire ropes and multi core trailing cable. The head frame shall be provided with guides and stops with PVC buffer for the docking. The pulley assembly shall be covered by a hot dip galvanized canopy.

5.3 Stainless Steel Wire Ropes:

The stainless steel wire ropes shall be in AISI 316 grade. 7/19 construction with central core in the same material of 6 mm diameter. The breaking load of each rope shall not be less than 2350 Kg giving a factor of safety of over 5 for the system at full load as per the TR-7. The end construction of rope for the winch drum shall be fitted with talurit and for two continuous rope the end termination in luminary's carriage shall be with stainless steel thimble and copper splicing and for others with stainless steel thimble and bull dog grips.

6. Electrical System, Cable and Cable Connections:

{ C- Nil, I- Nil, O- Nil, OW- Nil }

The multi core trailing cable from base compartment to junction box at the top shall be 1.1 KV grade PVC insulated, PVC sheathed copper conductor of size minimum 3 core x 2.5 sq. mm. Wiring from junction box to Aviation Light is to be done using 3 core 2.5 sq. mm PVC insulated, PVC sheathed, copper conductor flexible cable.

Suitable arrangement is to be provided in the base compartment to receive and terminate incoming power cable and MCB in a box for isolation of incoming power supply.

7. Power Tool for the Winch:

Three phase, single speed, motor of rating suitable to lift the load mounted on adjustable plate to adjust the length of winch motor coupling chain is to be provided in base compartment.

Plate to adjust the length of winch motor coupling chain is to be provided in base compartment.

Mechanical torque limiter is to be mounted on motor shaft to stop transmission of motion from motor to winch in case of excess load and thus prevent the damage to winch and breakage of rope.

8. Lighting Finial:

One number of FRP ornamental finial (DOME) shall be provided for FLAG Mast on the head frame to get a direct conduction path to the earth through the mast.

9. Aviation Obstruction Lights:

Supply of double dome LED type Aviation Obstruction Lights

10. Earthing Terminals:

Earth terminal using 12 mm diameter hot dip galvanized bolts shall be provided on the door stiffener of the mast for lightning and electrical earthing of the mast.

11. Mast Feeder Pillar/LT panel:

Mast shall be fed from a separate feeder pillar with incomer, time switch, power tool control with suitable contactors for raising / lowering with push button. Outgoing MCB's for switching of luminaries with auto/ manual selector switch through time switch etc as per requirement. Outdoor LT panel/Mast Feeder pillar (IP 54) shall be as per CPWD internal specification 2013 Part-I

12. Incoming Power Cable:

~~Power cable main and standby of suitable size 4 x 35sqmm up to the feeder pillar from supply point i.e. New Power House shall be provided.~~

13. Luminaries

The 350 W LED flood light luminaries, as per Technical specs for LED Fittings.

This Flood Light shall be installed on suitable pole with required mounting arrangement at desire direction of fitting, with supply & laying of 3Cx2.5 sq. mm Cu cable for the individual wiring of the luminaire to control box of pole.

14. PU Painting:

Flag mast shall be provided with Polyurethane (PU) paint over the galvanized surface after application of Etch Primer coat at factory.

15. FLAG

Supply of national flag of size 20' x 30' in 100% Knitted Polyester (140 gsm), With reinforced super-strong nylon webbing on all 3 sides & rope/toggle sleeve for Khajuraho airport. Flag shall confirm the **Flag Code of India, 2002.**

16. LT CABLE SPECIFICATIONS

The cable shall be XLPE insulated PVC sheathed and confirming to IS 7098 with upto date amendments.

17. CABLE LAYING

The scope of this shall confirm to the CPWD specification with the up to date amendment.

18. EARTHING

Earthing is to be carried out as per latest CPWD specifications & shall be in conformity with relevant provision of the Indian Electricity Rules and Indian standard Specification IS:3043-1987 with latest amendments.

The Earth Resistance at each electrode shall be measured. No earth electrode shall have a greater ohmic resistance than 05 ohms as measured by an approved and calibrated Earth Testing Apparatus (having valid calibration certificate from Govt. approved Testing Laboratory). In rocky soil, the resistance may be up to 08 ohms.

TECHNICAL DATA SHEET

HIGH MAST SYSTEM

Make	: As per Preferred Make List
Height of mast	: 27.5 Meter
No. of sections	: Three
Material construction	: S 355 grade as per BS-EN10025:1993
Base dia and top diameter (A/F)	: Minimum Top: 150 mm : Minimum Bottom: 540 mm
Plate thickness	: Minimum Top: 3 mm, : Minimum Middle: 4 mm : Minimum Bottom: 4 mm
Cross section of Mast	: 20 side polygon
Standard for of galvanization	: As per BS EN ISO 1461
Size of opening and door at base	: 1200 x 250mm
Diameter of base plate	: 740 mm
Thickness of base plate	: 30 mm
Max wind speed	: As per IS: 875 (Part – III)
Number of foundation bolts	: Minimum 12 nos.
PCD of foundation bolts	: 650 mm
Type / diameter / length of foundation bolts	: TS 600 /30 mm dia /850 mm long

POWER CABLE

Cable for Aviation	: Copper, 3 core 2.5 sqmm Armoured cable
--------------------	--

WINCH/POWER TOOL

Type SWL of winch	: Double drum, SWL 750 Kg (SGDD 30/6 PB)
Method of operation	: Integral Motor
Motor capacity	: Minimum 2 HP
No of speeds	: 6 Pole, single speed
Torque limiter	: With mechanical tripping facility

WIRE ROPE FOR FLAG

Grade / construction	: Galvanized
Diameter (mm)	: 6mm
Number of ropes	: Minimum 100mtr. long x 1 nos.

WIRE ROPE FOR BALANCE WEIGHTS

Grade construction : Galvanized
Number of ropes : as per OEM
Diameter (mm) : 6mm

CONTROL PANEL

: Custom Built Panel as per Requirement/ item
description in BOQ and approval of AAI

AVIATION OBSTRUCTION LIGHT

: Double dome, LED type light

NOTE: These are minimum requirements however higher-grade specifications as per manufacturer recommendation may also be acceptable.

LIST OF PREFERRED MAKES FOR ELECTRICAL ITEMS

Note: The following list of preferred makes is exhaustive. However, additional manufacturers or brands may be considered for any specified product or item, depending on market availability, delivery timelines and proven satisfactory performance in similar projects or works—preferably where such a make or product has been used in quantities constituting at least eighty percent (80%) of the estimated or proposed requirement for the relevant project or work. To establish performance, completion certificates, performance certificates and purchase orders accompanied by tax invoices will be considered, provided that the products comply with the technical specifications stipulated in the tender document.

ITEM CODE	ITEMS	PREFERRED MAKES (W.E.F. 10.07.2025)	CATEGORY FOR TEST CERTIFICATION/ INSPECTION
A.	PANEL, SWITCHGEARS AND RELATED ITEMS		
1	LT PANELS (TTA)	MAK / SHIV SHAKTI ENGINEERS / TECHNOCRAFTS / TENCO / KONTACT / ABB / RISHA / MARINE ELECTRICALS / POWERTECH SWITCHGEARS / ULTIMA / RITTAL / URJAYANT/ EXCEL CONTROL SYSTEMS / BALAJI ELECTRO CONTROLS PVT LTD / KRUTI / CMKL(CORE METAL) / KEPL(KHOKHAR) / LEGRAND (NOVATEUR) / CONQUERENT / MITSUBISHI / LS POWER / ZENIYA / NEPTUNE / LAURITZ KNUDSEN / C&S / BCH / ADVANCE / TRICOLITE / SCHNEIDER / SUDHIR / EAP / TRISQUARE / MILESTONE / ADLEC / UNILEC / CONSOUL (RR ISPAT) / PEATON/ HAROLD/ SPC ELECTROTECH / SIEMENS	CATEGORY-1
2	LT PANELS / FEEDER PILLAR (PTTA) / BUS TRUNKING	EXPERT ENGINEERS / MAK / APPLICATION CONTROL PANEL / AMBIT / ADLEC / SHIV SHAKTI ENGINEERS / TECHNOCRAFTS / EXCEL CONTROL SYSTEMS / GLOBAL / SUPERTECH CONTROL SYSTEMS / SWITCHGEARS & FABRICATORS / KONTACT / MARINE ELECTRICALS / R.P. CONTROLS / GOURAV EnerGen / TENCO / POWERTECH SWITCHGEARS / HAROLD / BALAJI ELECTRO CONTROLS PVT LTD / URJAYANT / KRUTI / ASES / ITE-GURGAON (INDIAN TRANSFORMERS) / LEGRAND (NOVATEUR) / CONQUERENT / CORONET / RST ELECTRICALS PVT LTD / HPL / C&S / LS POWER / ZENIYA / PRECISION / ABB / EAP / TRICOLITE / SUDHIR / SCHNEIDER / LAURITZ KNUDSEN / NEPTUNE / HENSEL / ADVANCE / KEPL(KHOKHAR) / PEATON / RISHA / TRISQUARE / CMKL (CORE METAL) / SPC ELECTROTECH / BCH / MILESTONE / YOGIJI DIGI (P) LTD / ELINS / EVA / UNILEC / HAROLD / ENGINEERS & ENGINEERS / SIEMENS / ULTIMA / NITYA	CATEGORY-1
3	AIR CIRCUIT BREAKERS	LS ELECTRIC / BCH / MITSUBISHI / HPL / LAURITZ KNUDSEN / LEGRAND (NOVATEUR) / ABB / C&S / HAVELLS / SCHNEIDER / SIEMENS	CATEGORY-2
4	MOULDED CASE CIRCUIT BREAKERS (MCCB)	LS ELECTRIC / BCH / MITSUBISHI / LAURITZ KNUDSEN / LEGRAND (NOVATEUR) / ABB / C&S / HAVELLS / INDO ASIAN (NOVATEUR) / HPL / SCHNEIDER / SIEMENS	CATEGORY-2
5	CHANGE OVER SWITCH/ FUSE DISCONNECTOR SWITCH/ SWITCH FUSE UNITS	BENTEC / BCH / INDO ASIAN (NOVATEUR) / SOCOMEC / LAURITZ KNUDSEN / C&S / LEGRAND (NOVATEUR) / HPL / ABB / HAVELLS / SIEMENS / SCHNEIDER	CATEGORY-2
6	METERS / MULTIFUNCTION METERS -ANALOGUE/DIGITAL	ELMEASURE / KRYKARD / SELEC / C&S / ABB / BENTEC / SELEC / C&S / MITSUBISHI / ABB / NEPTUNE / SOCOMEC / HPL / LAURITZ KNUDSEN / FINDER / SIEMENS / SCHNEIDER / CONSERVE / SECURE	CATEGORY-3
7	SELECTOR SWITCH, PUSH BUTTON SWITCH / EMERGENCY SWITCH	ABB/ TRINITY TOUCH / LAURITZ KNUDSEN / C&S/ BCH/ EATON / TEKNIC / SIEMENS / SCHNEIDER	CATEGORY-3
8	CT's / PT's	GLOBAL / KRUTI / WAGO / CG POWER / SELEC / NEWTEK / ANANT POWER (ADVANCE) / KAPPA	CATEGORY-3
9	PROTECTIVE RELAYS (ALL TYPE)	P2 POWER / WAGO / SELEC / HAVELLS / MITSUBISHI / LAURITZ KNUDSEN / CG POWER / C&S / ABB / SIEMENS	CATEGORY-2
10	CONTACTORS	MITSUBISHI / HPL / LAURITZ KNUDSEN / C&S / BCH / HAVELLS / ABB / TDK / SIEMENS / LEGRAND (NOVATEUR) / SCHNEIDER	CATEGORY-3
11	TIMERS / TIME SWITCH- ANALOGUE/DIGITAL	HAVELLS / LAURITZ KNUDSEN / SELEC / BCH / ABB / LEGRAND (NOVATEUR) / EATON / FINDER / SIEMENS / SCHNEIDER / C&S	CATEGORY-3
12	LED INDICATION LAMPS	EATON / OLIVE / ABB / LAURITZ KNUDSEN / C&S / BCH / VINAY LED / VAISHNOV / SCHNEIDER	CATEGORY-3


S. M. S. S. S.
M 5 9 5 7 0





ITEM CODE	ITEMS	PREFERRED MAKES (W.E.F. 10.07.2025)	CATEGORY FOR TEST CERTIFICATION/ INSPECTION
B. SUBSTATION RELATED ITEMS			
13	TRANSFORMER UP TO 500 KVA (DRY/OIL)	POWERWARE / ITE, GURGAON / ESENNAR / PVJ POWER / TRANSCON / AMES IMPEX / POWER STAR / JAY BEE / RTS / CG POWER / SUDHIR / VOLTAMP / BHARAT BIJLEE / KOTSONS/ SCHNEIDER / KIRLOSKAR	CATEGORY-1
14	TRANSFORMER MORE THAN 500 KVA (DRY/OIL)	POWERWARE / ITE, GURGAON / ESENNAR / PVJ POWER / TRANSCON / AMES IMPEX / POWER STAR / JAY BEE / RTS / CG POWER / SUDHIR / VOLTAMP / KOTSONS/ SCHNEIDER / BHARAT BIJLEE / KIRLOSKAR / SIEMENS	CATEGORY-1
15	H T PANEL	APPLICATION CONTROL PANEL / SHIV SHAKTI ENGINEERS / ITE, GURGAON / TECHNOCRAFTS / TENCO / MARINE ELECTRICALS / PASCAL / KEPL(KHOKHAR) / CONQUERENT / RISHA / CORONET / L.S POWER / ZENIYA / EAP / CG POWER (CFPISL) / TRICOLITE / SUDHIR / LAURITZ KNUDSEN / ABB / TRISQUARE / SCHNEIDER / MILESTONE / EATON / ANANT POWER (ADVANCE) / ADLEG / SIEMENS	CATEGORY-1
16	BUS DUCT-SANDWICH	RISHA / ADVANCE / RR KABEL / LAURITZ KNUDSEN / C&S / LEGRAND (NOVATEUR) / EAE / SCHNEIDER	CATEGORY-2
17	H.T /L.T.TERMINATION & JOINTING KIT.	DENSONS / CABSEAL® (HARI CONSOLIDATED) / COMPAQ / RAYCHEM	CATEGORY-3
18	POWER CABLES ABOVE 1.1 KV	V-MARC / SBEE / SUYOG ELECTRICALS LTD / DICABS / APAR / GEMSCAB / HPL / RR KABEL / SPECIAL CABLES / JMW KABEL / PARAMOUNT / TIRUPATI / KEC / POLYCAB / DYNAMIC / HAVELLS / KEI / UNISTAR / GLOSTER / RAVIN CABLES / NICCO	CATEGORY-1
19	POWER CABLES UP TO AND INCLUDING 1.1 KV	ALLCAB / AURAFLEX / V-MARC / VISHAL / SBEE / POLYCORE / VIN POWER / TORTEK / SUYOG ELECTRICALS LTD / GEMSCAB / RR KABEL / PLAZA / SPECIAL CABLES / KEI / JMW KABEL / POLYCAB / AVOCAB (CHANDRESH) / DYNAMIC / PARAMOUNT / SVARN / RALLISON (LKB) / BCH / TIRUPATI / KEC / GRANDLAY / HPL / GLOSTER / BONTON / HAVELLS / UNISTAR / APAR / RAVIN CABLES / NICCO	CATEGORY-1
20	CONTROL CABLES	GEMSCAB / ALLCAB / AURAFLEX / V-MARC / SBEE / POLYCORE / TORTEK / NICCO / SUYOG ELECTRICALS LTD / RR KABEL / PLAZA / SPECIAL CABLES / JMW KABEL / AVOCAB (CHANDRESH) / PARAMOUNT / SVARN / RALLISON (LKB) / BCH / BONTON / TIRUPATI / KEI / KEC / GRANDLAY/ UNISTAR / NATCAB (KUALITY) / HPL / POLYCAB / DYNAMIC / ALOKE (ANKUR) / HAVELLS / GLOSTER / FINECAB / APAR / BATRA HENLAY/ RAVIN CABLES	CATEGORY-1
21	TELEPHONE CABLE	POLY INFOCOM CABLES PVT LTD / ORBIT / DUCAB / RR KABEL / PLAZA / JMW KABEL / PARAMOUNT / ALOKE (ANKUR) / RALLISON (LKB) / BONTON / TIRUPAT / HAVELLS / KEI / KEC / KVVIS (INDUSTIRAL) / HPL / POLYCAB / NICCO	CATEGORY-2
22	CO- AXIAL/ INSTRUMENTATION/ FIBRE OPTIC/ CAT-6 / CAT-6A CABLES	AURAFLEX / SBEE / TORTEK / SUYOG ELECTRICALS LTD / ORBIT / POLYCORE / POLY INFOCOM CABLES PVT LTD / BATRA HENLAY / GEMSCAB / RR KABEL / PLAZA / SPECIAL CABLES / JMW KABEL / POLYCAB / PARAMOUNT / LEGRAND(NOVATEUR) / SVARN / RALLISON (LKB) / BONTON / HAVELLS / KEI / ROSENBERGER / KEC / GRANDLAY / GLOSTER / SCHNEIDER / APAR	CATEGORY-2
23	GI / SS CABLE MANAGEMENT SYSTEM (CABLE TRAY-PRE-FABRICATED/ PERFORATED / LADDER TYPE / WIRE MESH TYPE, ETC.)	GLOBAL / OBO BETTERMANN / MM ENTERPRISES / GLOBE / BEC / RMCON (RMG) / EXCEL CONTROL SYSTEMS / ADVANCE- ANANT / RMSCO (RAJASTHAN METAL) / SUMIP / CTM / L.S POWER / LEGRAND (NOVATEUR) / INDIANA / MM ENGG / SLOTCO / MEM	CATEGORY-3
24	UNDER FLOOR RACEWAYS & ITS ACCESSORIES	OBO BETTERMANN / BEC / ADVANCE- ANANT / SPC ELECTROTECH / CTM / MM ENTERPRISES	CATEGORY-3
25	CAPACITORS	SELEC / NEPTUNE / LAURITZ KNUDSEN / P2 POWER / LEGRAND (NOVATEUR) / HAVELLS / TDK INDIA / SCHNEIDER	CATEGORY-2

Anil Kumar
SUCCE)

[Signature]

[Signature]

ITEM CODE	ITEMS	PREFERRED MAKES (W.E.F. 10.07.2025)	CATEGORY FOR TEST CERTIFICATION/ INSPECTION
26	APFC PANEL/ ACTIVE & PASSIVE (HYBRID) PANEL	MAK / APPLICATION CONTROL PANEL / SHIV SHAKTI ENGINEERS / TENCO / RISHA / INPHASE POWER TECHNOLOGIES PVT LTD / GLOBAL / R.P. CONTROLS / ULTIMA / SUPERTech CONTROL SYSTEMS / SWITCHGEARS & FABRICATORS (SGF) / POWERTECH SWITCHGEARS / HAROLD / AB POWER / URJAYANT / SELEC / EAP / CG POWER / P2 POWER / KEPL (KHOKHAR) / ITE-GURGON (INDIAN TRANSFORMERS) / CONQUERENT / BCH / ANANT POWER (ADVANCE) / RISHA / HAVELLS / CORONET / SPC ELECTROTECH / PEATON / L.S POWER / MILESTONE / LAURITZ KNUDSEN / LEGRAND (NOVATEUR) / C&S / NEPTUNE / SCHNEIDER / NEPTUNE / P2 POWER / SELEC / ANANT POWER (ADVANCE) / SCHNEIDER / SPC ELECTROTECH / ADLEC / RST ELECTRICALS PVT LTD / TDK INDIA / TRICOLITE / AMBIT	CATEGORY-1
27	LIGHTENING PROTECTION SYSTEM (LPS) COMPLYING UPDATED IEC / NBC	JEF / OBO BETTERMANN / GROUND ECA3G / NEXPO POWER SOLUTIONS / CAPE / JMV / ABB / DEHN / PHEONIX / TERCEL	CATEGORY-3
28	EARTHING SYSTEM (CHEMICAL)	JEF / OBO BETTERMANN / GROUND ECA3G / TERCEL / BEC / DEHN / ABB / JMV / NEXPO POWER SOLUTIONS / RMSCO (RAJASTHAN METAL) / CAPE / JK CHEMRODE / PROTEC-DHRUVA (DHRUVA) / APS	CATEGORY-3
29	SURGE PROTECTION DEVICES	OBO BETTERMANN / DSS / GROUND ECA3G / TERCEL / WAGO / HAVELLS / ABB / CAPE / LAURITZ KNUDSEN / LEGRAND (NOVATEUR) / DEHN / MERSEN / JMV / PHOENIX CONTACT / PROTEC ALLIED / SECOM / CITEL	CATEGORY-3
30	SCADA (HARDWARE & SOFTWARE, EXCEPT COMPUTER & ACCESSORIES)	LAURITZ KNUDSEN / WAGO / PHOENIX CONTACT / HONEYWELL / SCHNEIDER / SIEMENS	CATEGORY-2
31	SF6 CIRCUIT BREAKER/ VACUUM CIRCUIT BREAKER	EATON / VOLTAMP / LAURITZ KNUDSEN / PASCAL / EATON / CG POWER / ABB / SCHNEIDER / SIEMENS	CATEGORY-2
32	SERVO / AUTOMATIC VOLTAGE STABILIZER	POWERWARE / KRYKARD / FUJI ELECTRIC / PVJ POWER / SELEC / ITE-GURGON (INDIAN TRANSFORMERS) / P2 POWER	CATEGORY-2
33	AUTO TRANSFER SWITCH (ATS)	EATON / HPL / LAURITZ KNUDSEN / LEGRAND (NOVATEUR) / SOCOMEC / HAVELLS / ASCO (SCHNEIDER)	CATEGORY-2
34	COMPACT SUB STATION	PVJ POWER / CORONET / ITE-GURGON (INDIAN TRANSFORMERS) / CONQUERENT / SUDHIR POWER / PEATON / L.S POWER / VOLTAMP / LAURITZ KNUDSEN / ABB / SCHNEIDER	CATEGORY-1
35	EMERGENCY LIGHT - LED (PORTABLE)	LIFE-GUARD / PROLITE	CATEGORY-3
36	CABLES GLANDS	HENSEL / POLYCAB / TRINITY TOUCH / ROXTEC / BRACO / MCI / (METAL/ CRAFT)	CATEGORY-3
37	LUGS & THIMBLES	WAGO / POLYCAB / TRINITY TOUCH	CATEGORY-4
38	SYNTHETIC / PVC INSULATING MATS	CPRi certified for required voltage level	CATEGORY-2
39	INSULATION TAPE (HT / LT)	MODI's / BENLO / ANCHOR	CATEGORY-4
C	DG SETS & RELATED ITEMS		
40	DIESEL ENGINE ABOVE 250 KVA	GREAVES COTTON / BAUDOUIN (SHANDONG) / MAHINDRA POWEROL / PERKINS / CUMMINS / KOEL / CATERPILLAR	CATEGORY-1
41	DIESEL ENGINE UPTO AND INCLUDING 250 KVA	GREAVES COTTON / BAUDOUIN (SHANDONG) / TMTL (TAFE MOTERS) / CUMMINS / MAHINDRA POWEROL / ASHOK LEYLAND / KOEL / CATERPILLAR	CATEGORY-1


SM(EE)
MIS95TD





ITEM CODE	ITEMS	PREFERRED MAKES (W.E.F. 10.07.2025)	CATEGORY FOR TEST CERTIFICATION/ INSPECTION
42	ALTERNATOR	TDPS (TD POWER SYSTEM) / KIRLOSKAR / CATERPILLAR / GREAVES COTTON	CATEGORY-1
43	BATTERIES-LED ACID/LI-ION	CLN / EXIDE / AMARON	CATEGORY-3
44	BATTERY CHARGER	SELEC / VERTIV / DELTA	CATEGORY-2
45	UPS - ABOVE 10 KVA	DELTA / ORION / FUJI ELECTRIC / KRYKARD / 3EM / PROSTARM / UNILINE/ TMEIC / POWER ONE / RIELLO / ABB / SOCOMEC / EATON / SCHNEIDER / NUMERIC-LEGRAND/ VERTIV (EMERSON)	CATEGORY-3
46	UPS - UPTO 10 KVA	DELTA / ORION / FUJI ELECTRIC / KRYKARD / PROSTARM / RIELLO / UNILINE / ABB / POWER-ONE / DELTA / SOCOMEC / EATON / SCHNEIDER / NUMERIC-LEGRAND / VERTIV (EMERSON)	CATEGORY-3
D	INTERNAL WIRING RELATED TEAMS		
47	MCB / ISOLATOR / MCBDB / RCCB / RCBO / ELCB	ANCHOR (PANASONIC) / ORIENT ELECTRIC / LAURITZ KNUDSEN / MITSUBISHI / LEGRAND (NOVATEUR) / C&S / HPL / ABB / POLYCAB / HAVELLS / SCHNEIDER / INDO ASIAN (NOVATEUR) / GM / MK HONEYWELL / BCH / EATON	CATEGORY-2
48	MS CONDUIT (ISI MARKED)	VPL / BEC / AKG / STEEL KRAFTS / TRINITY TOUCH / RMCON (RMG STEELS) / SUPER / JPC PIPES	CATEGORY-3
49	PVC CONDUIT (ISI MARKED)	VPL / FUSION / ASTRAL / SKYDA / BEC / NORPACK / MODI's / ANCHOR (PANASONIC) / POLYCAB / TRINITY TOUCH / AKG / GM / JPC PIPES	CATEGORY-3
50	INDUSTRIAL SOCKET IN SHEET STEEL ENCLOSURE WITH MCB/SWITCH	AJMER ELECTROTECH LLP / LAURITZ KNUDSEN / POLYCAB / NEPTUNE-BALS / LEGRAND (NOVATEUR) / C&S / BCH / HAVELLS / HPL / SCHNEIDER	CATEGORY-4
51	INSULATED COPPER WIRE	RAJNIGANDHA / GEMSCAB / ALLCAB / AURAFLEX / V-MARC / SBEE / UNISTAR / POLYCORE / TORTEK / BATRA HENLAY / RR KABEL / AKG / ANCHOR (PANASONIC) / BENTEC / JMW KABEL / POLYCAB / AVOCAB (CHANDRESH) / SVARN / PARAMOUNT / RALLISON (LKB) / HAVELLS / NATCAB (KVALITY) / BONTON / GRANDLAY / GLOSTER / BCH / PLA / APAR / GM / PARAGON (ELEKTRON) / FINECAB / ZENIUM	CATEGORY-2
52	SWITCHES/ SOCKETS/ TELEPHONE/ TV/ DATA SOCKET/ BOXES (MODULAR TYPE)	RR KABEL / ANCHOR (PANASONIC) / ORIENT ELECTRIC / INDO ASIAN (NOVATEUR) / C&S / POLYCAB / HPL / LAURITZ KNUDSEN / LEGRAND (NOVATEUR) / HAVELLS / GM / MK HONEYWELL / WESTERN VEGA / ABB	CATEGORY-3
53	SWITCHES/ SOCKETS/ TELEPHONE/ TV/ DATA SOCKET/ BOXES (PIANO TYPE)	ANCHOR (PANASONIC) / BENTEC / HAVELLS / HPL / POLYCAB / MK HONEYWELL / WESTERN VEGA	CATEGORY-3
E	FIRE ALARM EQUIPMENTS		
54	FIRE / SMOKE DETECTOR/ MULTI CRITERIA DETECTOR/ FIRE ALARM PANEL / REPEATER PANEL/ HOOTER / MANUAL CALL POINT / RESPONSE INDICATOR/ FAULT ISOLATOR	NOTOFIRE / VELOX / SCHNEIDER / PANASONIC / EATON / HOCHIKI / RAVEL / SIEMENS / BOSCH / APOLLO / EDWARDS (UTC) / G + M / SCHRACK / HONEYWELL / KIDDE (UTC) / GST (UTC) / TYCO / ASES	CATEGORY-2

[Signature]
SM (EE)

[Signature]

[Signature]

ITEM CODE	ITEMS	PREFERRED MAKES (W.E.F. 10.07.2025)	CATEGORY FOR TEST CERTIFICATION/ INSPECTION
55	FIRE SURVIVAL CABLE	GEMSCAB / SBEE / FRTEK / BATRA HENLAY / RR KABEL / SEPCIAL CABLES / SVARN / JMW KABEL / POLYCAB / ALOKE (ANKUR) / RALLISON (LKB) / KEC / GRANDLAY / RAVEL / GLOSTER / KEI / BONTON / BOSCH / WREXHAM / FUSION POLYMER	CATEGORY-2
56	FIRE SIGNAGES	ASES / LIFEGUARD (UNITED FIRE) / EATON / FIRE SHIELD / BOSCH / RAVEL / DELITE / AUTOGLO (PROLITE)	CATEGORY-3
57	ASPIRATION SYSTEM	SHOOTFIRE (VIMAL FIRE) / HOCHIKI / BOSCH / RAVEL	CATEGORY-2
F	LED LIGHT FIXTURE AND FANS		
58	LIGHT FIXTURE WITH LED - INDOOR	PYROTECH / GOLDWYN LED / KI KALINGIA / GM / NESSA / PLUS LIGHT TECH / LEGERO / MAGIK / LIGHTBOOK / LEKSA LIGHTING / R R KABEL (RR/ AARAYSTORM) / PANASONIC / EVEREADY / INSTAPOWER / POLYCAB / SURYA / HALONIX / HAVELLS / SIGNIFY / JAQUAR (JAQUAR LIGHTING) / HPL / BAJAJ / WIPRO / ORIENT / CROMPTON / REGENT	CATEGORY-2
59	LIGHT FIXTURE WITH LED - OUTDOOR/FACADE	PYROTECH / GOLDWYN LED / KI KALINGIA / GM / NESSA / PLUS LIGHT TECH / MAGIK / LIGHTBOOK / LEKSA LIGHTING / R R KABEL (RR/ AARAYSTORM) / PANASONIC / HPL / BENTEC (BENLO) / EVEREADY/ POLYCAB / K-LITE / SURYA / TRANSRAIL / HALONIX / HAVELLS / JAQUAR (JAQUAR LIGHTING) / SIGNIFY / INSTAPOWER / BAJAJ / WIPRO / ORIENT / CROMPTON / REGENT	CATEGORY-2
60	LINEAR LED/ CUSTOMISED/ DECORATIVE LED LIGHT FIXTURE	PYROTECH / GOLDWYN LED / KI KALINGIA / GM / LIGHT FORMS / PLUS LIGHT TECH / LEGERO / MAGIK / WMEL / FORUS / HUBLIT / LIGHTBOOK / PANASONIC / POLYCAB / R R KABEL (RR/ AARAYSTORM) / EVEREADY / SURYA / HALONIX / HAVELLS / HPL / SIGNIFY / BAJAJ / WIPRO / ORIENT / CROMPTON / REGENT	CATEGORY-2
61	AVIATION WARNING /OBSTRUCTION LIGHT	PYROTECH / FORUS / KI KALINGIA / HARYANA GENERAL INDUSTRIES / VSTP / K-LITE / SURYA / TRANSRAIL / HPL / INSTAPOWER / BAJAJ / WIPRO / CROMPTON /	CATEGORY-3
62	CEILING/ WALL / EXHAUST/ PEDESTAL FAN (CONVENTIONAL / BLDC)	ORIENT ELECTRIC / RR KABEL / ANCHOR (PANASONIC) / POLYCAB / HALONIX / HAVELLS / ALMONARD / USHA / KHAITAN	CATEGORY-3
63	HVLS FANS	MARUT AIR / RR KABEL / RITE HITE	CATEGORY-3
G	AIRCONDITIONING AND FIRE FIGHTING ACCESSORIES		
64	G I / M S PIPE (ISI MARKED)	VPL / ITL / BEC / APL APOLLO / PRAKASH SURYA / JINDAL STAR / TATA / SAIL / HIRA PIPES (RR ISPAT) /	CATEGORY-2
65	MANUAL VALVE - BUTTERFLY/ SLUICE / CHECK / NRV / FOOT/GATE / GLOBE	LEHRY / SANT / VENUS / NEWAGE FIRE / CASTLE / ZOLOTO / VTM (VA VALVES) / EMERALD / ADVANCE VALVES / DIVINE / C&R	CATEGORY-2
66	MOTORISED VALVE - BALANCING / MODULATING / PICB / DELTA T / CONTROL / MIXING	SANT / VTM (VA VALVES) / CASTLE / DANFOSS / ZOLOTO / ANERGY	CATEGORY-2
67	SUCTION / POT / Y- STRAINER	VENUS / CASTLE / ZOLOTO / ANERGY / SANT / VTM (VA VALVES) / EMERALD	CATEGORY-2
68	FLEXIBLE CONNECTION FOR SPRINKLER / SPRINKLER	LIFEGUARD (UNITED FIRE) / FIRE SHIELD / NEWAGE / EXFLAME / HD / SAFEFIRE	CATEGORY-2
69	FIRE HYDRANT LANDING VALVES/ INSTALLATION VALVE/ FIRE BRIGADE CONNECTION.	SHOOTFIRE (VIMAL) / LIFEGUARD (UNITED FIRE) / ZOLOTO / KALPEX (KALPATARU) / NEWAGE / EXFLAME / SAFEFIRE / HD / FIRE SHIELD	CATEGORY-2

Amil Kumar
SMCEE

late

By

ITEM CODE	ITEMS	PREFERRED MAKES (W.E.F. 10.07.2025)	CATEGORY FOR TEST CERTIFICATION/ INSPECTION
70	FIRE HOSE PIPES/ FIRST AID HOSE REEL/ BRANCH PIPE / NOZZLE / COUPLINGS	SHOOTFIRE (VIMAL) / LIFEGUARD (UNITED FIRE) / KALPEX (KALPATARU) / NEWAGE / FIRE SHIELD / EXFLAME / SAFEFIRE	CATEGORY-2
71	FIRE EXTINGUISHERS	DSS / KANEX / SHOOTFIRE (VIMAL) / LIFEGUARD (UNITED FIRE) / CEASEFIRE / SAFEFIRE / AFS (ADVANCED) / KALPEX (KALPATARU) / EXFLAME / SUPREMEX / FIRE SHIELD / MINIMAX / SAFEX	CATEGORY-2
72	GAS BASED FIRE SUPPRESSION SYSTEM	SYNERGY & SYNERGY PLUS / FIRECEASE / FIRETREX / VIVINA / ASES / CEASEFIRE / SHOOTFIRE (VIMAL) / LIFEGUARD (UNITED FIRE) / KALPEX(KALPATARU) / FOAMTECH / SUPREMEX / SIEMENS / FIRETREX (SVS)	CATEGORY-2
73	KITCHENHOOD GAS BASED SUPPRESSION SYSTEM	SYNERGY / FIRECEASE / FIRETREX / VIVINA / SHOOTFIRE (VIMAL) / UNITED / FOAMTECH / CEASEFIRE / KALPATARU /	CATEGORY-2
74	HIGH/LOW PRESSURE WATER MIST BASED FIRE SUPPRESSION SYSTEM	SYNEAQUAMIST / FIRETREX / SHOOTFIRE	CATEGORY-2
75	FLOW SWITCH/PRESSURE SWITCH	OMICRON / ANERGY / DANFOSS / EMERALD / SWIZER	CATEGORY-3
76	FIREMAN AXE	LIFEGUARD (UNITED FIRE) / NEWAGE / FIRE SHIELD / ADVANCE	CATEGORY-3
77	DIESEL ENGINE DRIVEN PUMP FOR FIRE FIGHTING	TMTL (TAFE MOTERS) / KSB / WILO / GRUNDFOS / KIRLOSKAR / ASHOK LEYLAND / CATERPILLAR / MAHINDRA POWEROL	CATEGORY-2
78	PUMPS -VERTICAL/ HORIZONTAL / SUBMERSIBLE	HAVELLS / WILO / GRUNDFOS / ANDRITZ / KSB / KIRLOSKAR / XYLEM / AQUA_ANS / MATHER & PLATT / CROMPTON	CATEGORY-2
79	MOTORS	LHP / ROTOMOTIVE / KSB / HAVELLS / TMEIC / GRUNDFOS / BCH / KIRLOSKAR / BHARAT BIJLEE / ALSTOM / SEIMENS / CROMPTON	CATEGORY-2
80	MOTOR STARTER	BENTEC / KSB / HAVELLS / L.S POWER / GRUNDFOS / PHOENIX / C&S / BCH / SCHNEIDER / EATON / MOTOVARIO / SIEMENS / SCHNEIDER	CATEGORY-2
81	SINGLE PHASE PREVENTER / OVER LOAD PROTECTION/HIGH VOLTAGE/LOW VOLTAGE/EARTH FAULT PROTECTION	C&S / LAURITZ KNUDSEN / SELEC / SIEMENS	CATEGORY-3
82	G I SHEETS	JSW STEEL / TATA / HSL / SAIL	CATEGORY-2
83	GRILLS /DIFFUSERS	PRECISE / ASAWA INSULATION / MAPRO (AIR FLOW) / CRYSTAL / TRISTAR	CATEGORY-3
84	INSULATION MATERIAL - ROCK WOOL/ GLASS WOOL	ENSAVE / ROCK INSUL / AEROLAM / SUNROCK (THERMOCARE ROCK WOOL) / INSUFLEX (THE SUPREME) / LIONROCK / POLYBOND / EPACK / TWIGA INSUL	CATEGORY-3
85	INSULATION MATERIAL - XLPE/EPDM/ NITRILE RUBBER	AEROFOAM / PARAMOUNT / SAFARI / AEROLAM / INSUFLEX (THE SUPREME) / EPACK / SUNROCK (THERMOCARE ROCK WOOL) / INSUFLEX (THE SUPREME) / LIONROCK / POLYBOND / TWIGA INSUL	CATEGORY-3

(Signature)
SM (EE)

(Signature)

(Signature)

ITEM CODE	ITEMS	PREFERRED MAKES (W.E.F. 10.07.2025)	CATEGORY FOR TEST CERTIFICATION/ INSPECTION
86	PRE-INSULATED DUCT	ASAWA INSULATION / MECHEASY	CATEGORY-3
87	PRE-FABRICATED GI DUCT	ASAWA INSULATION / WAD / DUCTOFAB / WAVES / ZECO / ADVANCE VENTILATION	CATEGORY-3
88	FIRE DAMPERS	MAPRO (AIR FLOW) / GREENHECK / TRISTAR / RUSKIN / CARRIER	CATEGORY-2
89	AIR CURTAINS	EURONICS / MITZVAH / TECHNOCRATS / DOLPHY	CATEGORY-2
90	MODULATING MOTOR/FIRE DAMPER MOTOR	LHP / ANERGY / HONEYWELL / GRUNDFOS / BALEMO / SIEMENS	CATEGORY-2
91	AIR FILTERS (MERV/ESP/HEPA) FOR HVAC SYSTEM	MECHMAARK / ADITYA / O2 CURE / WAVES / HUMIDIN / INTELLIGREEN	CATEGORY-3
92	THERMOSTATS / HUMIDISTATS	OMICRON / ANERGY / FINDER / DANFOSS / HONEYWELL	CATEGORY-3
93	THERMOMETERS/ PRESSURE GAUGE	OMICRON / ANERGY / EMERALD / FIEBIG	CATEGORY-3
94	INTEGRATED BUILDING MANAGEMENT SYSTEM ((IBMS)/BMS/ SCADA SYSTEM (HARDWARE* & SOFTWARE, EXCEPT COMPUTER & ACCESSORIES)	SCHNEIDER / ENLITE / PANASONIC / WAGO / PHOENIX / SIEMENS / AZBIL / LAURITZ KNUDSEN / TRIDIYM (* includes all hardware of BMS)	CATEGORY-3
95	FIELD DEVICES (FOR IBMS/BMS/SCADA)	SELEC / OMICRON	CATEGORY-3
96	VFD DRIVE	YASKAWA / SELEC / FUJI / TMEIC / LAURITZ KNUDSEN / DANFOSS / SCHNEIDER / SIEMENS	CATEGORY-3
H	AC PLANTS, AC UNITS & EQUIPMENTS		
97	AIR-CONDITIONER UNITS - SPLIT / WINDOW / CASSETTE/ TOWER	HAVELLS / HITACHI (JOHNSON) / LG / BLUE STAR / DAIKIN/ VOLTAS / SAMSUNG / HAIER / O GENERAL / PANASONIC / CARRIER	CATEGORY-2
98	PRECISION AIR CONDITIONING (PAC)	CLIMAVENTA / SWEGON BLUE BOX / SIDWAL	CATEGORY-3
99	PACKAGED AIRCONDITIONER	DAIKIN / HITACHI (JOHNSON) / VOLTAS / LG / SIDWAL / CARRIER / DAIKIN / BLUE STAR	CATEGORY-2
100	CHILLERS	KIRLOSKAR / DAIKIN / CARRIER / VOLTAS / BLUE STAR / LG / CLIMAVENETA / TRANE / YORK / SWEGON BLUE BOX / DUNHAMBUSH	CATEGORY-1
101	AIR HANDLING UNITS (AHU)	CRYSTAL / CITIZEN / WAVES / EDGETECH / CARRIER / ZECO / HUMIDIN / TRISTAR	CATEGORY-1
102	FAN COIL UNIT (FCU)	WAVES / CRYSTAL / ZECO / CITIZEN / EDGETECH / CARRIER / DAIKIN / TRISTAR / YORK	CATEGORY-2
103	VRV/ VRF HVAC UNIT	LG / HITACHI (JOHNSON) / SAMSUNG / DAIKIN / VOLTAS / HAIER / CARRIER / BLUE STAR	CATEGORY-2

Amelponko
SMEP
MUST SFD

Info

P

ITEM CODE	ITEMS	PREFERRED MAKES (W.E.F. 10.07.2025)	CATEGORY FOR TEST CERTIFICATION/ INSPECTION
104	COOLING TOWER UP TO 200 TR.	DELTA / BELL COOLING TOWERS / MIHIR / PAHARPUR	CATEGORY-2
105	COOLING TOWER ABOVE 200 TR.	DELTA / BELL COOLING TOWERS / MIHIR / PAHARPUR	CATEGORY-2
106	EXPANSION TANK	ANERGY	CATEGORY-3
107	AIR & DIRT SEPARATOR	ANERGY	CATEGORY-3
108	FAN - AXIAL FLOW / INLINE / VENTILATION / PROPELLER / PLUG	DYNAIR-MAICO / DUSTECH / KRUGER / WAVES / HUMIDIN / WOLTER / AIR FLOW / RR KABEL / CRYSTAL / GREENHECK	CATEGORY-2
109	R O SYSTEM /WATER SOFTENING PLANT	SURYA RO / DELTA / WAE / VENZA (MGROW)	CATEGORY-3
110	WATER COOLER	CLIMATROL / VOLTAS / ORIENT ELECTRIC / SIDWAL	CATEGORY-3
111	WATER DISPENSER	WAE / VENZA (MGROW) / VOLTAS	CATEGORY-3
112	DRINKING WATER FOUNTAIN	WAE / VENZA (MGROW) / OASIS	CATEGORY-3
I	PA SYSTEM & RELATED ITEMS		
113	AMPLIFIERS	ATEIS / SCHRACK / HEINRICH / BOSCH / HONEYWELL / OPTIMUS / BOSE	CATEGORY-2
114	ANNOUNCEMENT MICROPHONES /CAR CALL CONSOLES	ATEIS / SCHRACK / HEINRICH / BOSCH / HONEYWELL / OPTIMUS / BOSE	CATEGORY-2
115	CONTROLLERS	ATEIS / SCHRACK / BOSCH / HEINRICH / HONEYWELL / OPTIMUS	CATEGORY-3
116	SPEAKER	ATEIS / SCHRACK / HEINRICH / BOSCH / NOTIFIRE / OPTIMUS / BOSE	CATEGORY-3
117	DIGITAL CALL STATION / WORK STATION	AVTRON / ATEIS / HEINRICH / BOSCH / OPTIMUS	CATEGORY-3
118	EQUIPMENT RACK	HEINRICH / BOSCH / PRESIDENT / ORDEIN	CATEGORY-3
119	DVD/DVR /MP3 PLAYER	TYCO / HEINRICH / BOSCH / HONEYWELL / SIEMENS / OPTIMUS	CATEGORY-2
120	CABLE FOR MICROPHONE / SPEAKER	RR KABEL / JMW KABEL / POLYCAB / BONTON / BOSCH / HPL / KVV (INDUSTRIAL)	CATEGORY-2
121	DIGITAL LINE ARRAY SPEAKER	ATEIS / HEINRICH / BOSCH / BOSE / OPTIMUS	CATEGORY-2
122	CCTV CAMERA	AVTRON / TYCO ILLUSTRATE / HEINRICH / SIEMENS / BOSCH / HONEYWELL / ULTRAK / PELCO	CATEGORY-2
123	MONITOR /DISPLAY-LCD / LED / PLASMA	LG / PANASONIC / SAMSUNG / SONY	CATEGORY-2
124	COMPUTER /LAPTOP (FOR IBMS/BMS/SCADA)	HP / DELL / LENOVO / IBM	CATEGORY-4
125	COMPUTER ACCESSORIES (KEY BOARD/MOUSE)	HP / DELL / LENOVO / IBM	CATEGORY-4

Anil Kumar
SMCEE

[Signature]

[Signature]

ITEM CODE	ITEMS	PREFERRED MAKES (W.E.F. 10.07.2025)	CATEGORY FOR TEST CERTIFICATION/ INSPECTION
J	SOLAR PLANT & ACCESSORIES		
126	SOLAR INVERTER/ POWER CONDITIONING UNIT	SELEC / HAVELLS/ POWER ONE	CATEGORY-2
127	SOLAR MODULES	SWELECT / HAVELLS/ JAKSON	CATEGORY-2
128	DC CABLES	GEMSCAB / APAR / RR KABEL / SPECIAL CABLES / JMW KABEL / POLYCAB / HAVELLS / RALLISON (LKB) / KEC / HPL / GLOSTER / KEI / BONTON	CATEGORY-2
K	MISCELLANEOUS & OTHER MECHANICAL ITEMS		
129	HAND DRIER	TECHNOCRATS / EURONICS / DOLPHY / ANAND AUTOMATIC SYSTEM	CATEGORY-3
130	DOUBLE WALL CORRUGATED HDPE PIPE/PLAIN HDPE PIPE	VPL / GANGOTRI / ASTRAL / CPE / BEC PLAST / KESHAV KRIPA / VALENS / TIRUPATI PLASTOMATIC / GEMINI / HIMALYAN / MANGALAM	CATEGORY-3
131	AUTOMATIC SLIDING DOOR	HOUSYS / GEZE / NEPTUNE / S. ADITYA / DORMAKABA / TECHNOCRATS / AUTOINGRESS	CATEGORY-3
132	ELEVATOR	ORBIS / SCHINDLER / FUJITEC / INFRA / TRIO ELEVATOR / OMEGA ELEVATOR / ESCON / JOHNSON LIFTS / ECE / KONE / TKE / OTIS	CATEGORY-1
133	ESCALATOR /TRAVELATOR	ORBIS / SCHINDLER / TRIO ELEVATOR / OMEGA ELEVATOR / JOHNSON LIFTS / KONE / TKE / OTIS	CATEGORY-1
134	BOLLARD	HOUSYS / AVIANS / SWARAJ / S. ADITYA / TECHNOCRATS / EURONICS / NEPTUNE / BROSIS / FAAC	CATEGORY-3
135	BOOM BARRIER	HOUSYS / AVIANS / SWARAJ / S. ADITYA / DORMAKABA / TECHNOCRATS / BROSIS / NEPTUNE / AUTOINGRESS / FAAC / SPEEDGATZ	CATEGORY-3
136	TROLLEY GATE	AVIANS / SWARAJ / S. ADITYA / TECHNOCRATS / DELITE / AUTOINGRESS / LOTUS	CATEGORY-3
137	TYRE KILLER/SPIKE BARRIER	HOUSYS / SWARAJ / S. ADITYA / TECHNOCRATS / NEPTUNE / BROSIS / FAAC / SPEEDGATZ	CATEGORY-3
138	UNDER VEHICLE SCANNING SYSTEM	HOUSYS	CATEGORY-3
139	EXTERNAL LIGHTING POLES/ DECORATIVE LIGHT POLE	SUBHAM / AMBIKA POLES / LYSAGHTPOLE™ / VAKRANGEE / VSTP / UTKARSH / RMSCO (RAJASTHAN METAL) / SKIPPER / BP PROJECTS / K-LITE / TRANSRAIL / PRAKASH SURYA (SURYA ROSHNI) / SUMIP / SIGNIFY / BAJAJ / WIPRO / CROMPTON / ORIENT ELECTRIC	CATEGORY-3
140	HIGH MAST	SUBHAM / AMBIKA POLES / VAKRANGEE / VSTP / LYSAGHTPOLE™ / UTKARSH / SKIPPER/ BP PROJECTS / K-LITE / PRAKASH SURYA (SURYA ROSHNI) / TRANSRAIL / SIGNIFY / BAJAJ / WIPRO / ORIENT ELECTRIC / CROMPTON	CATEGORY-3
141	ALUMINIUM LADDERS / HYDRAULIC LADDERS	DELITE	CATEGORY-2
142	BOOM /SCISSOR/SPIDER/VERTICAL LIFT	MLIFT	CATEGORY-2
143	DASH FASTENERS	HILTI / FISCHER	CATEGORY-4
144	GEAR BOX	MGM VARVEL / iMAK	CATEGORY-3
145	GEARED MOTOR	LHP / LENZE / ROTOMOTIVE / MGM VARVEL / iMAK	CATEGORY-3
146	WEATHERPROOF JUNCTIONBOX	TRINITY TOUCH / SPELSBERG (CAPE) / RITTAL	CATEGORY-3

Amelapala
SMEB
MURST

Info

R

ITEM CODE	ITEMS	PREFERRED MAKES (W.E.F. 10.07.2025)	CATEGORY FOR TEST CERTIFICATION/ INSPECTION
147	EV CHARGERS	P2 POWER / E-FUEL / AXONIFY TECH SYSTEMS PRIVATE LIMITED	CATEGORY-1
L	GROUND LIGHTING ITEMS		
148	PAPI (NON-LED)	AMA / VARDHMAN / NASU SYSTEM	CATEGORY-1
149	LAMP (HALOGEN)	List of preferred makes for S.No. 148 to 152 is on LOPM Pg. No. 11 to 12	CATEGORY-1
150	AGL FITTING (LED)		CATEGORY-1
151	AGL FITTING (NON-LED)		CATEGORY-1
152	ALCMS / ILCMS		CATEGORY-1
153	ISOLATING TRANSFORMER	TRIO / CTC (CREATIVE TRADING) / VARDHMAN / AMA / BILDAL / ELECTROMACH / YOUYANG	CATEGORY-1
154	CONSTANT CURRENT REGULATOR (CCR)	VARDHMAN / AMA / HONEYWELL / YOUYANG / NASU SYSTEM	CATEGORY-1
155	5 KV GRADE AFL CABLE - UNSHIELDED / SHIELDED	GEMSCAB / APAR / RR KABEL / ALOKE (ANKUR) / RALLISON (LKB) / JRD / KEI / GLOSTER	CATEGORY-1
156	1.1 KV GRADE SECONDARY LEAD FOR AFL CABLE	GEMSCAB / APAR / RR KABEL / AMA / ELECTROMACH / ALOKE (ANKUR) / RALLISON (LKB) / JRD	CATEGORY-2
157	PLUGS / RECEPTACLE / CONNECTOR	CTC (CREATIVE TRADING) / ELECTROMACH / ALOKE (ANKUR) / VARDHMAN / NEPTUNE / AMA / BILDAL / YOUYANG	CATEGORY-2

Note: This is mere enlistment as preferred make and is subject to the compliance of Technical Specification mentioned in tender.

CATEGORY REQUIREMENT OF TEST CERTIFICATE/ INSPECTION

CATEGORY-1:

- Type test certificate for similar item done. If not one of the items offered is to be type tested.
- OEMs routine test certificate.
- Acceptance test to be conducted in the presence of AAI representative at OEMs factory.

CATEGORY-2:

- Type test for similar done. If not, one of the items offered is to be type tested.
- OEMs routine test certificate.
- Visual and functional check by PMC / Engineering Consultant representative (AAI official incase of non avialibility of PMC/ Engineering Consultant) at AAI airport site.

CATEGORY-3:

- OEM/ Dealer/ Contractor routine test certificate.
- Visual and functional check by PMC / Engineering Consultant representative (AAI official incase of non avialibility of PMC/ Engineering Consultant) at AAI airport site.

CATEGORY-4:

- Visual and functional check by PMC / Engineering Consultant representative (AAI official incase of non avialibility of PMC/ Engineering Consultant) at AAI airport site.

[Signature]
SM/CPD
MIS/STD

[Signature]

[Signature]

2. Annexure A1, Item code L-148 to 152 shall be read as below-

Sr. No.	Items	PREFERRED MAKES	Category For Test Certification/ Inspection
148	PAPI (NON-LED)	AMA / VARDHMAN FAA CERTIFIED / FAA COMPLIANCE (FOR INDEGENOUS MANUFACTURER) SUBJECT TO FULFILLING THE REQUIREMENT OF ICAO/DGCA-CAR AND APPROVAL AS PER SR NO.-3, PARA NO.-3 OF TC 03/2025	CATEGORY-1
149	LAMP (HALOGEN)	YOUYANG / PHILIPS / OSRAM / NARVA / AS RECOMMENDED BY OEM	CATEGORY-3
150(a)	AGL FITTING (LED)-ELEVATED	VARDHMAN / AMA FAA CERTIFIED / FAA COMPLIANCE (FOR INDEGENOUS MANUFACTURER) SUBJECT TO FULFILLING THE REQUIREMENT	CATEGORY-1

		OF ICAO/DGCA-CAR AND APPROVAL AS PER SR NO.-3, PARA NO.-3 OF TC 03/2025	
150(b)	AGL FITTING (LED)-INSET	FAA CERTIFIED / FAA COMPLIANCE (FOR INDEGENOUS MANUFACTURER) SUBJECT TO FULFILLING THE REQUIREMENT OF ICAO/DGCA-CAR AND APPROVAL AS PER SR NO.-3, PARA NO.-3 OF TC 03/2025	CATEGORY-1
151(a)	AGL FITTING (NON-LED)-ELEVATED	VARDHMAN / AMA FAA CERTIFIED / FAA COMPLIANCE (FOR INDEGENOUS MANUFACTURER) SUBJECT TO FULFILLING THE REQUIREMENT OF ICAO/DGCA-CAR AND APPROVAL AS PER SR NO.-3, PARA NO.-3 OF TC 03/2025	CATEGORY-1
151(b)	AGL FITTING (NON-LED)-INSET	FAA CERTIFIED / FAA COMPLIANCE (FOR INDEGENOUS MANUFACTURER) SUBJECT TO FULFILLING THE REQUIREMENT OF ICAO/DGCA-CAR AND APPROVAL AS PER SR NO.-3, PARA NO.-3 OF TC 03/2025	CATEGORY-1
152	ALCMS / ILCMS	VARDHMAN FAA CERTIFIED / FAA COMPLIANCE (FOR INDEGENOUS MANUFACTURER) SUBJECT TO FULFILLING THE REQUIREMENT OF ICAO/DGCA-CAR AND APPROVAL AS PER SR NO.-3, PARA NO.-3 OF TC 03/2025	CATEGORY-1

BOQ (for reference)			
Name of Work: Development of Lal Bahadur Shastri International Airport, Varanasi; SH: SITC of Perimeter Lighting, WDI and Landing T.			
Tender ID: 2026_AAI_283667_1			
Sl. No.	Description of items	Qty	Unit
Electrical Works			
1	Supply of LED light for street lighting of maximum rated capacity of 45 watt with minimum lumen efficacy of 110 lumens/watt, IP 65 & color temperature of 5700 K made of pressor die cast aluminum housing & heat resistant toughened clear glass including all accessories like electronic gear / driver with LED as light source suitable to operate on 140-270 V, 50 Hz AC supply complete as per the required specifications.	600.00	Nos.
2	Supply of 06 mtrs. high GI OCTAGONAL continuously tapered galvanised street light pole (bottom size 130 mm min. & top size 70 mm min.) with single arm GI bracket (length and design of bracket as approved by EIC) for installation of LED Street light luminaire (approx. 45 Watt) suitable for wind velocity as per IS 875 (but not less than 50 m/sec.), fabricated out of 3 mm MS plate in single section, suitable for installation on a precast foundation with supply of minimum 4 nos. of foundation bolt & anchor plate, rigid flange plate (200x200x12mm min.) welded with the base of pole for fixing on foundation bolts complete as reqd. for structural stability (Vetted by any IIT/NIT/Govt. Engg College/ reputed Consultant) as specified, weather proof and vandal resistant door flush with the exterior surface containing a terminal plate of 5 mm thick backlite sheet with 32 Amp heavy duty connector for loop in loop out cable terminations suitable for upto two numbers 4 core 25 Sq.mm cables & 6A DP MCB for each LED fixture connections, earthing bolts for continuous earth connection, complete as required & as specified.	394.00	Nos.
3	Supplying and fixing of 32 mm dia X 2.00 metres long G.I. pipe (medium class) bracket for mounting of LED street light fitting on wall including bending the pipe to the required shape, 2 nos 40 mm X 3 mm flat iron clamps with nuts, bolts and washer, painting the flat iron with primer and finish paint etc. including connection of LED lights complete as required.	164.00	Nos.
4	Erection of 06 Mtr. high G.I.OCTAGONAL pole & bracket with all accessories along with casting of reinforced cement concrete 1:2:4 (1 cement : 2 coarse sand : 4 graded stone aggregate 40 mm nominal size) foundation including excavation and refilling including positioning of template & foundation bolts (supplied with pole to match with pole base plate) & providing and fixing of DWC HDPE pipe of size 63 mm dia (2 pieces of min. 0.75 m length) in the foundation for loop-in-loop-out of the cable to the pole, including installation of LED street light, supplying of 3C X 2.5 sq.mm. Copper wire with lugs and making connections to the LED street light complete as required and as specified	394.00	Jobs
5	S.I.T.C. of High Efficiency Mono Crystalline (module efficiency should not be less than 17%), Lithium type battery of required capacity (confirming to BIS/ Intl Std.), High Efficiency Long Life LED of 45W with customized Lens for proper light distribution, dispersed beam, soothing to eyes with the use of proper optics and diffuser, Pole mounted with suitable size of bracket as per site requirements, “ALL IN ONE” TYPE having On-Grid/Hybrid Functionality OUTDOOR LED SOLAR LIGHTS with Autonomy of Minimum 12 hrs. (LED lights excluded, considered in Item no.#1).	120.00	Jobs

Sl. No.	Description of items	Qty	Unit
6	S.I.T.C. of outdoor type Feeder Pillar/Panel of PTTA type fabricated out of 14 SWG CRCA sheet having double doors with locking arrangement at front and openable back for easy access to cable alley, dust & vermin proof, totally enclosed, compartmentalised, rubber gasket on all doors. M S angle base frame, earth terminal bolts, internal wiring, connections etc comprising with the following switch gears suitable for operation on 415 V, 3 phase, 4 wire, 50 Hz AC power supply complete as required. The feeder pillar shall have the provision of M S angle stand fabricated out of 50 x 50 x 6 mm angle (legs of stand 300mm above ground and 300mm below grouted) suitable for installation of feeder pillar on M S stand including grouting the stand with cement concrete mortar(upto 300mm above GL) , nut bolts etc as required and as per enclosed specification conforming to relevant IS specification. Incoming 125 Amp four pole, 25 KA MCCB with thermal and Magnetic setting - 2 Set 125 Amp four pole, 25 KA MCCB with thermal and Magnetic setting - Bus Coupler - 1 Set Outgoing 32 Amp, TPN , 25 KA MCCB - 10 sets 200 Amp TPN aluminium busbar - 1 Set Metering panel with Voltmeter, Ammeter of suitable ranged, indication lamps RYB & Voltmeter & Ammeter Selector Switch for I/Cs	2.00	Jobs
7	S.I.T.C. of outdoor type Feeder Pillar/Panel of size approx. PTTA type fabricated out of 14 SWG CRCA sheet having double doors with locking arrangement at front and openable back for easy access to cable alley, dust & vermin proof, totally enclosed, compartmentalised, rubber gasket on all doors. M S angle base frame, earth terminal bolts, internal wiring, connections etc comprising with the following switch gears suitable for operation on 415 V, 3 phase, 4 wire, 50 Hz AC power supply complete as required. The feeder pillar shall have the provision of M S angle stand fabricated out of 50 x 50 x 6 mm angle (legs of stand 300mm above ground and 300mm below grouted) suitable for installation of feeder pillar on M S stand including grouting the stand with cement concrete mortar(upto 300mm above GL) , nut bolts etc as required and as per enclosed specification conforming to relevant IS specification. Incomer- 32 Amp, 4 pole, 10 KA MCCB with thermal and magnetic setting - 1 Set 100 Amp TPN aluminium busbar - 1 Set Outgoing- 16 Amp, TPN , 25 KA MCCB - 04 sets Metering panel with Voltmeter, Ammeter of suitable ranged, Indication lamps RYB & Voltmeter & Ammeter Selector Switch for I/Cs Timer of 24 hour dial type 240 V, 25 Amp Suitable rating Triple pole contactor for Timer - 1 Set Auto Manual Switch - 01 Set	4.00	Jobs

Sl. No.	Description of items	Qty	Unit
8	S.I.T.C. of outdoor type Feeder Pillar/Panel of size approx. PTTA type fabricated out of 14 SWG CRCA sheet having double doors with locking arrangement at front and openable back for easy access to cable alley, dust & vermin proof, totally enclosed, compartmentalised, rubber gasket on all doors. M S angle base frame, earth terminal bolts, internal wiring, connections etc comprising with the following switch gears suitable for operation on 415 V, 3 phase, 4 wire, 50 Hz AC power supply complete as required. The feeder pillar shall have the provision of M S angle stand fabricated out of 50 x 50 x 6 mm angle (legs of stand 300mm above ground and 300mm below grouted) suitable for installation of feeder pillar on M S stand including grouting the stand with cement concrete mortar (upto 300mm above GL) , nut bolts etc as required and as per enclosed specification conforming to relevant IS specification. Incomer- 32 Amp, 4 pole, 25 KA MCCB with thermal and magnetic setting - 2 Set 32 Amp, 4 pole, 25 KA MCCB with thermal and magnetic setting Bus coupler - 1 Set 100 Amp TPN aluminium busbar - 1 Set Outgoing- 16 Amp, TPN , 25 KA MCCB - 06 sets Metering panel with Voltmeter, Ammeter of suitable range, Indication lamps RYB & Voltmeter & Ammeter Selector Switch for I/Cs Timer of 24 hour dial type 240 V, 25 Amp Suitable rating Triple pole contactor for Timer - 1 Set Auto Manual Switch - 01 Set	4.00	Jobs
9	Supply of following Size 1.1 KV grade aluminium conductor XLPE insulated and PVC sheathed, steel strip armoured power cable as per IS 7098:1988 (Part-I) with upto date amendments: 3.5 Core X 185 Sq.mm	3300.00	Mtr
10	Supply of following Size 1.1 KV grade aluminium conductor XLPE insulated and PVC sheathed, steel strip armoured power cable as per IS 7098:1988 (Part-I) with upto date amendments: 3.5 Core X 95 Sq.mm	13310.00	Mtr
11	Supply of following Size 1.1 KV grade aluminium conductor XLPE insulated and PVC sheathed, steel strip armoured power cable as per IS 7098:1988 (Part-I) with upto date amendments: 4 Core X 25 Sq.mm	18930.00	Mtr
12	Supply and Laying of following size DWC HDPE pipe ISI marked along with all accessories like socket, bend, couplers etc. conforming to IS 14930, Part II complete with fitting and cutting, jointing etc. direct in ground (75 cm below ground level) including excavation and refilling the trench but excluding sand cushioning and protective covering etc., complete as required. (Make :-As per AAI preferred make list) 120 mm dia (OD-120 mm & ID-103 mm nominal)	3300.00	Mtr
13	Supply and Laying of following size DWC HDPE pipe ISI marked along with all accessories like socket, bend, couplers etc. conforming to IS 14930, Part II complete with fitting and cutting, jointing etc. direct in ground (75 cm below ground level) including excavation and refilling the trench but excluding sand cushioning and protective covering etc., complete as required. (Make :-As per AAI preferred make list) 63 mm dia (OD-63 mm & ID-51 mm nominal)	32240.00	Mtr
14	Laying and fixing of one number PVC insulated and PVC sheathed / XLPE power cable of 1.1 KV grade of following size on wall surface as required: Upto 35 sq. mm (clamped with 1mm thick saddle)	4733.00	Mtr
15	Providing and Laying of following dia 'B' class GI Pipe including excavation of hard / soft soil complete with threading and alignment of pipe, bituminous road/concrete surface cutting for laying the pipe and making good the same with 1:2:4 cement concrete etc. as required. ≥120 mm dia 'B' class GI Pipe	150.00	Mtr

Sl. No.	Description of items	Qty	Unit
16	Installation Testing and Commissioning of upto 45 watt LED type Road/ street light fixtures on perimeter wall on existing bracket . Installation shall be including earthing and connection with 1.5 Sq.mm PVC insulated copper conductor single flexible cable complete as required. (Weather-proof Box alongwith mounted 6A MCB to be provided for installation of fittings)	164.00	Jobs
17	Laying of one number PVC insulated & PVC sheathed XLPE power cable of 1.1 KV grade of following size in the existing masonry open duct as required a) Above 95 sqmm and upto 185 sqmm	200.00	Mtr
18	Laying of one number PVC insulated & PVC sheathe/XLPE power/Control cable of grade upto 1.1 KV of following size in the existing RCC/HUME/METAL/HDPE/ DWC pipes etc. as required. A) Up to 35 sq.mm. (4C cable)	32240.00	Mtr
19	Laying of one number PVC insulated & PVC sheathe/XLPE power/Control cable of grade upto 1.1 KV of following size in the existing RCC/HUME/METAL/HDPE/ DWC pipes etc. as required. A) Above 35 sq.mm. up to 95 sq.mm (3.5C Cable)	13310.00	Mtr
20	Laying of one number PVC insulated & PVC sheathe/XLPE power/Control cable of grade upto 1.1 KV of following size in the existing RCC/HUME/METAL/HDPE/ DWC pipes etc. as required. A) Above 95 sq.mm. up to 185 sq.mm. (3.5C Cable)	3300.00	Mtr
21	Supplying and making end termination with brass compression gland and Aluminium lugs for following size of PVC insulated and PVC sheathed / XLPE Aluminium conductor cable of 1.1 KV grade as required. a) 3.5 X 185 Sq.mm	8.00	Set
22	Supplying and making end termination with brass compression gland and Aluminium lugs for following size of PVC insulated and PVC sheathed / XLPE Aluminium conductor cable of 1.1 KV grade as required. a) 3.5 X 95 Sq.mm	20.00	Set
23	Supplying and making end termination by Aluminium lugs for following size of PVC insulated and PVC sheathed / XLPE Aluminium conductor cable of 1.1 KV grade as required. a) 1 X 25 Sq.mm	574.00	Set
24	Earthing with 'B' class G. I. earth pipe 4.5 Metres. long x 40 mm dia i/c accessories and providing masonry enclosures with cover plate having locking arrangement & watering pipe, funnel etc. i/c charcoal/ coke and salt complete as required as per specification.	120.00	Jobs
25	Providing and laying earth connection from earth electrode with 6 SWG dia G.I. Wire in 15 mm dia G.I. pipe medium class from earth electrode including connection with G.I. thimble excavation and re-filling as required.	600.00	Mtr
26	Providing and fixing 6 SWG G. I. wire on surface or in recess or with HDE/ DWC /GI/Hume pipe etc. for loop earthing as required.	17500.00	Mtr
27	Supplying & fixing cable route marker with 10X10X5mm thick GI plate with description there on bolted/welded to 35mmX35mmX6mm angle iron 60cm long and fixing the same in ground as required.	333.00	Jobs

Sl. No.	Description of items	Qty	Unit
28	Design, manufacture, supply, installation, testing and commissioning of outdoor type feeder pillar box as per latest IS of size 0.60 m X 0.75 m X 0.30 m (or bigger) with double door fabricated from 2 mm thick MS steel including TPN Bus bar of 415V, 200 Amp, 50 Hz with suitable equidistant arrangement for connection of 01 I/c and 04 Outgoing cables, cable entry from bottom, arrangement for earth connection, totally enclosed type with free standing floor mounted, dust & vermin proof etc including MS angle iron stand as per site requirement complete as required.	2.00	Jobs
29	Supplying and making straight through joint with heat shrinkable kit including ferrules and other jointing materials for following size of PVC insulated and PVC sheathed / XLPE aluminium conductor cable of 1.1 KV grade as required. 3½ X 185 sq. mm	5.00	Jobs
30	Supplying and making straight through joint with heat shrinkable kit including ferrules and other jointing materials for following size of PVC insulated and PVC sheathed / XLPE aluminium conductor cable of 1.1 KV grade as required. 3½ X 95 sq. mm	32.00	Jobs
31	Supply, Installation, Testing & Commissioning of Landing 'H' , direction indicator complying with ICAO & CAR standards consisting of three rectangular Aluminium limbs having length of 4000 Metre each supported with 50mm dia Aluminium pipe of 1350 mm length & frangible coupling with flanges, 9/10 watt LED lamp fixtures with glass dome (minimum IP 65) and lamps for each limb. each circuits to operate on 230 V, 50 Hz AC supply, providing control unit with suitable control transformer, Relay, Contactor, copper wiring upto Junction Box etc. as required for remote operation of landing 'T' from CCR Hall as well as from control tower, connections/interconnections, civil foundations for each legs along with MS anchor base plate, casting pedestal up to 1.0 Metre outside all around the landing 'H', with 1:2:4 cement concrete of 100 mm thick and neat finish top etc. complete as required as per site requirement. (excluding feeder cable)	1.00	Job
32	Supply, Installation, Testing & Commissioning of frangible & externally illuminated Wind Direction Indicator conforming to ICAO & CAR standards and suitable for operation on 230 V, 50 Hz single phase supply and consist of following as required at the given stations: (a) 4.5 Metre high FRP frangible pole/mast of red & white colour. The frangibility shall conforming to ICAO Annex 14 & Aerodrome design manual part-VI/FAA guidelines. (b) Wind sock cone should have a length of not less than 3.60 m and diameter, at larger end, of not less than 0.90 m as per technical specifications. (c) Illuminating indicator with Four nos. 20 watt LED lamps with lamps mounting arrangement for outdoor conditions. (d) One no. LED aviation obstruction light having aluminium cast body and red polycarbonate dome, internal wiring, provision for remote control operation. (e) Providing and laying 1:2:4 Cement Concrete foundation for installation of WDI and casting pedestal all around upto 7.5 m radius with 100mm thick 1:2:4 cement concrete & neat finish top surface as per OEM recommendations & as per direction complete as required as per site requirement.	2.00	Jobs
33	Supply and fixing of cable junction box suitable for termination of 4C x 25 sq mm Al armoured cable including terminals and knockouts for bottom cable entry having weatherproof housing IP 66 or better, suitable for wall mount/pole mount outdoor installation etc complete as required.	2.00	Jobs

Sl. No.	Description of items	Qty	Unit
34	Design, Supply, Installation, Erection, Testsing, Commissioning of 27.5M high Flag Mast. Mast Shaft shall be in three telescopic sections (with base plate welded to bottom section), hot dip galvanised steel externally & internally and suitable for wind velocity as per IS 875 (but not less than 50 m/s) along with special type dome and lightning finial (Mast shall be suitable for Indian Tri Color Flag Size 30Ft X 20Ft as per given technical specifications) including other assemblies as required with following accessories etc as per specifications: a) Supply and installation of twin dome LED aviation obstruction lights with 3Cx2.5 sqmmcopper conductor armoured cable with complete arrangement as per ICAO Specifications. b) System for Raising and lowering mechanism consisting of flag with double drum winch assembly, head frame assembly on top with self lubricating bearing, stainless steel wire ropes of minimum 6 mm. dia (Grade 316) etc. designed to operate with integral electric driven power tool motor of 2 hp capacity and also for manual operation. c) Providing and fixing of foundation bolts of M30 X 850 size manufactured from special steel along with nuts, washers, suitable size anchor plate and template, etc,as required. d) PU painting of High mast shaft with a coating of etch primer, primer and PU paint e) Supply, Installation, Testing and Commisioning of suitable size dust & vermin proof, IP 65, out door type, floor mounted Feeder Pillar Panel on cement concrete foundation, MS channel mounting frame of 50mm x 50mm x 5 mm thick MS Angle and 0.5 m long legs of same size foundation, fabricated with 14 SWG CRCA sheet steel complete with 3 mm thick detachable gland plate and front hinged door locking arrangement, totally enclosed, duly powder coated of approved shade as per manufacturer drawings/SLD, provision for bottom cable entry, panel shall also have common Al strip of 25 mm x 5 mm size at the rear with two numbers of earth studs and including wiring, interconnection with suitable size copper wire with the following switch gears complete as required. The Panel shall have 2KVA online UPS suitable to work on 200v-230v, 50Hz input and 230v, 50Hz out put along with SMF VRLA batteries to provide minimum 30 minutes back up time and as per technical specification, preferred make list etc including other desired accessories mentioned in technical specifications as required. UPS and battery shall be accomodated in separate compartment of control panel with proper air ventilation. INCOMER : - (a) Four Pole MCB 50 A, 10 KA, C Curve - 2 Nos. with 4 X 63 A Aluminium busbar with insulation sleeves (R,Y,B,N) (b) Manual Changeover Switch, 63 A-1 No. (c) Digital Multifuntion Meter -1 Nos. with set of suitable size CTs. (d) Phase indication LED lamps RYB, ON & OFF with suitable SPMCB - 02 Set (e) Suitable capacity overload protection relay and single phase preventer. OUT GOING : - (a) 10 A, 10 KA, C Curve, SPMCB-2 No. (b) 25 A, 10 KA, C Curve, SPMCB-1 No. (c) 5/15 A Switch Socket- 1 No. (d) Control system for raising/lowering of Flag-01 No. alongwith additional wired remote control for raising/lowering of Flag (e) Suitable rating Contactor operated through 24 Hours Timer Switch for the for the automatic switching of luminaries alongwith auto/manual selector switch	1.00	Job

Sl. No.	Description of items	Qty	Unit
35	Construction of shallow foundation with M30 grade concrete or as per foundation design submitted by OEM duly vetted by IIT/NIT/Reputed Govt. for the 27.5 m highmast considering the safe soil bearing capacity with soil testing report (min 10T/SQM) at site at suitable depth and of suitable size with all materials and labour. This item also covers the charges towards vetting of the foundation design (as submitted by OEM).	1.00	Job
36	Supply of Flood light LED fitting with minimum output of 38500 lumens and minimum 110 Lumens/Watt, for 230V Single Phase AC supply, 50Hz, PF>0.95, CRI>70, CCT - 5700K, Life of fitting not less than 50000 hrs complete as required. Luminaire should have high pressure die cast Aluminium/standard alloy housing with surge protection system > 4KV. Luminaire should have proper thermal management. Min IP protection should be IP65. It shall meet as per technical specification enclosed with tender complete in all respect as required as per direction and satisfaction of Engineer-Incharge.	4.00	Nos.
37	Installation, testing and commissioning of LED Flood light fitting with all accessories with mounting arrangement as required on existing 6.00 m octagonal pole including providing & wiring with 3Cx 2.5 sq.mm flexible PVC insulated copper conductor cable from the light fixture to MCB inside the pole.	4.00	Nos.